


POWER MAX SYSTEM

Condensation | Heating module

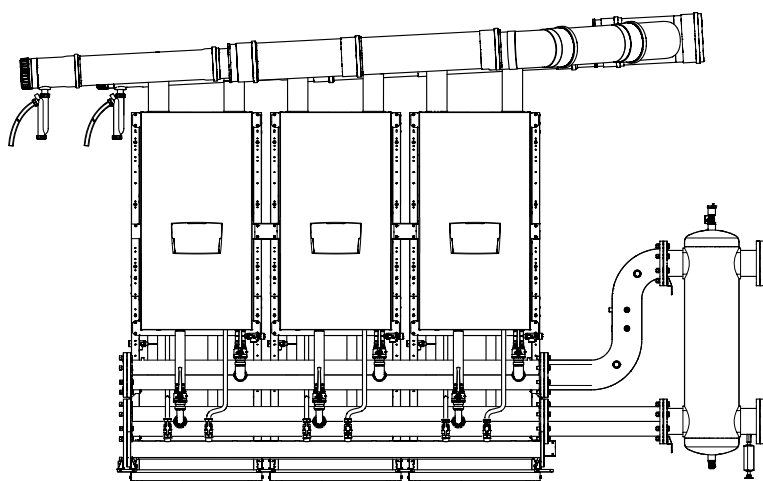

EN Installation Manual

CONTENTS

1	GENERAL INFORMATION	3	3.4	System parameters Block diagram 1.	59
1.1	General Safety Information	3	3.5	Block diagram 2.	60
1.2	Description of the appliance	3	3.5.1	Electrical power connections Block diagram 2.	61
1.3	System layout.	4	3.5.2	Sensor connections Block diagram 2.	61
1.3.1	In line lay-out (FRONT) with 2 modules	4	3.5.3	Bus connections Block diagram 2.	62
1.3.2	In line lay-out (FRONT) with 3 modules	5	3.6	System parameters Block diagram 2.	62
1.3.3	In line lay-out (FRONT) with 4 modules	6	3.7	Block diagram 3.	63
1.3.4	In line lay-out (FRONT) with 5 modules	7	3.7.1	Electrical power connections Block diagram 3.	64
1.3.5	In line lay-out (FRONT) with 6 modules	8	3.7.2	Sensor connections Block diagram 3.	64
1.3.6	In line lay-out (FRONT) with 7 modules	9	3.7.3	Bus connections Block diagram 3.	65
1.3.7	In line lay-out (FRONT) with 8 modules	10	3.8	System parameters Block diagram 3.	65
1.3.8	In line lay-out (FRONT) with 9 modules	11	3.9	Block diagram 4.	66
1.3.9	In line lay-out (FRONT) with 10 modules	12	3.9.1	Electrical power connections Block diagram 4.	67
1.3.10	B2B (BACK TO BACK) layout with 2 modules.	13	3.9.2	Sensor connections Block diagram 4.	67
1.3.11	B2B (BACK TO BACK) layout with 3 and 4 modules	14	3.9.3	Bus connections Block diagram 4.	68
1.3.12	B2B (BACK TO BACK) layout with 5 and 6 modules	15	3.10	System parameters Block diagram 4.	68
1.3.13	B2B (BACK TO BACK) layout with 7 and 8 modules	16	4	SYSTEM MANAGEMENT	69
1.3.14	B2B (BACK TO BACK) layout with 9 and 10 modules	17	4.1	Communication between the thermal modules.	69
1.4	Installation premises	18	4.1.1	Setting the dip-switch	69
1.5	Air vent.	19	4.2	Bus connections	69
2	INSTALLATION	20	4.3	Communication with Mixed Zone Controller	70
2.1	Preliminary installation measures.	20	5	COMMISSIONING AND MAINTENANCE	71
2.2	Assembly of the FRAMES	21	5.1	Repositioning the front panels.	71
2.3	Positioning the CONDENSATE PIPES	29	5.2	Putting the system into service	71
2.4	Positioning the 3" MANIFOLDS	30	5.3	Electronic control.	72
2.5	Positioning the 5" MANIFOLDS	34	5.3.1	USER navigation MENU.	72
2.6	Positioning the CONDENSATE OUTLET	38	5.3.2	Navigation Menu INSTALLER / MANUFACTURER	73
2.7	Positioning the GAS PIPES	39	5.3.3	Parameters specific to cascade systems	74
2.8	Positioning the DELIVERY-RETURN PIPES	42	5.3.4	Setting the main parameters	77
2.9	Positioning the SAFETY SECTION AND SEPARATOR	46	5.3.5	Par.5073 – Managing, Stand-alone, Dependent mode.	77
2.10	Neutralization of the condensate.	53	5.3.6	Par.4147 – No. thermal modules	77
3	CONFIGURATION OF THE MAIN BLOCK DIAGRAMS	54	5.3.7	Par.2007 – heating setpoint hysteresis	77
3.1	Configuration of the primary system	54	5.3.8	Par.9097 – definition of the system with circulator / system with two-way valve.	77
3.2	Configuration of the secondary system.	55	5.3.9	General operation	77
3.3	Block diagram 1.	57	5.4	Operation with the primary sensor.	77
3.3.1	Electrical power connections Block diagram 1.	58	5.5	Operation with the secondary sensor	78
3.3.2	Sensor connections Block diagram 1.	58	5.6	Parameter 4148: operating mode of the cascade.	78
3.3.3	Bus connections Block diagram 1.	59	5.6.1	Par 4148 = 0	78
			5.6.2	Par 4148 = 1	78
			5.6.3	Par 4148 = 2	79

The following symbols are used in this manual:



CAUTION! = Identifies actions that require caution and adequate preparation.



STOP! = Identifies actions that you MUST NOT do.



= identifies a sequence where "N" corresponds to the number of the phase described.

1 GENERAL INFORMATION

1.1 General Safety Information

-  This instruction booklet is an integral part of the instruction manual of the single appliance **POWER MAX**, to which you are referred for the GENERAL WARNINGS and for the BASIC SAFETY RULES
-  The instructions provided for the cascade accessories are an integral part of this manual. They must be referred to and must not be disposed of.

1.2 Description of the appliance


POWER MAX can be combined in cascade with other generators in order to create modular thermal power units, consisting of thermal modules connected hydraulically, the electronic controls of which communicate via bus. In fact, each thermal module has been designed to combine with other identical units, up to a maximum number of 10 units, with the exception of model 135 whereby the maximum number of models in cascade is 8.

For each thermal model it is possible to configure the different types of installations either in line (i.e. Front) or back to back (i.e. Back to Back).

Model	POWER MAX							
	50 P DEP	50 P	65 P	80 P	100	110	130	150
No. thermal modules	Total Cascade Power (kW)							
1	34,9	45	57	68	90	97	112	131
2	70	90	114	136	180	194	224	262
3	105	135	171	204	270	291	336	393
4	140	180	228	272	360	388	448	524
5	175	225	285	340	450	485	560	655
6	209	270	342	408	540	582	672	786
7	244	315	399	476	630	679	784	917
8	279	360	456	544	720	776	896	1048
9	314	405	513	612	810	873	1008	ND
10	349	450	570	680	900	970	1120	ND


1.3 System layout

1.3.1 In line lay-out (FRONT) with 2 modules

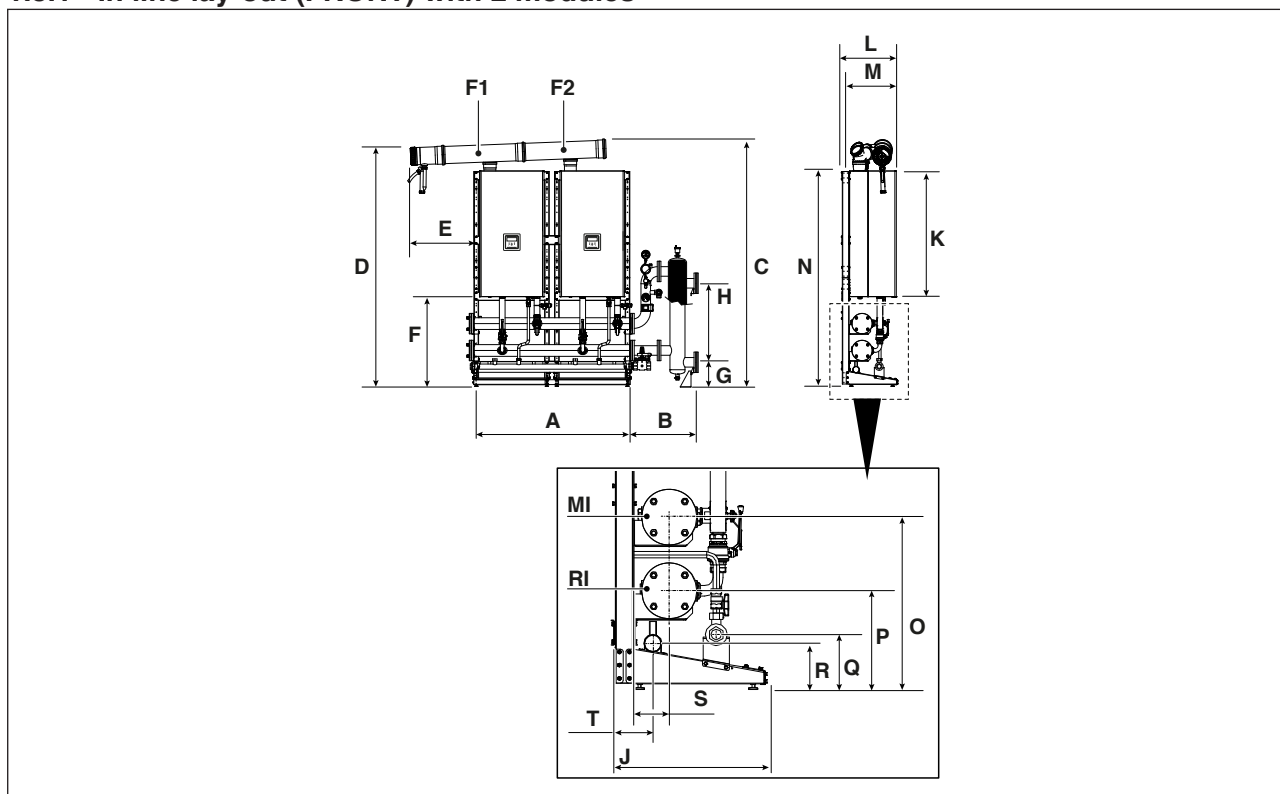


DESCRIPTION	POWER MAX								
	50 P DEP	50 P	65 P	80 P	100	110	130	150	
A	1494	1494	1494	1494	1494	1494	1494	1494	mm
B	591	591	591	591	591	591	591	591	mm
C	2275	2275	2131	2131	2131	2131	2301	2301	mm
D	2195	2195	2051	2051	2051	2051	2221	2221	mm
E	594	594	594	594	594	594	594	594	mm
F	834	834	834	834	834	834	834	834	mm
G	230	230	230	230	230	230	230	230	mm
H	735	735	735	735	735	735	735	735	mm
J	525	525	525	525	525	525	525	525	mm
K	1010	1010	1010	1010	1010	1010	1173	1173	mm
L	511	511	511	511	511	511	511	511	mm
M	436	436	436	436	436	436	436	436	mm
N	1999	1999	1999	1999	1999	1999	1999	1999	mm
O	584	584	584	584	584	584	584	584	mm
P	334	334	334	334	334	334	334	334	mm
Q	186	186	186	186	186	186	186	186	mm
R	156	156	156	156	156	156	156	156	mm
S	121	121	121	121	121	121	121	121	mm
T	137	137	137	137	137	137	137	137	mm
F1	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
RI	Ø 3"								inch
MI	Ø 3"								inch

1.3.2 In line lay-out (FRONT) with 3 modules

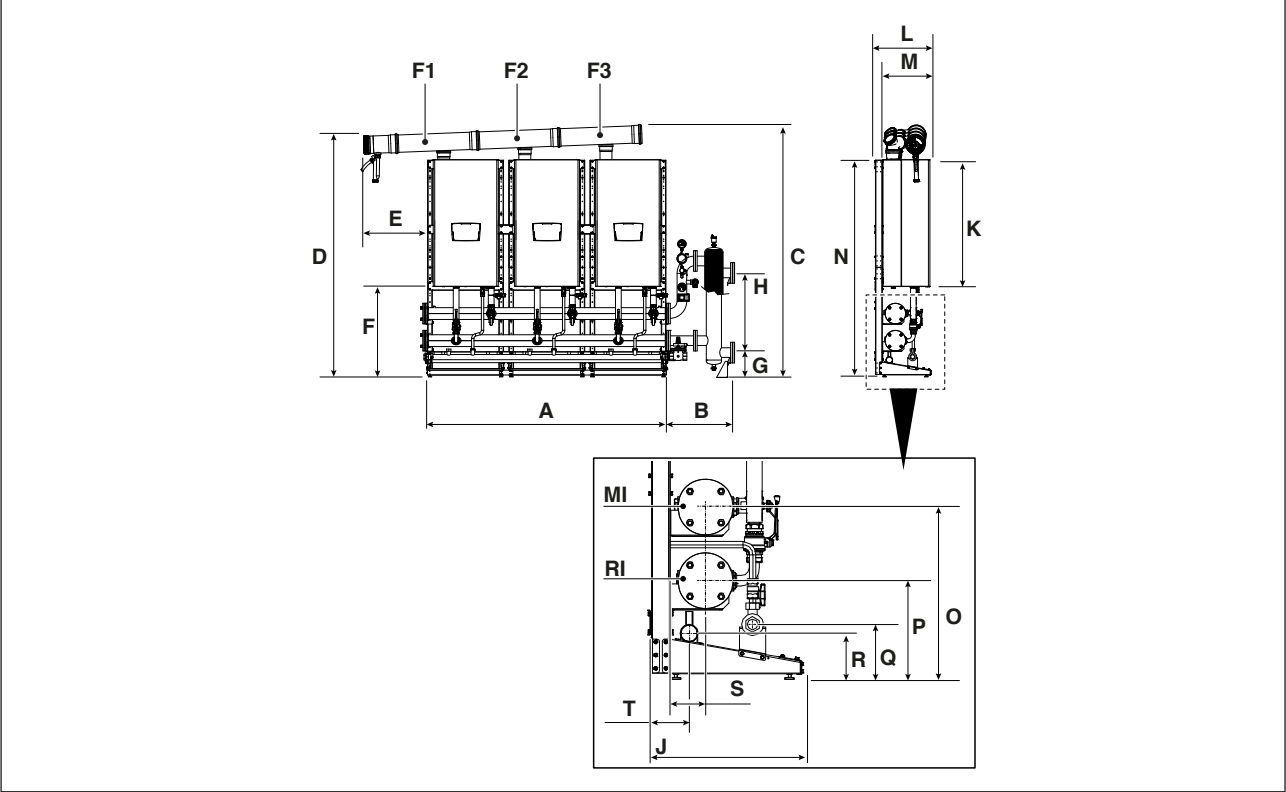


DESCRIPTION	POWER MAX								
	50 P DEP	50 P	65 P	80 P	100	110	130	150	
A	2242	2242	2242	2242	2242	2242	2242	2242	mm
B	591	591	591	591	591	591	591	591	mm
C	2305	2305	2161	2161	2161	2161	2240	2240	mm
D	2195	2195	2051	2051	2051	2051	2221	2221	mm
E	594	594	594	594	594	594	594	594	mm
F	834	834	834	834	834	834	834	834	mm
G	230	230	230	230	230	230	230	230	mm
H	735	735	735	735	735	735	735	735	mm
J	525	525	525	525	525	525	525	525	mm
K	1010	1010	1010	1010	1010	1010	1173	1173	mm
L	511	511	511	511	511	511	511	511	mm
M	436	436	436	436	436	436	436	436	mm
N	1999	1999	1999	1999	1999	1999	1999	1999	mm
O	584	584	584	584	584	584	584	584	mm
P	334	334	334	334	334	334	334	334	mm
Q	186	186	186	186	186	186	186	186	mm
R	156	156	156	156	156	156	156	156	mm
S	121	121	121	121	121	121	121	121	mm
T	137	137	137	137	137	137	137	137	mm
F1	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
RI	Ø 3"								inch
MI	Ø 3"								inch

1.3.3 In line lay-out (FRONT) with 4 modules

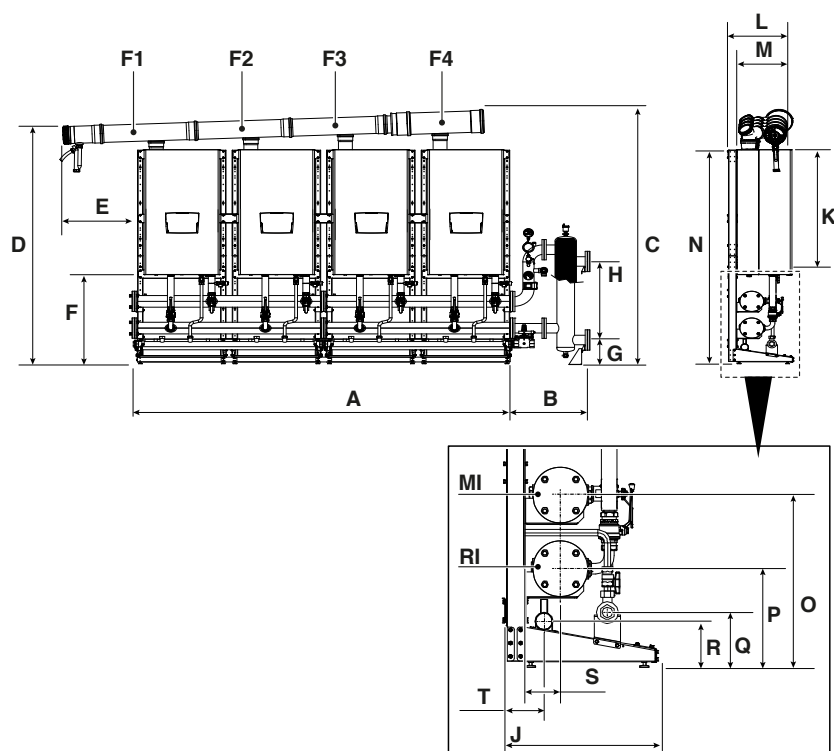


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		2988	2988	2988	2988	2988	2988	2988	2988	mm
B	3"	591	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2334	2334	2190	2190	2190	2190	2382	2382	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	230	230	230	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	337	mm
H	3"	735	735	735	735	735	735	735	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	850	mm
J		525	525	525	525	525	525	525	525	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		511	511	511	511	511	511	511	511	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
RI		Ø 3"							Ø 5"	inch
MI		Ø 3"							Ø 5"	inch

1.3.4 In line lay-out (FRONT) with 5 modules

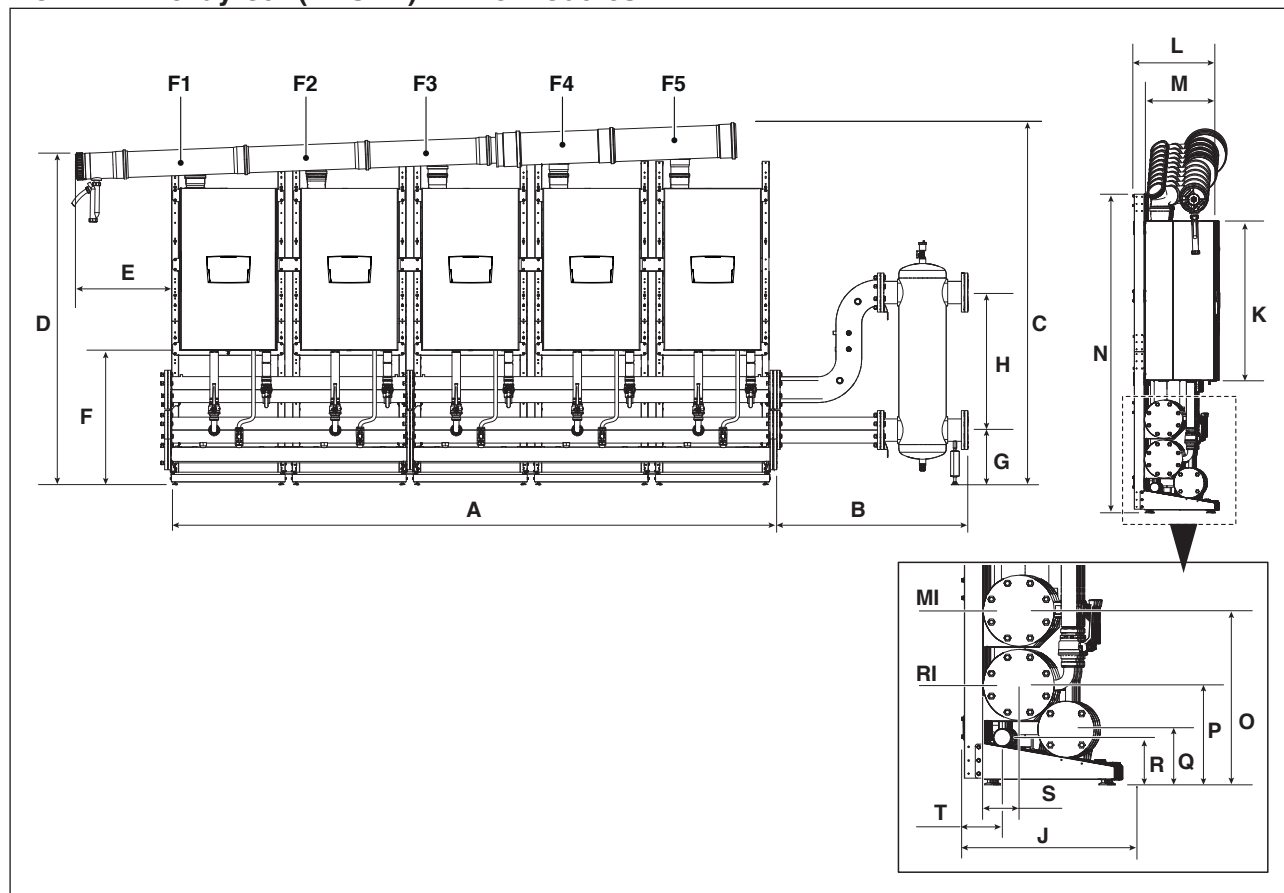


DESCRIPTION	POWER MAX								
	50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		3736	3736	3736	3736	3736	3736	3736	mm
B	3"	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	mm
C		2385	2385	2241	2241	2241	2411	2411	mm
D		2195	2195	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	230	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	337	337	mm
H	3"	735	735	735	735	735	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	850	850	mm
J		525	525	525	525	525	525	525	mm
K		1010	1010	1010	1010	1010	1173	1173	mm
L		511	511	511	511	511	511	511	mm
M		436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	mm
RI		Ø 3"					Ø 5"		inch
MI		Ø 3"					Ø 5"		inch

1.3.5 In line lay-out (FRONT) with 6 modules

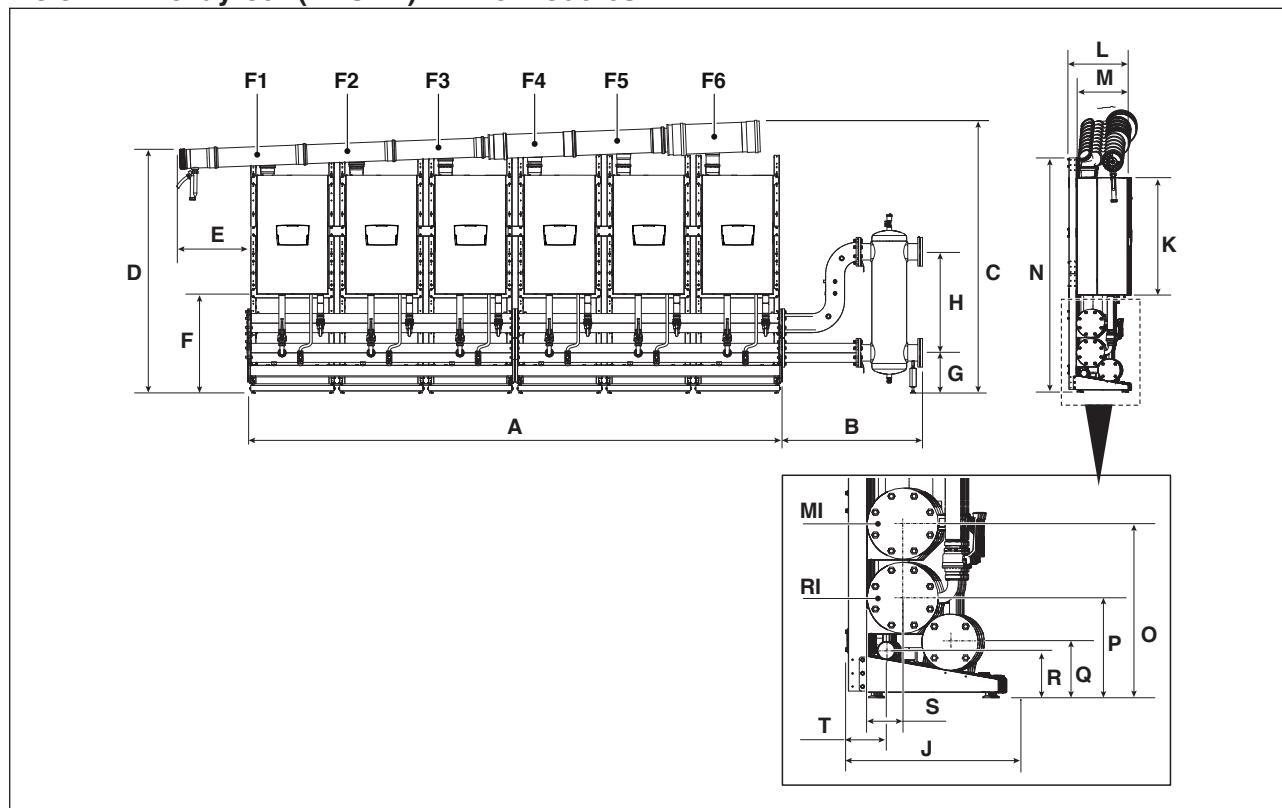


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		4484	4484	4484	4484	4484	4484	4484	4484	mm
B	3"	591	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2414	2414	2270	2270	2270	2270	2461	2461	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	337	337	337	337	mm
H	3"	735	735	735	735	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	850	850	850	850	mm
J		525	525	525	525	525	525	525	525	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		511	511	511	511	511	511	511	511	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 200	mm
F6		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	mm
RI		Ø 3"				Ø 5"				inch
MI		Ø 3"				Ø 5"				inch

1.3.6 In line lay-out (FRONT) with 7 modules

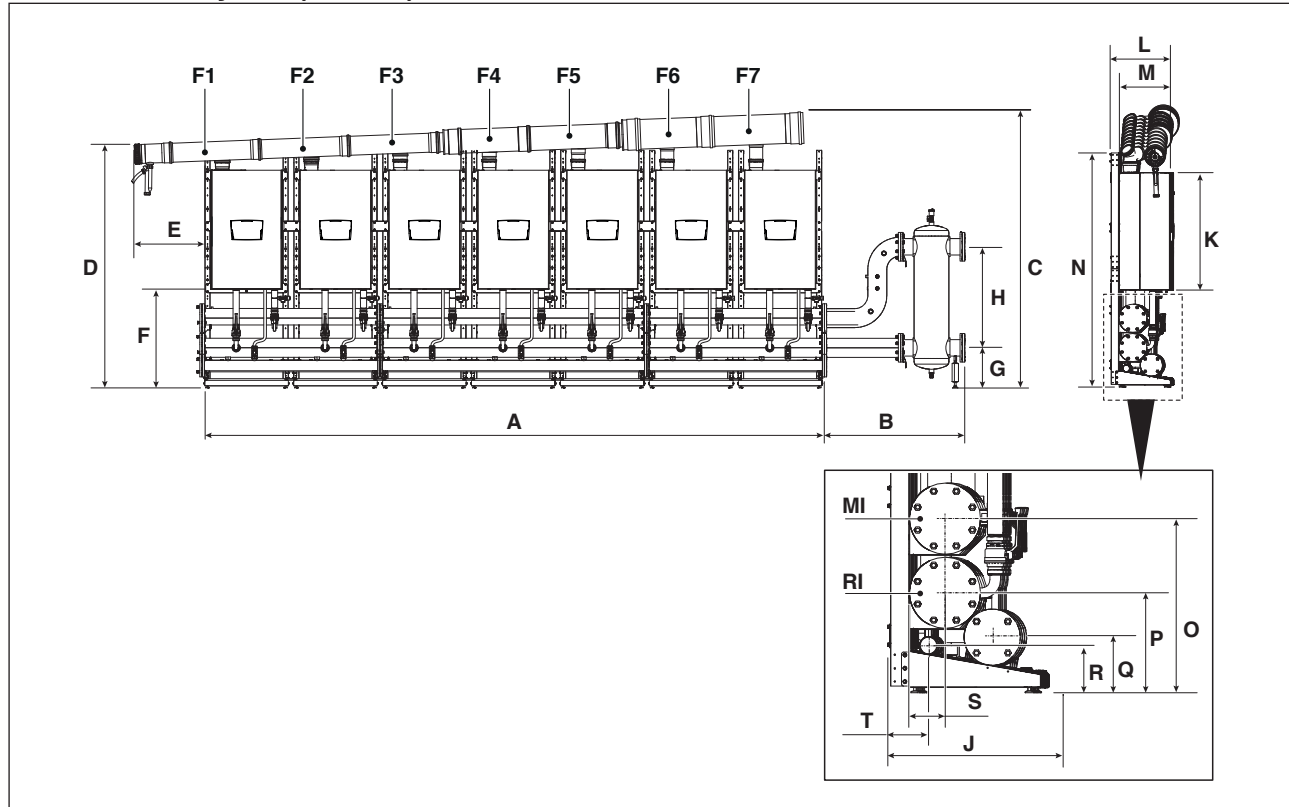


DESCRIPTION		POWER MAX							
		50 P DEP	50 P	65 P	80 P	100	110	130	150
A		5230	5230	5230	5230	5230	5230	5230	mm
B	3"	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	mm
C		2439	2439	2295	2295	2295	2295	2490	mm
D		2195	2195	2051	2051	2051	2051	2221	mm
E		594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	337	337	337	mm
H	3"	735	735	735	735	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	850	850	850	mm
J		525	525	525	525	525	525	525	mm
K		1010	1010	1010	1010	1010	1010	1173	mm
L		511	511	511	511	511	511	511	mm
M		436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	mm
F6		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	mm
F7		Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	mm
RI		Ø 3"				Ø 5"			inch
MI		Ø 3"				Ø 5"			inch

1.3.7 In line lay-out (FRONT) with 8 modules

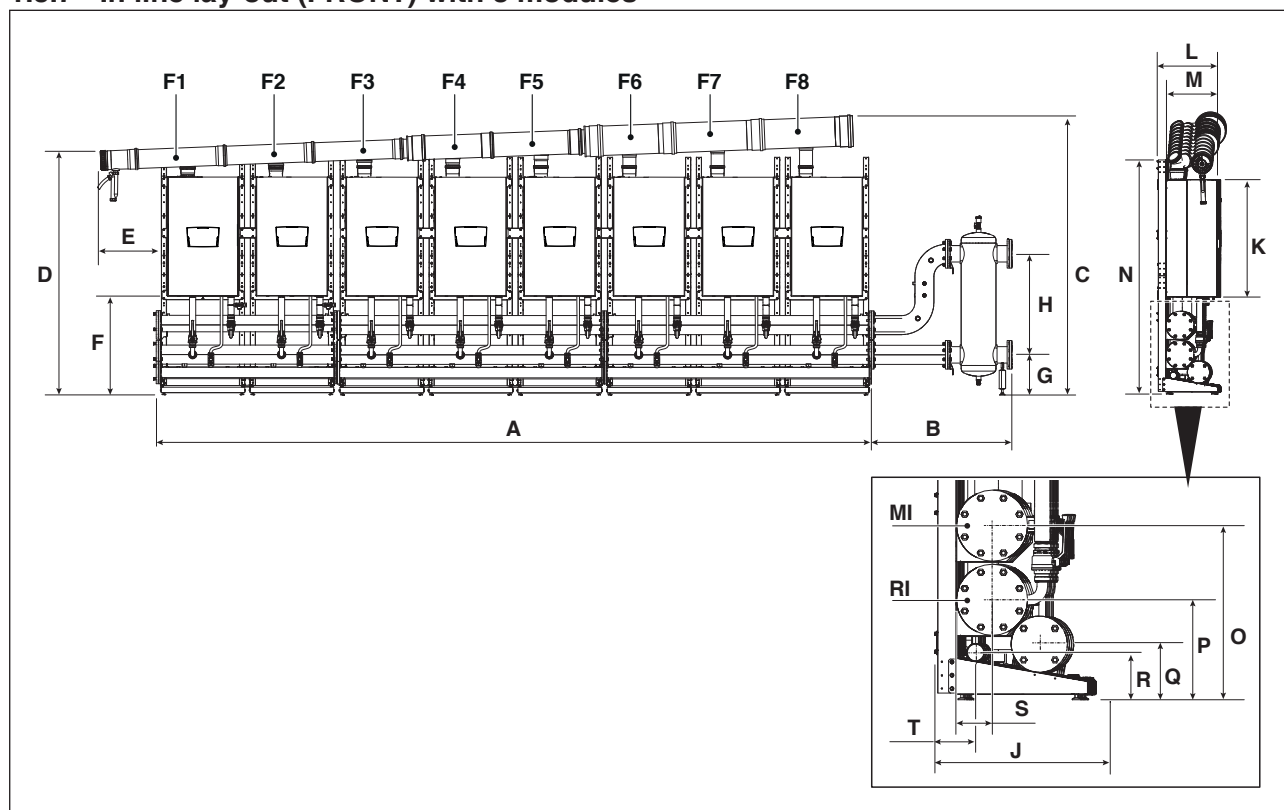


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130		150
A		5978	5978	5978	5978	5978	5978	5978	5978	mm
B		1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2490	2490	2346	2346	2346	2346	2519	2519	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	337	337	337	337	337	mm
H	3"	735	735	735	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	850	850	850	850	850	mm
J		525	525	525	525	525	525	525	525	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		511	511	511	511	511	511	511	511	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 200	mm
F6		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	mm
F7		Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	Ø 250	mm
F8		Ø 160	Ø 160	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	Ø 250	mm
RI		Ø 3"			Ø 5"					inch
MI		Ø 3"			Ø 5"					inch

1.3.8 In line lay-out (FRONT) with 9 modules

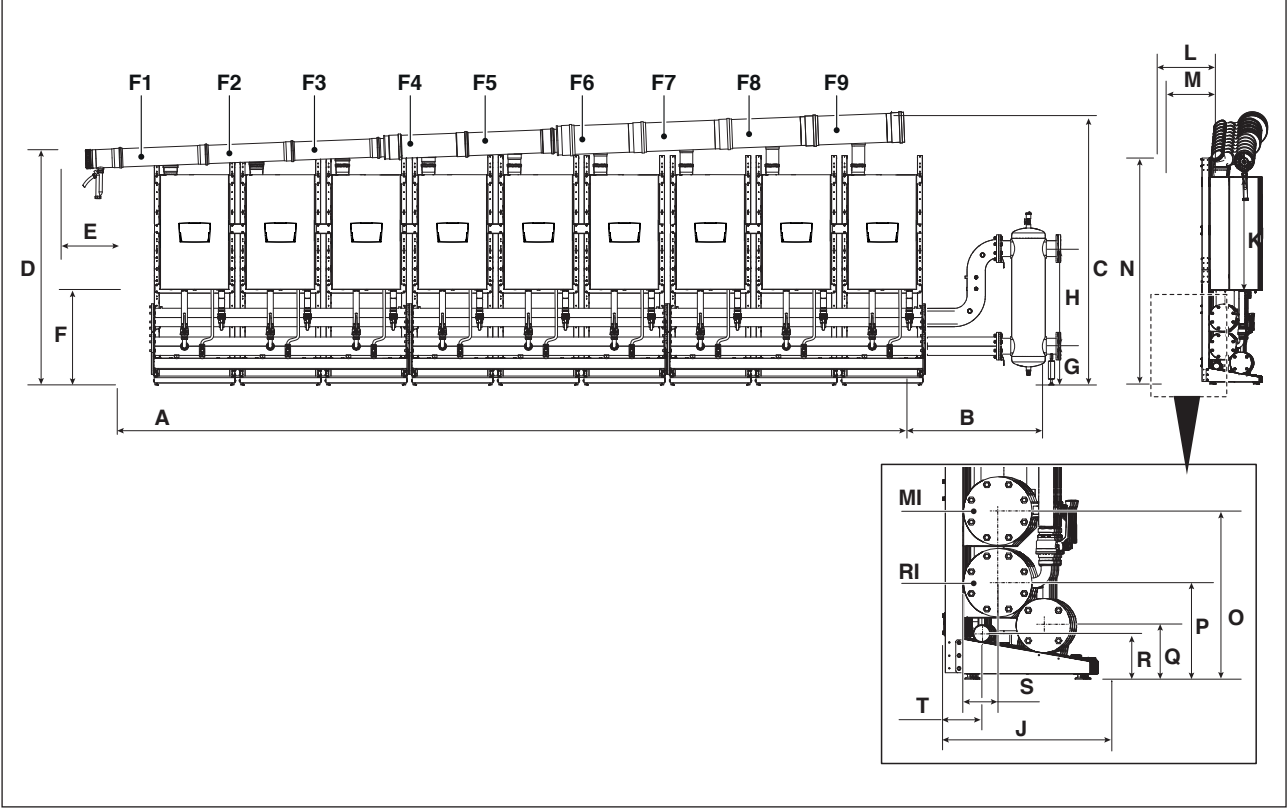


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130		150
A		6726	6726	6726	6726	6726	6726	6726	N.A.	mm
B		1159	1159	1159	1159	1159	1159	1159	N.A.	mm
C		2520	2520	2376	2376	2376	2376	2548	N.A.	mm
D		2195	2195	2051	2051	2051	2051	2221	N.A.	mm
E		594	594	594	594	594	594	594	N.A.	mm
F		834	834	834	834	834	834	834	N.A.	mm
G	3"	230	230	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	337	337	337	337	337	N.A.	mm
H	3"	735	735	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	850	850	850	850	850	N.A.	mm
J		525	525	525	525	525	525	525	N.A.	mm
K		1010	1010	1010	1010	1010	1010	1173	N.A.	mm
L		511	511	511	511	511	511	511	N.A.	mm
M		436	436	436	436	436	436	436	N.A.	mm
N		1999	1999	1999	1999	1999	1999	1999	N.A.	mm
O		584	584	584	584	584	584	584	N.A.	mm
P		334	334	334	334	334	334	334	N.A.	mm
Q		186	186	186	186	186	186	186	N.A.	mm
R		156	156	156	156	156	156	156	N.A.	mm
S		121	121	121	121	121	121	121	N.A.	mm
T		137	137	137	137	137	137	137	N.A.	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
F6		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
F7		Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	N.A.	mm
F8		Ø 160	Ø 160	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	N.A.	mm
F9		Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	N.A.	mm
RI		Ø 3"		Ø 5"						inch
MI		Ø 3"		Ø 5"						inch

1.3.9 In line lay-out (FRONT) with 10 modules

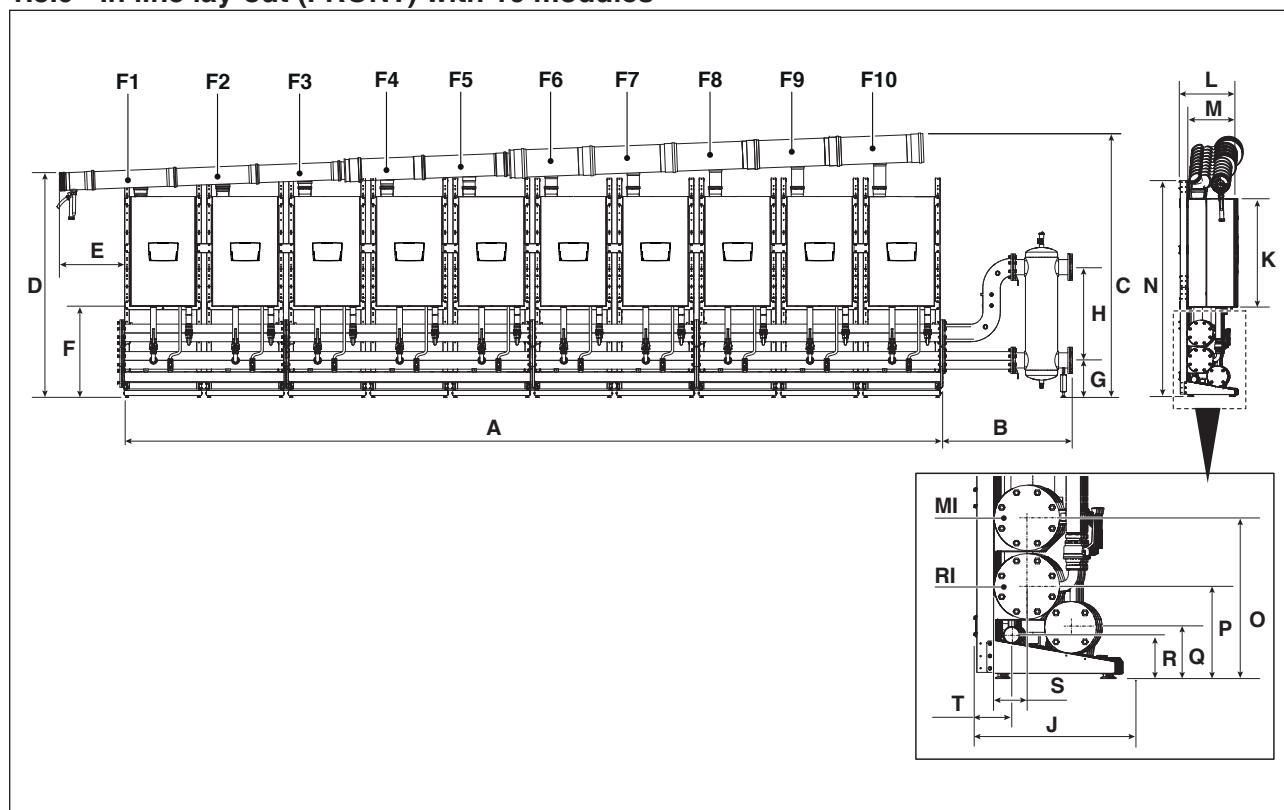


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130		150
A		7472	7472	7472	7472	7472	7472	7472	N.A.	mm
B		1159	1159	1159	1159	1159	1159	1159	N.A.	mm
C		2549	2549	2405	2405	2405	2405	2578	N.A.	mm
D		2195	2195	2051	2051	2051	2051	2221	N.A.	mm
E		594	594	594	594	594	594	594	N.A.	mm
F		834	834	834	834	834	834	834	N.A.	mm
G	3"	230	230	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	337	337	337	337	337	N.A.	mm
H	3"	735	735	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	850	850	850	850	850	N.A.	mm
J		525	525	525	525	525	525	525	N.A.	mm
K		1010	1010	1010	1010	1010	1010	1173	N.A.	mm
L		511	511	511	511	511	511	511	N.A.	mm
M		436	436	436	436	436	436	436	N.A.	mm
N		1999	1999	1999	1999	1999	1999	1999	N.A.	mm
O		584	584	584	584	584	584	584	N.A.	mm
P		334	334	334	334	334	334	334	N.A.	mm
Q		186	186	186	186	186	186	186	N.A.	mm
R		156	156	156	156	156	156	156	N.A.	mm
S		121	121	121	121	121	121	121	N.A.	mm
T		137	137	137	137	137	137	137	N.A.	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F5		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
F6		Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
F7		Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	N.A.	mm
F8		Ø 160	Ø 160	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	N.A.	mm
F9		Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	N.A.	mm
F10		Ø 160	Ø 200	Ø 200	Ø 200	Ø 250	Ø 250	Ø 250	N.A.	mm
RI		Ø 3"		Ø 5"						inch
MI		Ø 3"		Ø 5"						inch

1.3.10 B2B (BACK TO BACK) layout with 2 modules

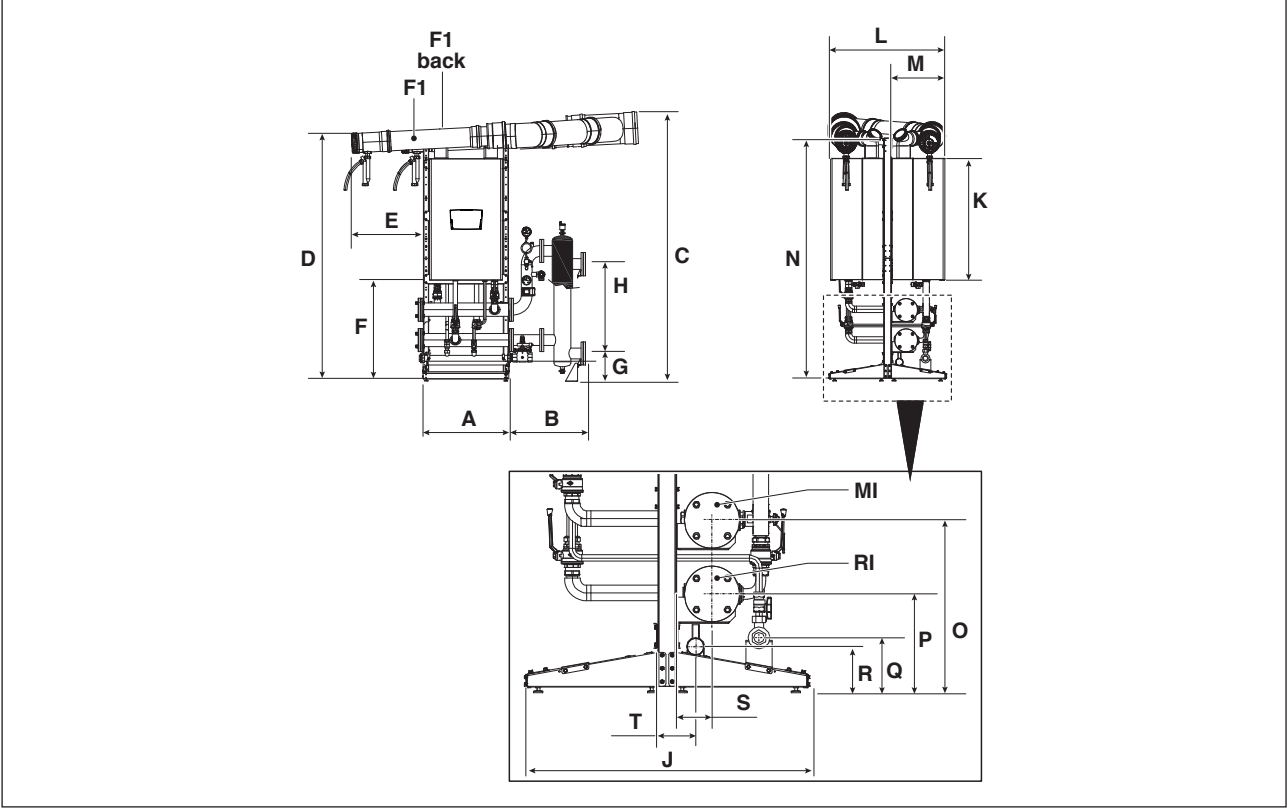


DESCRIPTION	POWER MAX								
	50 P DEP	50 P	65 P	80 P	100	110	130	150	
A	746	746	746	746	746	746	746	746	mm
B	591	591	591	591	591	591	591	591	mm
C	2364	2364	2220	2220	2220	2220	2390	2390	mm
D	2195	2195	2051	2051	2051	2051	2221	2221	mm
E	594	594	594	594	594	594	594	594	mm
F	834	834	834	834	834	834	834	834	mm
G	230	230	230	230	230	230	230	230	mm
H	735	735	735	735	735	735	735	735	mm
J	969	969	969	969	969	969	969	969	mm
K	1010	1010	1010	1010	1010	1010	1173	1173	mm
L	942	942	942	942	942	942	942	942	mm
M	436	436	436	436	436	436	436	436	mm
N	1999	1999	1999	1999	1999	1999	1999	1999	mm
O	584	584	584	584	584	584	584	584	mm
P	334	334	334	334	334	334	334	334	mm
Q	186	186	186	186	186	186	186	186	mm
R	156	156	156	156	156	156	156	156	mm
S	121	121	121	121	121	121	121	121	mm
T	137	137	137	137	137	137	137	137	mm
F1	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F1 back	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
RI	Ø 3"								inch
MI	Ø 3"								inch

1.3.11 B2B (BACK TO BACK) layout with 3 and 4 modules

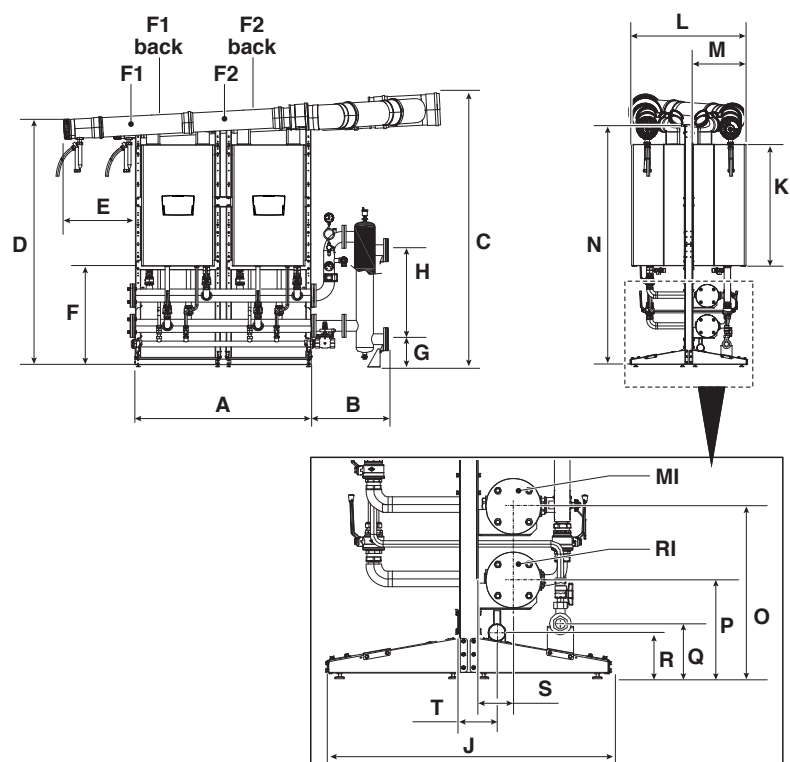


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		1494	1494	1494	1494	1494	1494	1494	1494	mm
B	3"	591	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2404	2404	2260	2260	2260	2260	2430	2430	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	230	230	230	230	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	337	mm
H	3"	735	735	735	735	735	735	735	735	mm
	5"	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	850	mm
J		969	969	969	969	969	969	969	969	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		942	942	942	942	942	942	942	942	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F1 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
RI	3 modules	Ø 3"							Ø 3"	inch
	4 modules	Ø 3"							Ø 5"	inch
MI	3 modules	Ø 3"							Ø 3"	inch
	4 modules	Ø 3"							Ø 5"	inch

1.3.12 B2B (BACK TO BACK) layout with 5 and 6 modules

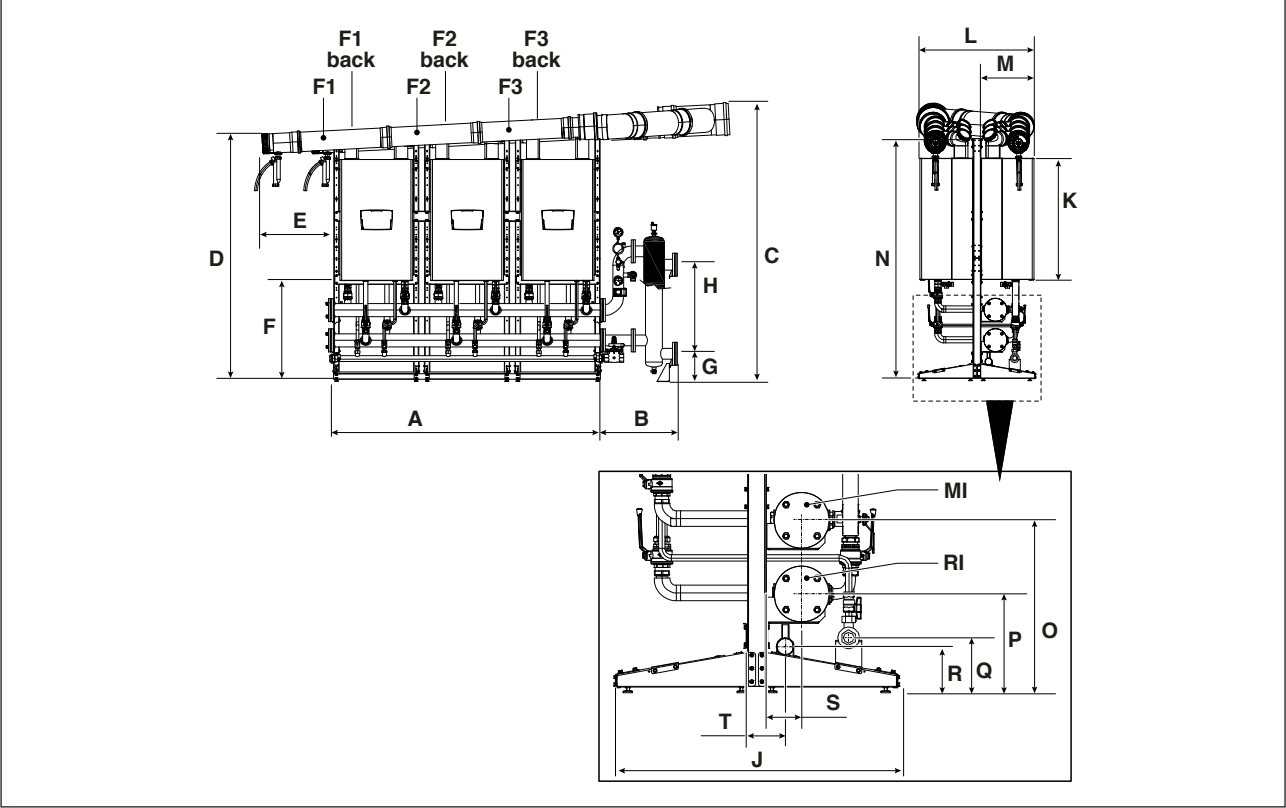


DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		2242	2242	2242	2242	2242	2242	2242	2242	mm
B	3"	591	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2443	2443	2299	2299	2299	2299	2469	2469	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	230	230	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	337	337	337	337	mm
H	3"	735	735	735	735	735	735	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	N.A.	850	850	850	850	mm
J		969	969	969	969	969	969	969	969	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		942	942	942	942	942	942	942	942	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F1 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
RI	5 modules	Ø 3"				Ø 3"		Ø 5"		inch
	6 modules	Ø 3"				Ø 5"		Ø 5"		inch
MI	5 modules	Ø 3"				Ø 3"		Ø 5"		inch
	6 modules	Ø 3"				Ø 5"		Ø 5"		inch

1.3.13 B2B (BACK TO BACK) layout with 7 and 8 modules

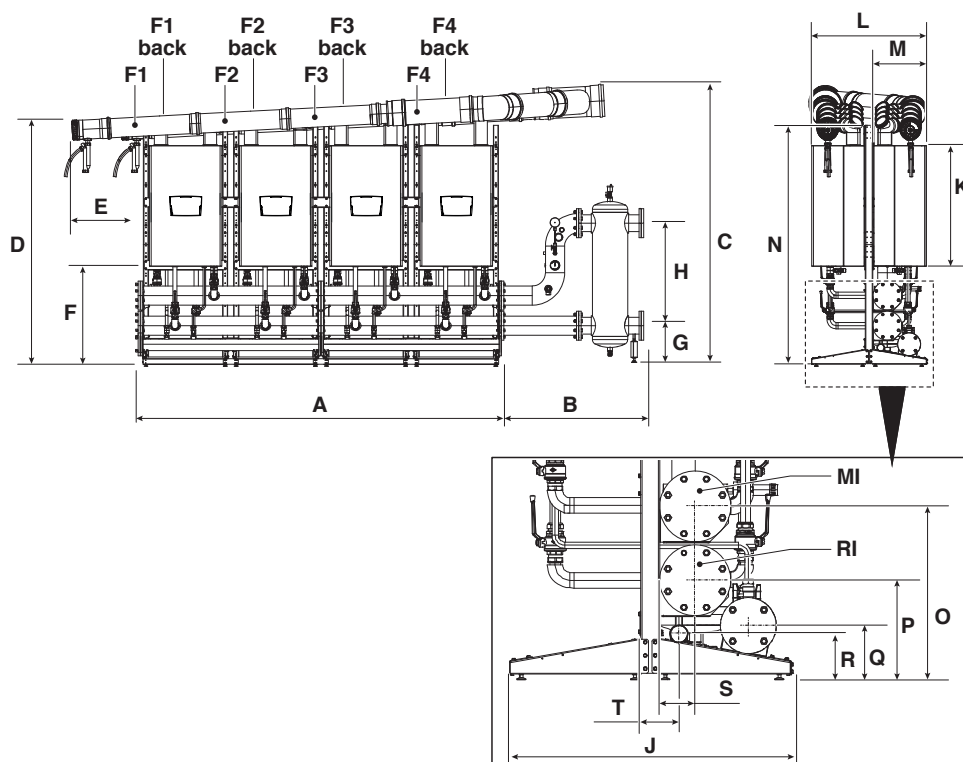

DESCRIPTION		POWER MAX								
		50 P DEP	50 P	65 P	80 P	100	110	130	150	
A		2988	2988	2988	2988	2988	2988	2988	2988	mm
B	3"	591	591	591	591	591	591	591	591	mm
	5"	1159	1159	1159	1159	1159	1159	1159	1159	mm
C		2483	2483	2339	2339	2339	2339	2509	2509	mm
D		2195	2195	2051	2051	2051	2051	2221	2221	mm
E		594	594	594	594	594	594	594	594	mm
F		834	834	834	834	834	834	834	834	mm
G	3"	230	230	230	230	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	337	337	337	337	337	mm
H	3"	735	735	735	735	N.A.	N.A.	N.A.	N.A.	mm
	5"	N.A.	N.A.	N.A.	850	850	850	850	850	mm
J		969	969	969	969	969	969	969	969	mm
K		1010	1010	1010	1010	1010	1010	1173	1173	mm
L		942	942	942	942	942	942	942	942	mm
M		436	436	436	436	436	436	436	436	mm
N		1999	1999	1999	1999	1999	1999	1999	1999	mm
O		584	584	584	584	584	584	584	584	mm
P		334	334	334	334	334	334	334	334	mm
Q		186	186	186	186	186	186	186	186	mm
R		156	156	156	156	156	156	156	156	mm
S		121	121	121	121	121	121	121	121	mm
T		137	137	137	137	137	137	137	137	mm
F1		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F1 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F2 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F3 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	mm
F4		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
F4 back		Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	mm
RI	7 modules	Ø 3"			Ø 3"	Ø 5"				inch
	8 modules	Ø 3"			Ø 5"	Ø 5"				inch
MI	7 modules	Ø 3"			Ø 3"	Ø 5"				inch
	8 modules	Ø 3"			Ø 5"	Ø 5"				inch

1.3.14 B2B (BACK TO BACK) layout with 9 and 10 modules

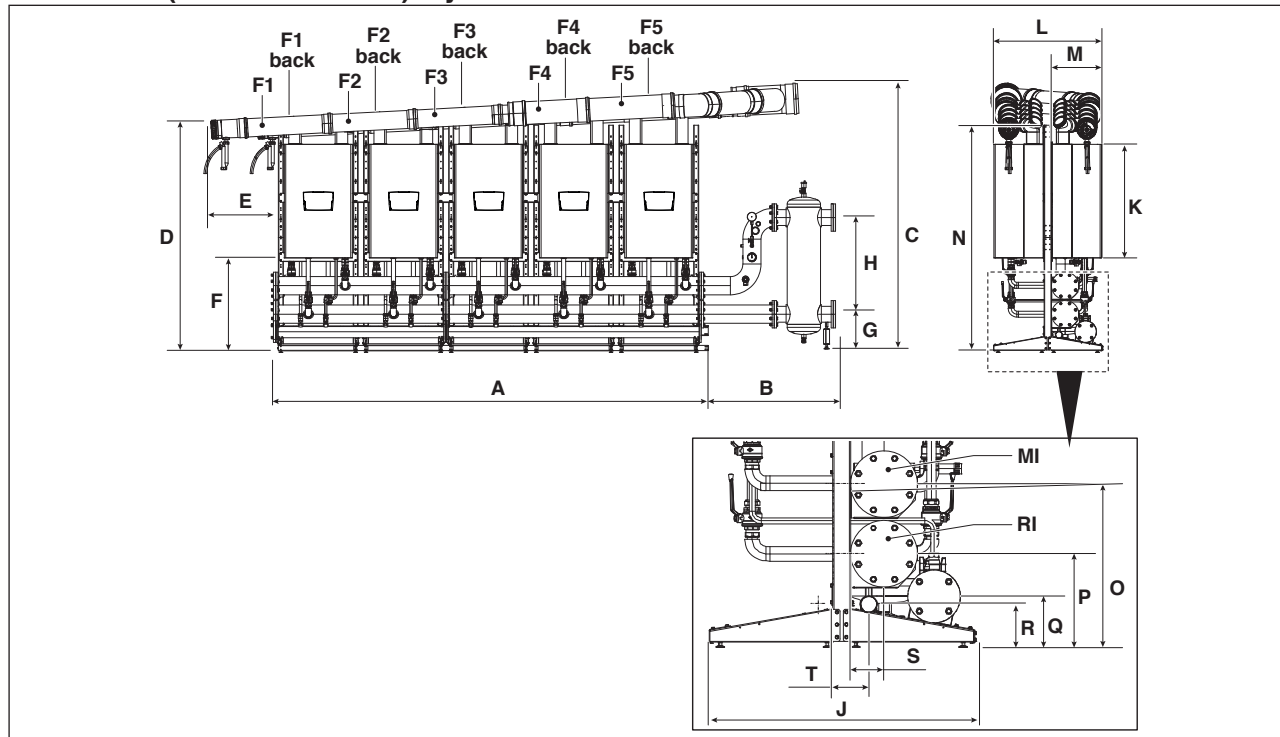


DESCRIPTION			POWER MAX								
			50 P DEP	50 P	65 P	80 P	100	110	130		150
A			3736	3736	3736	3736	3736	3736	3736	N.A.	mm
B			1159	1159	1159	1159	1159	1159	1159	N.A.	mm
C			2511	2511	2367	2367	2367	2367	2537	N.A.	mm
D			2195	2195	2051	2051	2051	2051	2221	N.A.	mm
E			594	594	594	594	594	594	594	N.A.	mm
F			834	834	834	834	834	834	834	N.A.	mm
G	9 modules	3"	230	230	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
		5"	N.A.	N.A.	337	337	337	337	337	N.A.	mm
	10 mod- ules	3"	230	230	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
		5"	N.A.	N.A.	337	337	337	337	337	N.A.	mm
H	9 modules	3"	735	735	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
		5"	N.A.	N.A.	850	850	850	850	850	N.A.	mm
	10 mod- ules	3"	735	735	N.A.	N.A.	N.A.	N.A.	N.A.	N.A.	mm
		5"	N.A.	N.A.	850	850	850	850	850	N.A.	mm
J			969	969	969	969	969	969	969	N.A.	mm
K			1010	1010	1010	1010	1010	1010	1173	N.A.	mm
L			942	942	942	942	942	942	942	N.A.	mm
M			436	436	436	436	436	436	436	N.A.	mm
N			1999	1999	1999	1999	1999	1999	1999	N.A.	mm
O			584	584	584	584	584	584	584	N.A.	mm
P			334	334	334	334	334	334	334	N.A.	mm
Q			186	186	186	186	186	186	186	N.A.	mm
R			156	156	156	156	156	156	156	N.A.	mm
S			121	121	121	121	121	121	121	N.A.	mm
T			137	137	137	137	137	137	137	N.A.	mm
F1			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F1 back			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F2			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F2 back			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F3			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F3 back			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F4			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F4 back			Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	Ø 160	N.A.	mm
F5			Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
F5 back			Ø 160	Ø 160	Ø 160	Ø 160	Ø 200	Ø 200	Ø 200	N.A.	mm
RI	9 modules		Ø 3"		Ø 5"						inch
	10 modules		Ø 3"		Ø 5"						inch
MI	9 modules		Ø 3"		Ø 5"						inch
	10 modules		Ø 3"		Ø 5"						inch


1.4 Installation premises

The thermal module must be installed in premises used exclusively for the latter conforming to standards and legislation in force and where combustion exhaust products and combustion air intake is conveyed out of said premises. Where combustion air is instead taken from the installation premises then the latter must be equipped with suitably sized vents conforming to standards.

Space required for in line layout (FRONT)

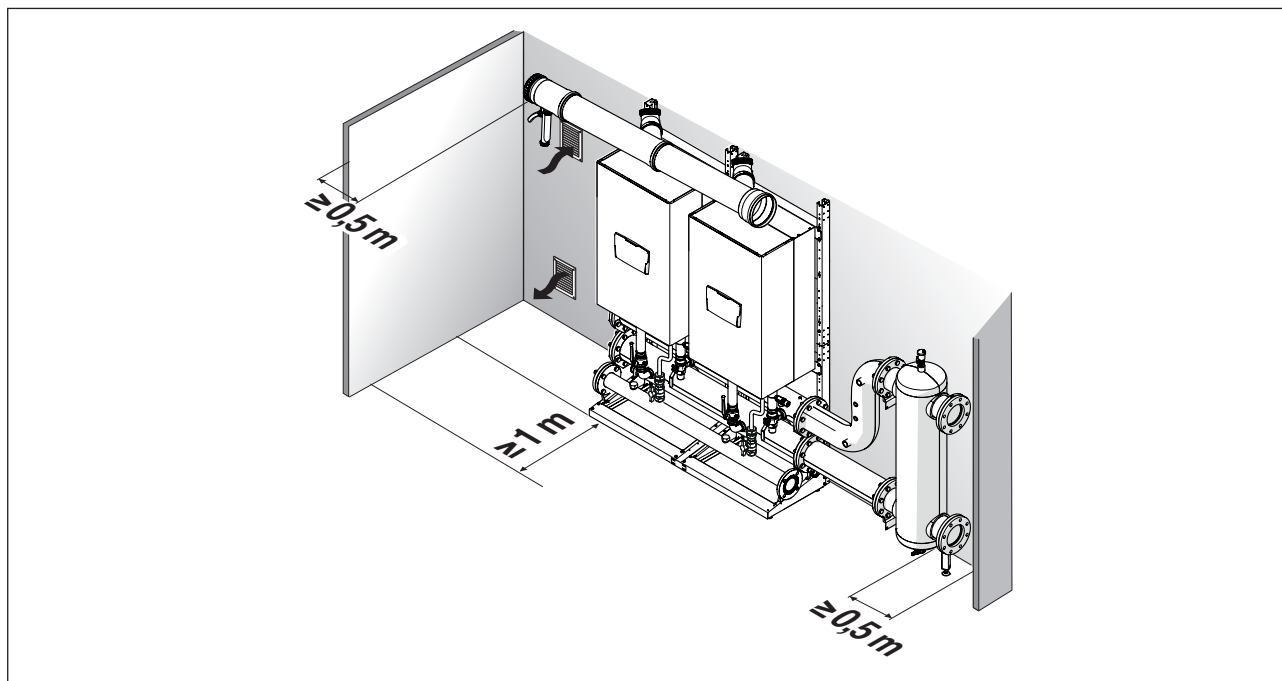

Space required for back-to-back layout (B2B - BACK TO BACK)

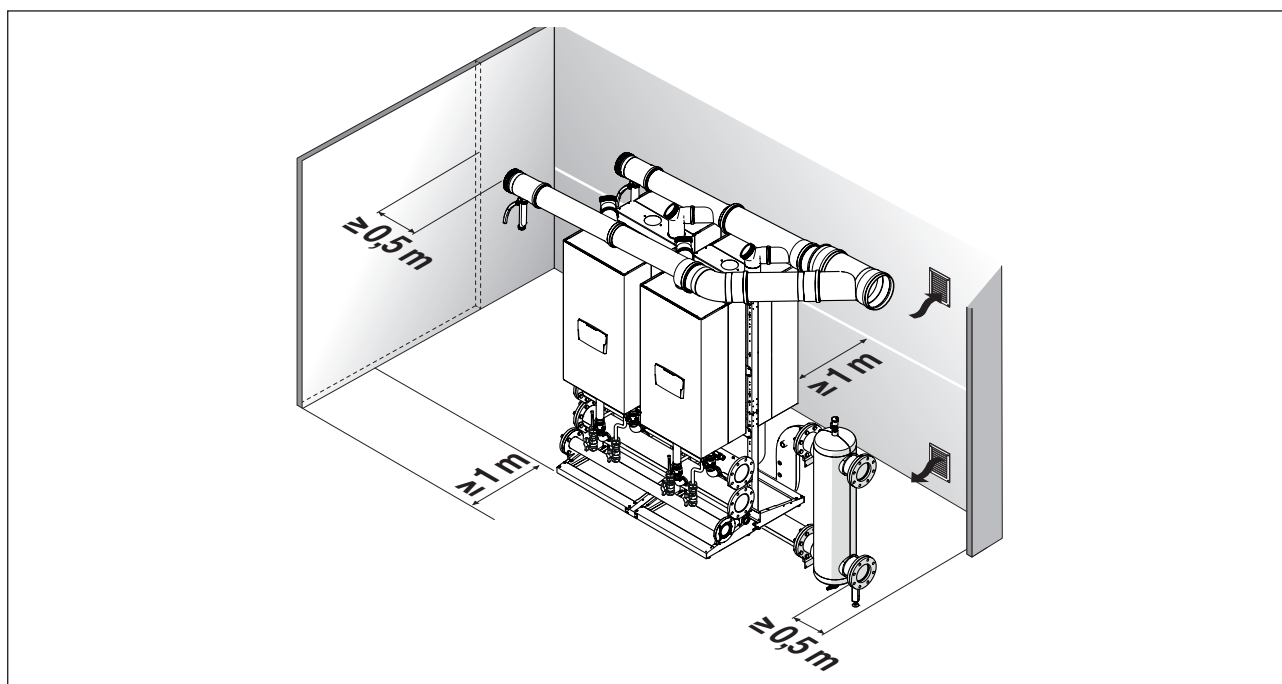

- ⚠ When installing the boiler, allow sufficient space around it to access all safety and control devices and to permit easy maintenance.
- ⚠ The height of the installation room must meet the fire-prevention requirements and current regulations in force in the country of installation.
- ⚠ Check that the electrical protection rating of the thermal module is sufficient for the characteristics of the installation room.
- ⚠ If the thermal modules are powered by combustible gas with a specific weight exceeding that of air, the electrical parts must be positioned at a height exceeding 500 mm from the ground.

1.5 Air vent

The rooms must be equipped with one or more permanent air vents positioned on external walls, ensuring that the all regulations established in the country of installation are complied with.

For Italy:

The air vents must not have a surface area less than the minimum value indicated in the table (expressed in cm²):

Rooms above the ground

(*) 5000 cm² in the case of G30-G31

Model	POWER MAX							
	50 P DEP	50 P	65 P	80 P	100	110	130	150
No. of Boilers	MINIMUM DIMENSION OF AIR VENT (cm ²)							
2	3000*	3000*	3000*	3000*	3000*	3000*	3000*	3000*
3	3000*	3000*	3000*	3000*	3000*	3000*	3360*	3930*
4	3000*	3000*	3000*	3000*	3600*	3880*	4480*	5240
5	3000*	3000*	3000*	3400*	4500*	4850*	5600	6550
6	3420*	3420*	3420*	4080*	5400	5820	6720	7860
7	3990*	3990*	3990*	4760*	6300	6790	7840	9170
8	4560*	4560*	4560*	5440	7200	7760	8960	10480
9	5130	5130	5130	6120	8100	8730	10080	ND
10	5700	5700	5700	6800	9000	9700	11200	ND

Rooms below ground, down to a distance of - 5 m from the reference floor level:

Model	POWER MAX							
	50 P DEP	50 P	65 P	80 P	100	110	130	150
No. of Boilers	MINIMUM DIMENSION OF AIR VENT (cm ²)							
2	3000	3000	3000	3000	3000	3000	3360	3930
3	3000	3000	3000	3060	4050	4365	5040	5895
4	3420	3420	3420	4080	5400	5820	6720	7860
5	4275	4275	4275	5100	6750	7275	8400	9825
6	5130	5130	5130	6120	8100	8730	10080	11790
7	5985	5985	5985	7140	9450	10185	11760	13755
8	6840	6840	6840	8160	10800	11640	13440	15720
9	7695	7695	7695	9180	12150	13095	15120	ND
10	8550	8550	8550	10200	13500	14550	16800	ND

Rooms below ground, at a distance of between - 5 m and - 10 m below the reference floor level (with a minimum of 5000 cm²):

Model	POWER MAX							
	50 P DEP	50 P	65 P	80 P	100	110	130	150
No. of Boilers	MINIMUM DIMENSION OF AIR VENT (cm ²)							
2	5000	5000	5000	5000	5000	5000	5000	5240
3	5000	5000	5000	5000	5400	5820	6720	7860
4	5000	5000	5000	5440	7200	7760	8960	10480
5	5700	5700	5700	6800	9000	9700	11200	13100
6	6840	6840	6840	8160	10800	11640	13440	15720
7	7980	7980	7980	9520	12600	13580	15680	18340
8	9120	9120	9120	10880	14400	15520	17920	20960
9	10260	10260	10260	12240	16200	17460	20160	ND
10	11400	11400	11400	13600	18000	19400	22400	ND



It is not permitted to install systems for relative gas density greater than 0.8 (G30-G31) in rooms with flooring below the natural ground level.




The aeration surface area must not in any case be less than 3000 cm² or 5000 cm² if using gas with a density exceeding 0.8 (G30-G31).



The air vents in rooms with appliances supplied with gas must meet all fire prevention requirements, in particular Ministerial Decree of 12th April 2011 and subsequent updates.

2 INSTALLATION

2.1 Preliminary installation measures

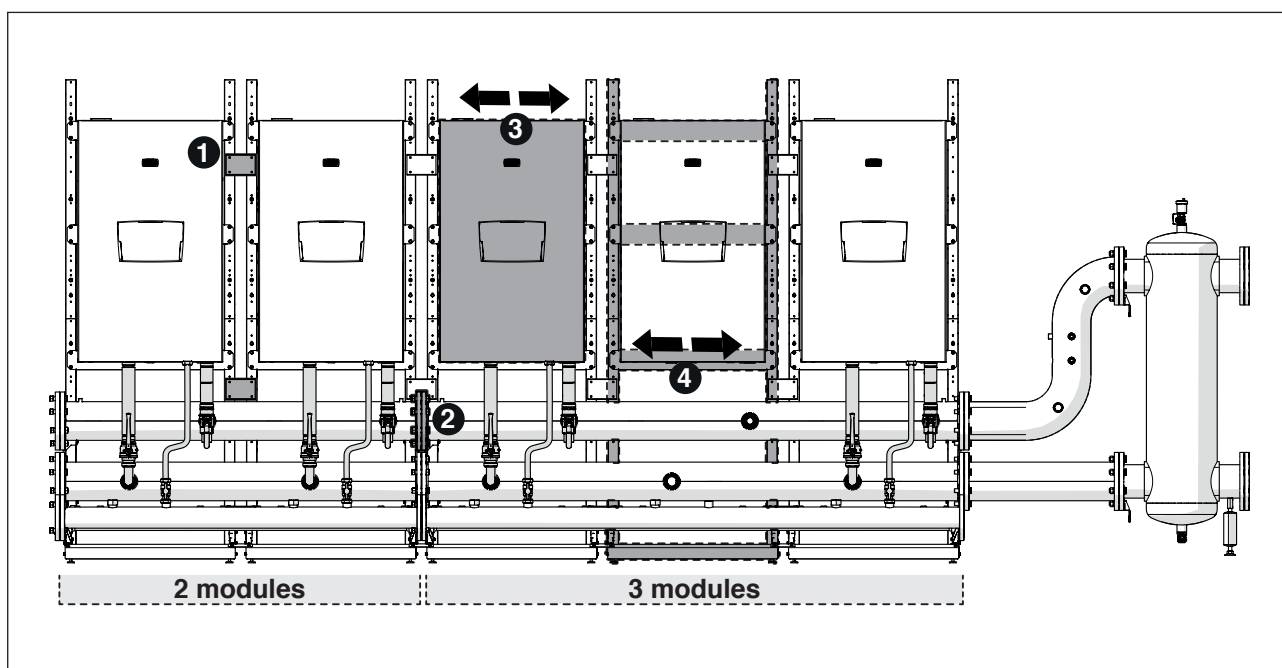


To correctly install the modules, the installer must take into consideration a series of tolerances on the installation distances as established during the design stage.

In particular:


- 1 the plates for securing the frames have slots and must only be secured after having fitted the manifolds.
- 2 if making connections between manifolds, tighten the flange to ensure that the seal adheres and reduce the clearance on the total length of the manifolds.
- 3 the thermal module can slide (right-left) on the supporting bracket to facilitate any adjustments which need to be made during the installation stage of the hydraulic ramps.
- 4 in the case of installations with a manifold for 3 modules, the central frame has a greater tolerance.

2.2 Assembly of the FRAMES

Assembly of the cascade frame in-line. Components included in code 20131663

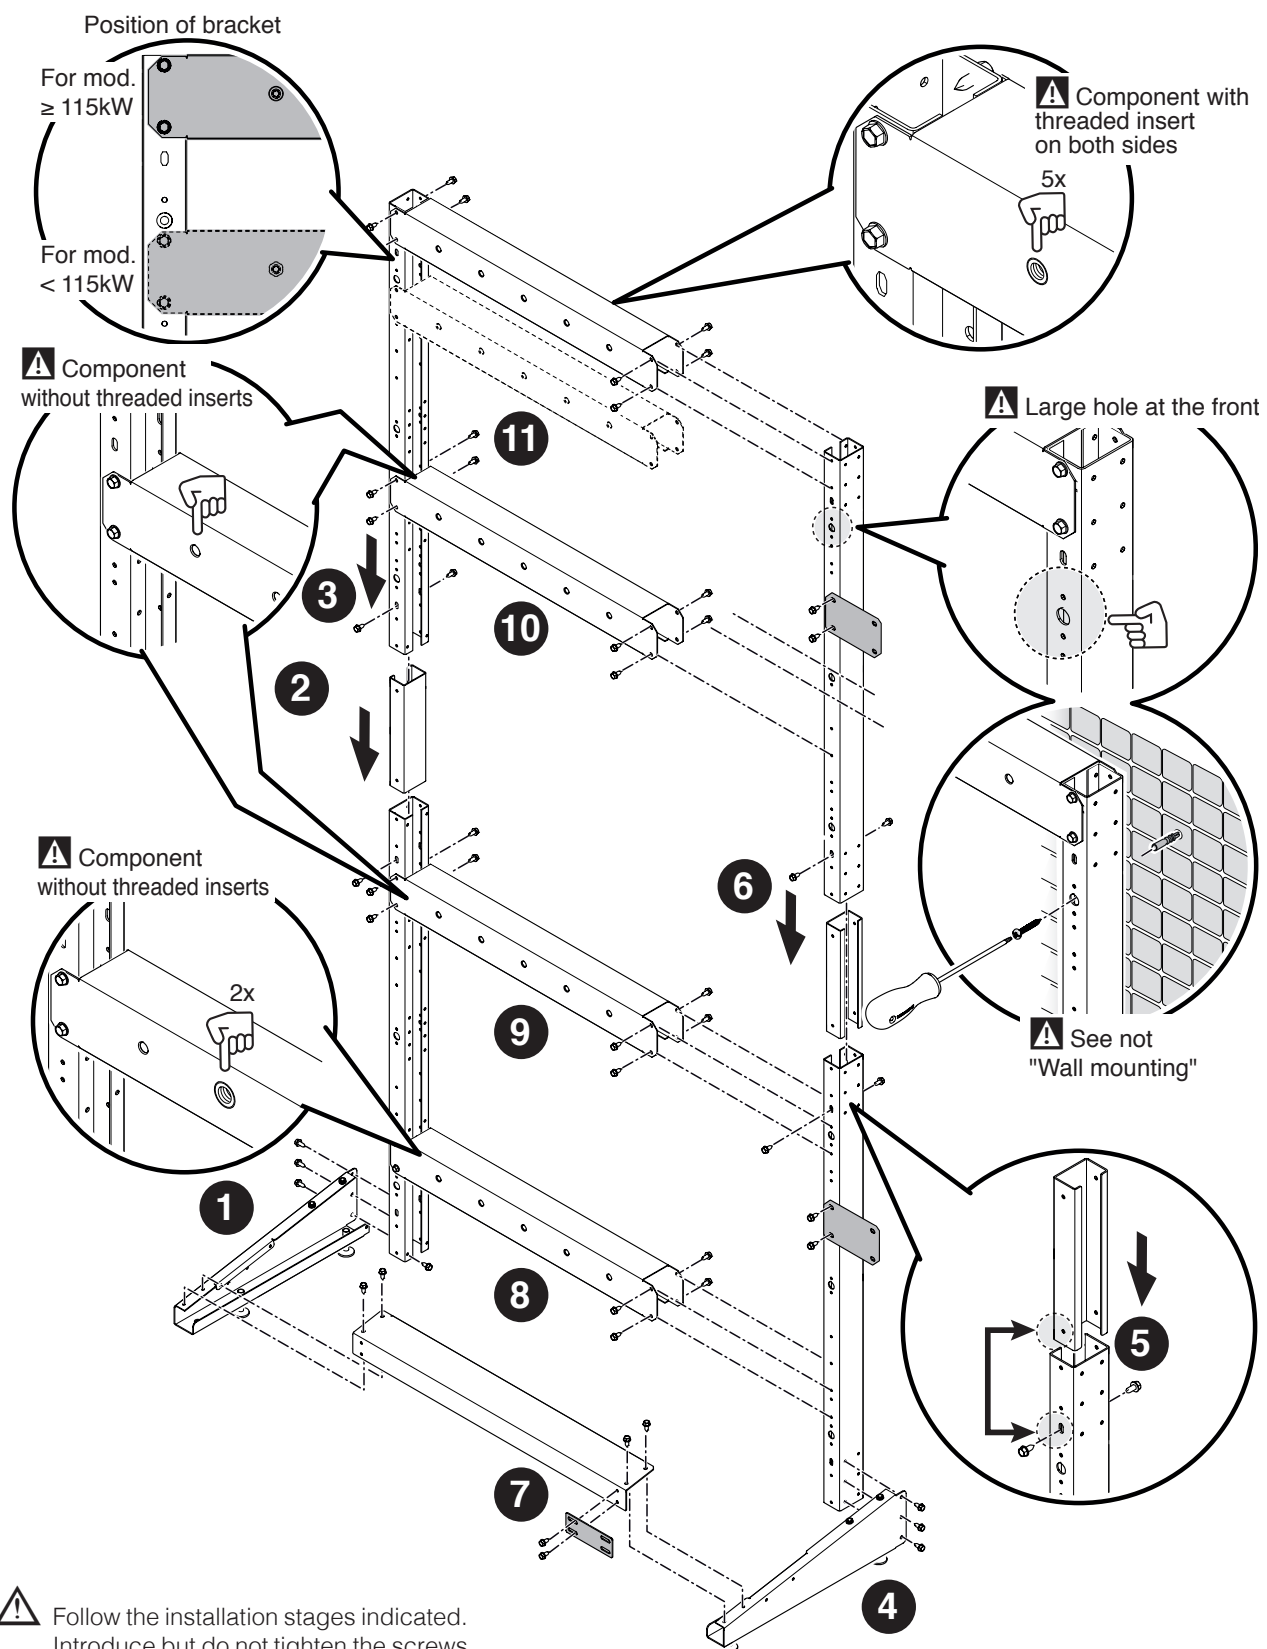

⚠ Follow the installation stages indicated. Introduce but do not tighten the screws so any necessary adjustments can be still be made. Once installation of the entire frame has been completed, only then can the screws be fully tightened.

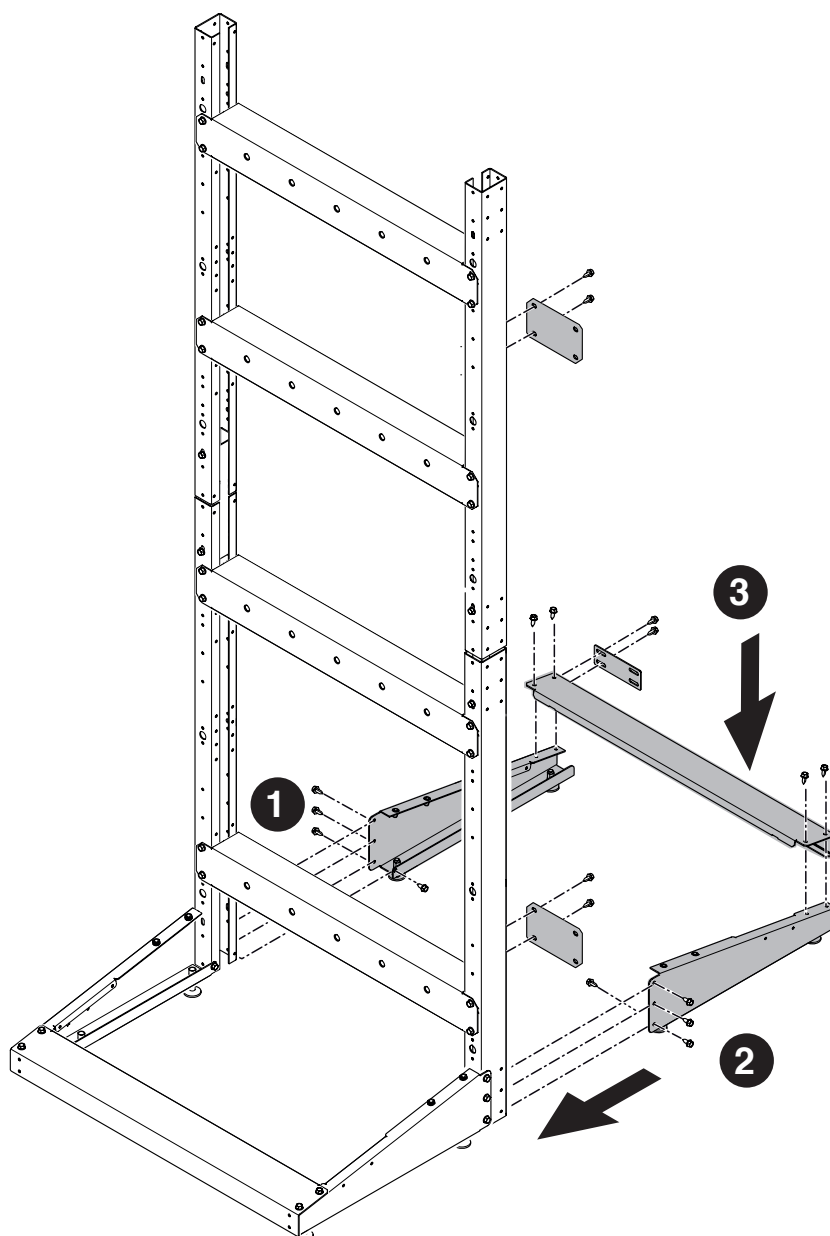


 Follow the installation stages indicated. Introduce but do not tighten the screws so any necessary adjustments can be still be made. Once installation of the entire frame has been completed, only then can the screws be fully tightened.

Fastening the frames to each other.

Cascade installation in-line

Cascade installation B2B

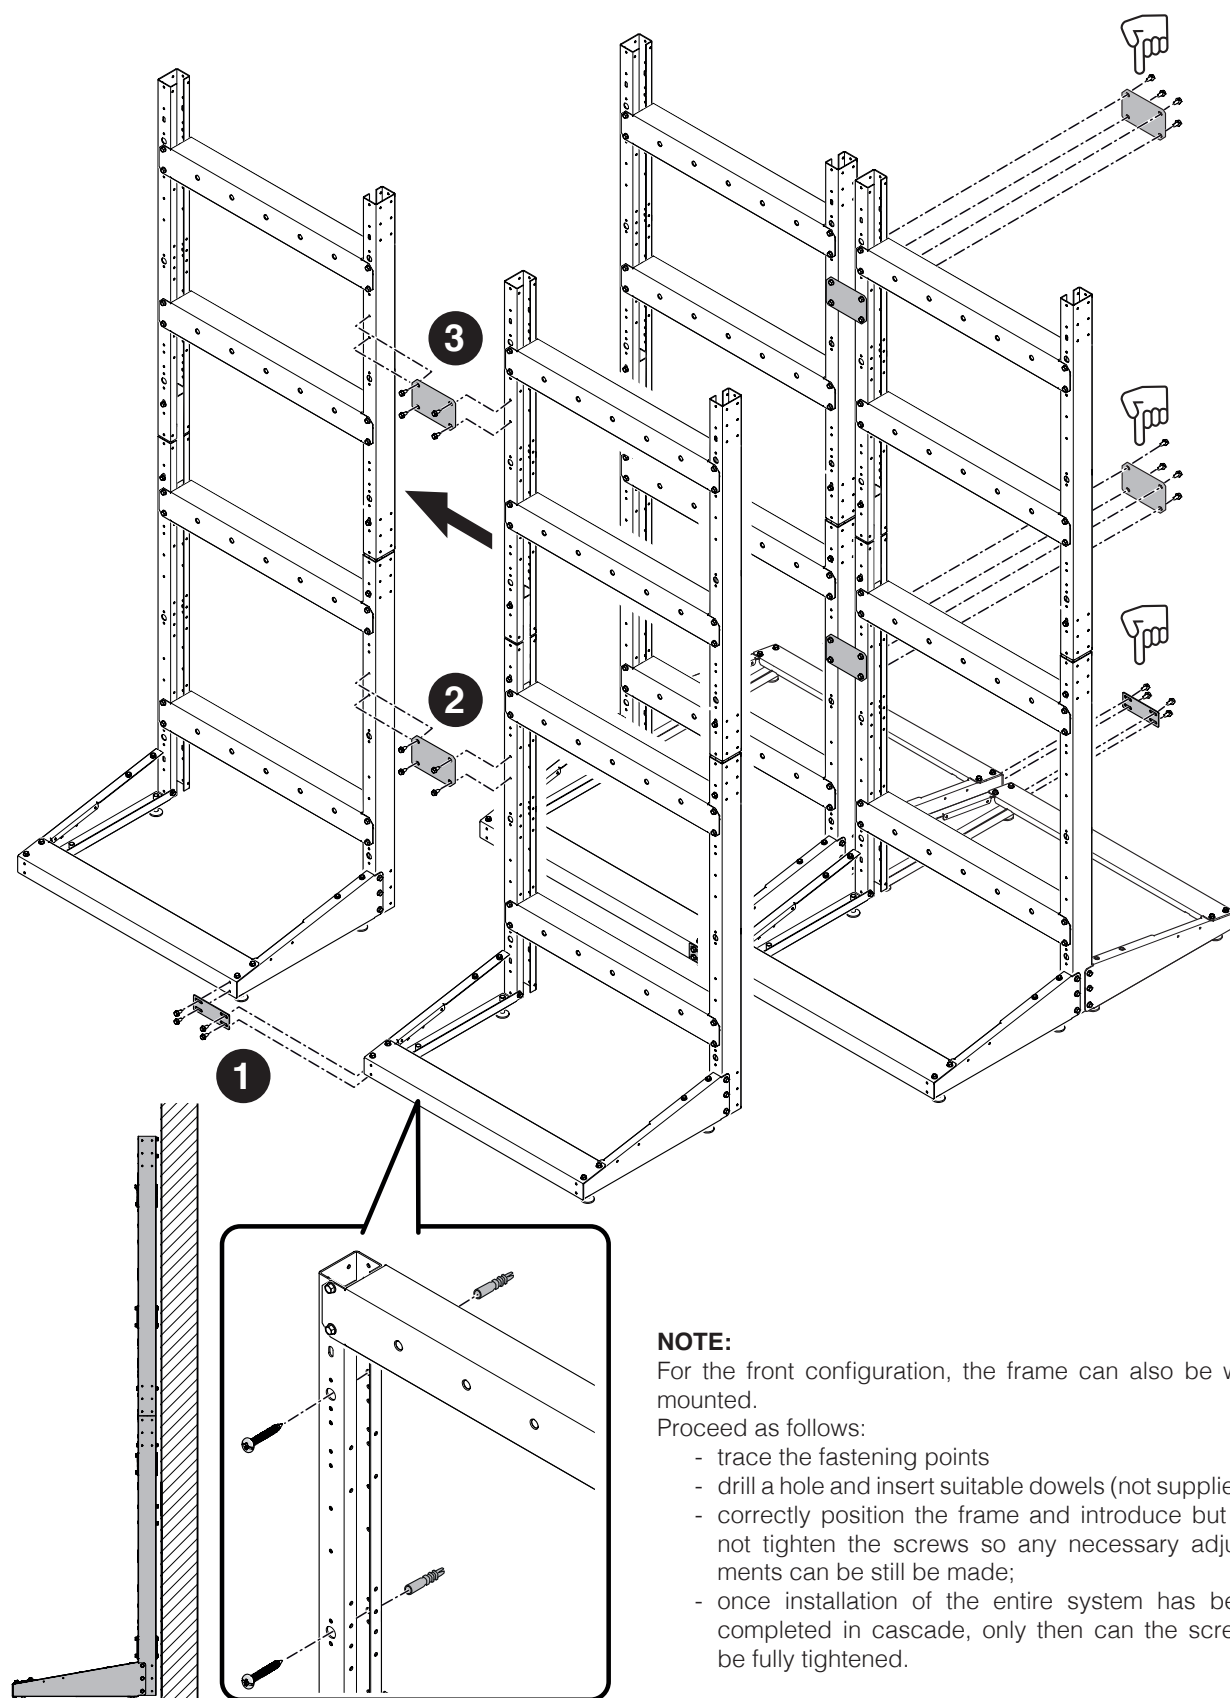

23


NOTE:

For the front configuration, the frame can also be wall mounted.

Proceed as follows:

- trace the fastening points
- drill a hole and insert suitable dowels (not supplied);
- correctly position the frame and introduce but do not tighten the screws so any necessary adjustments can be still be made;
- once installation of the entire system has been completed in cascade, only then can the screws be fully tightened.

Adjusting the feet.

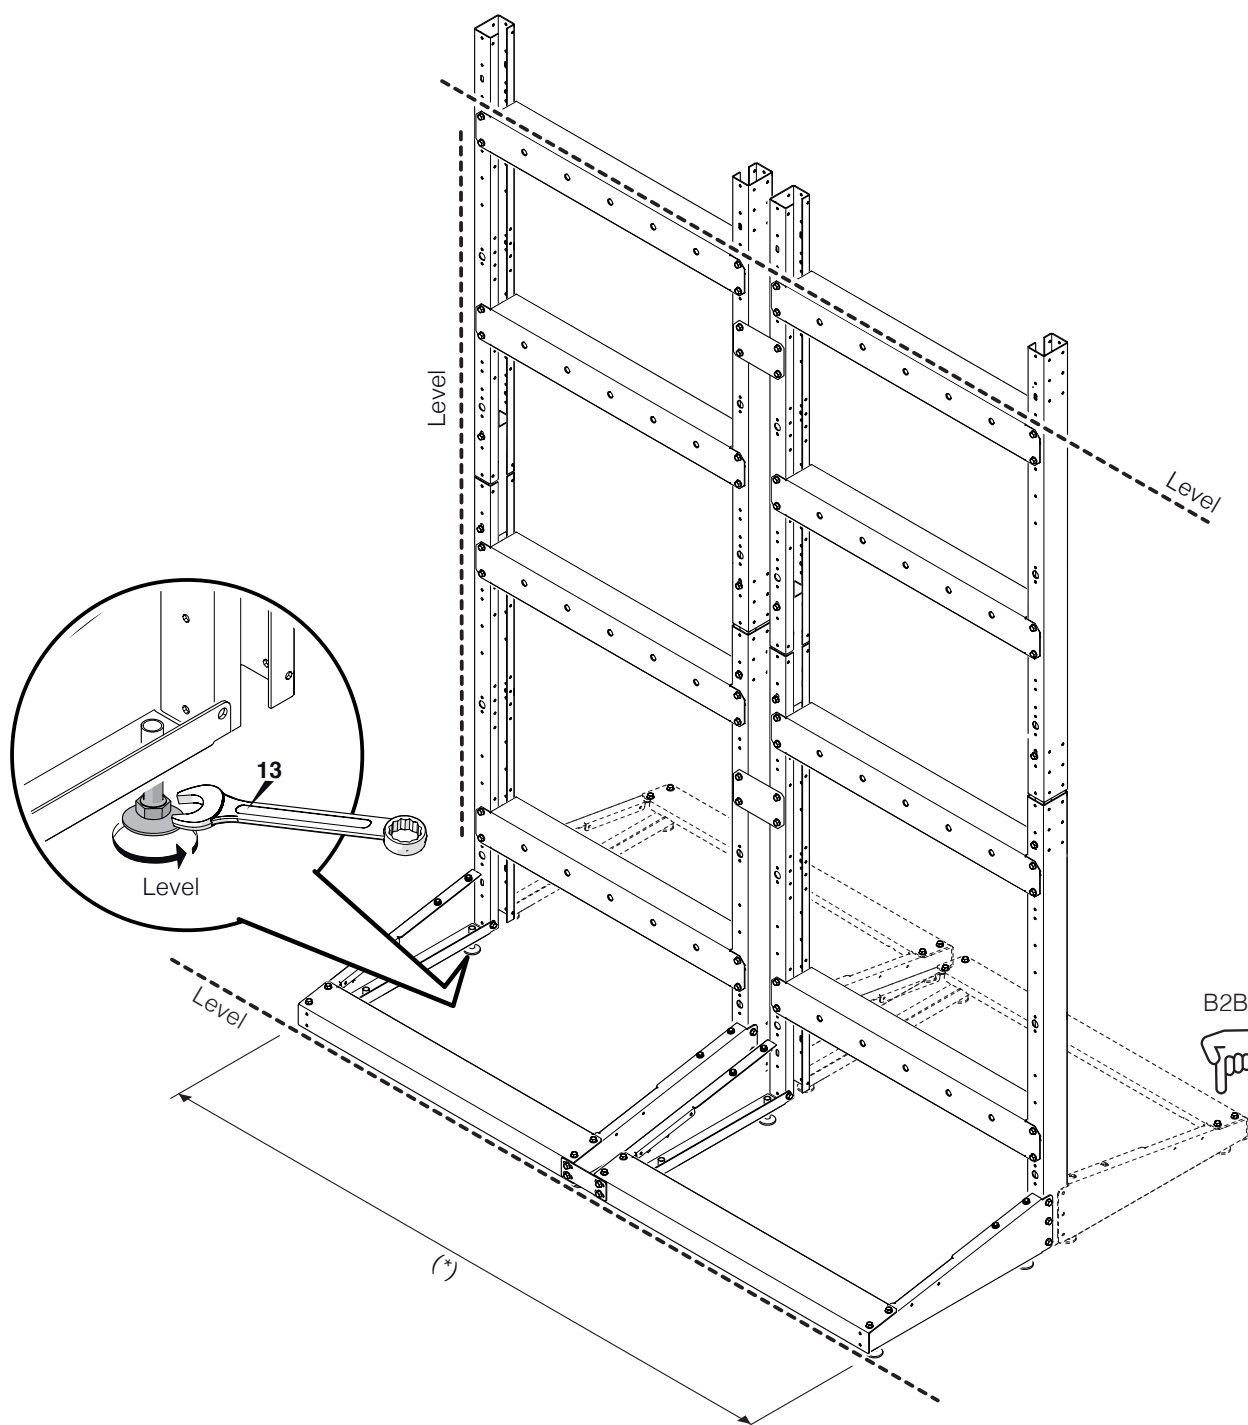


(*) check the measurements on the table of the dimensions present in the paragraph "System layout".

Moving and removing the packing

-  Do not remove the cardboard used for packaging the appliance until it has reached the place of installation.
-  Before carrying out any transport operations or removing the packaging, ensure you are wearing suitable PPE and use tools and means which are appropriate for the dimensions and weight of the appliance.
-  This operations is to be carried out by more than one person, equipped with means which are suitably for the weight and dimensions of the appliance. Make sure that the weight of the package remains balanced during handling operations.

Proceed as follows to remove the packing:


- Remove the retainers which secure the package to the pallet
- Remove the cardboard
- Remove edge protectors (1)
- Remove the Styrofoam protection (2)
- Remove the protective bag (3).

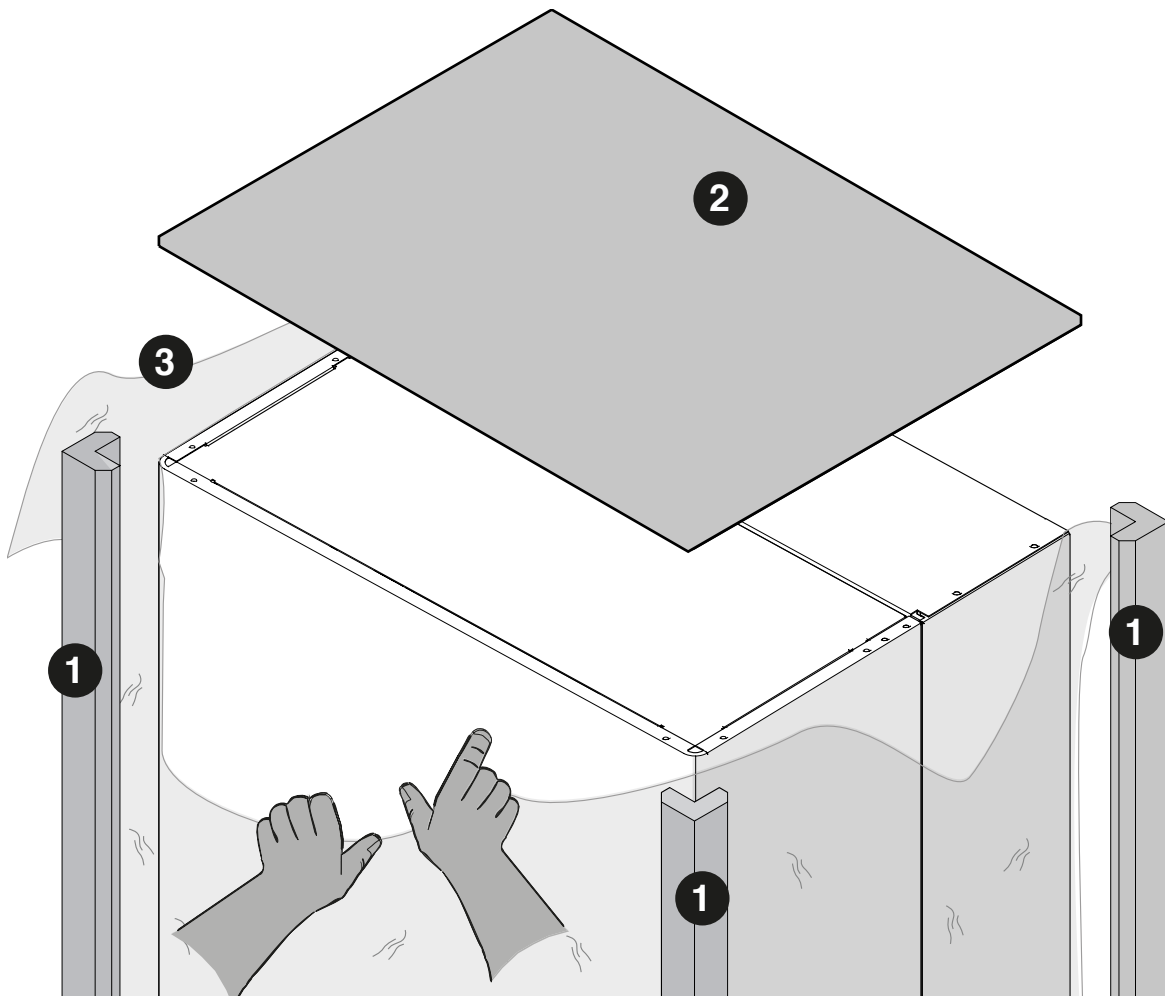


Fitting the thermal module support bracket

The bracket is supplied together with the thermal module.

Cascade installation B2B

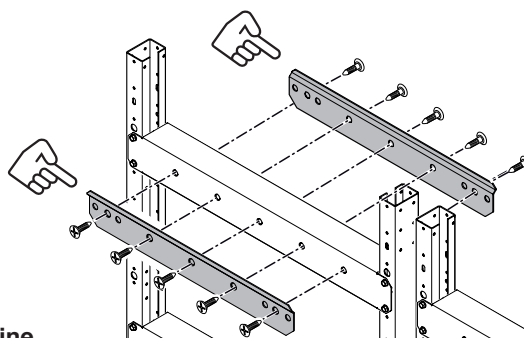


Cascade installation in-line

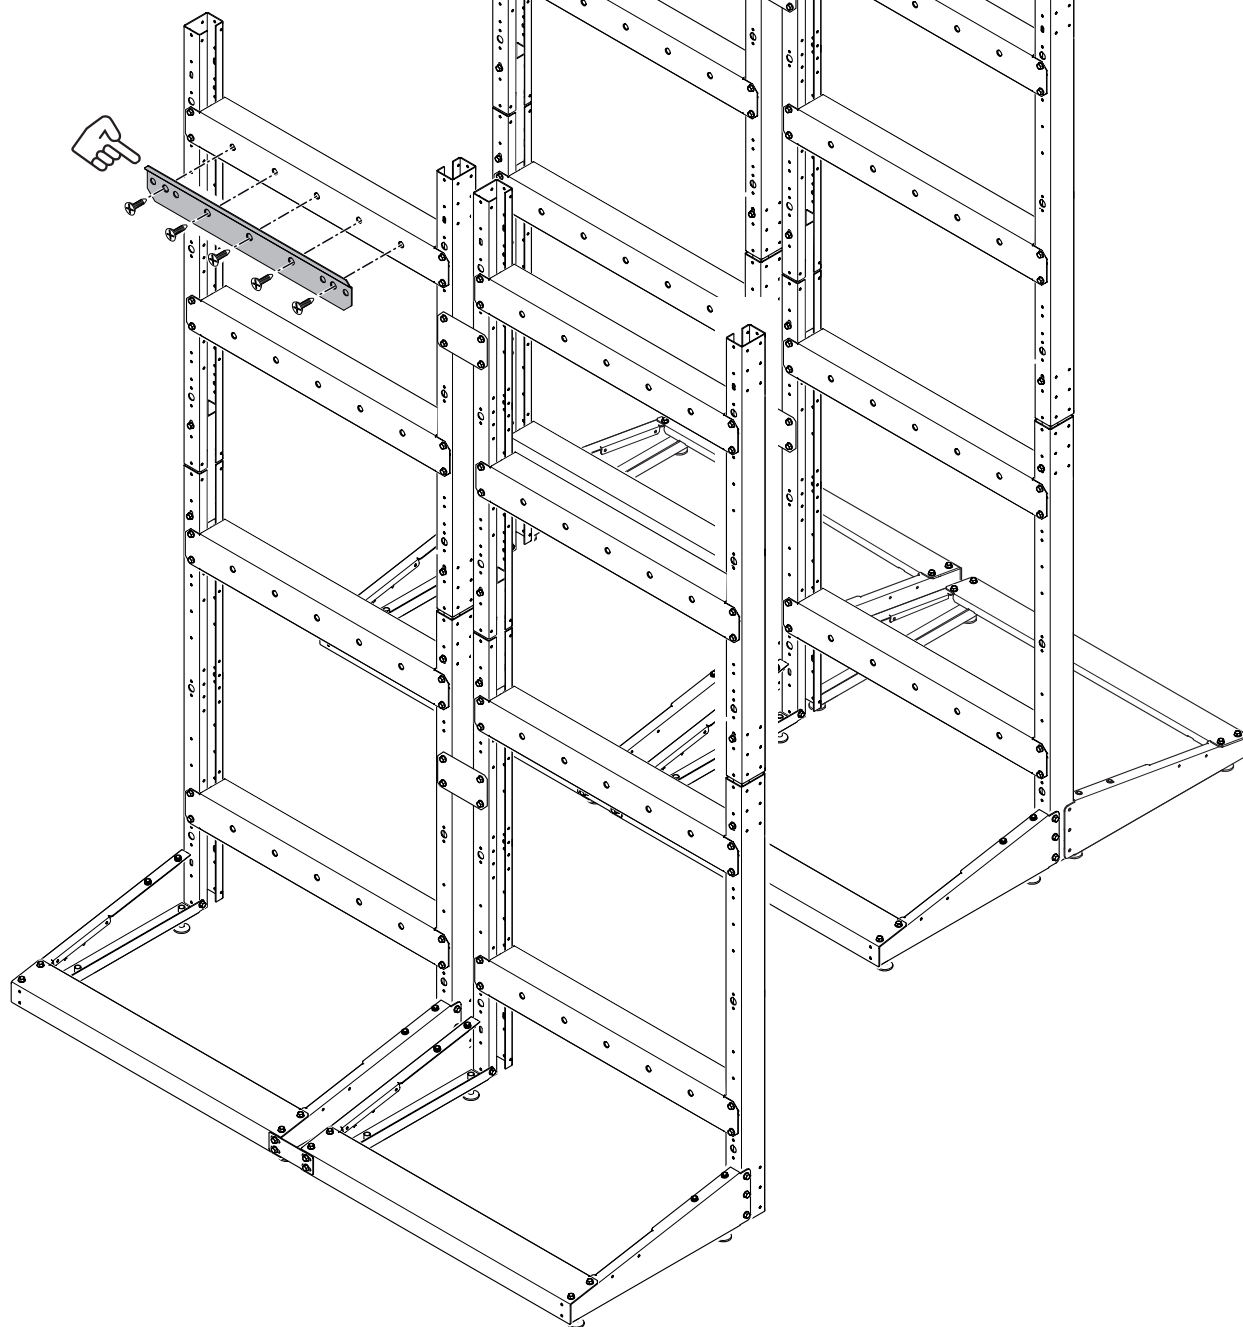


Fitting the thermal module onto the frame

- 1 Working together with other people, lift the thermal module.
- 2 Correctly position the module on the bracket which was previously fitted onto the frame.

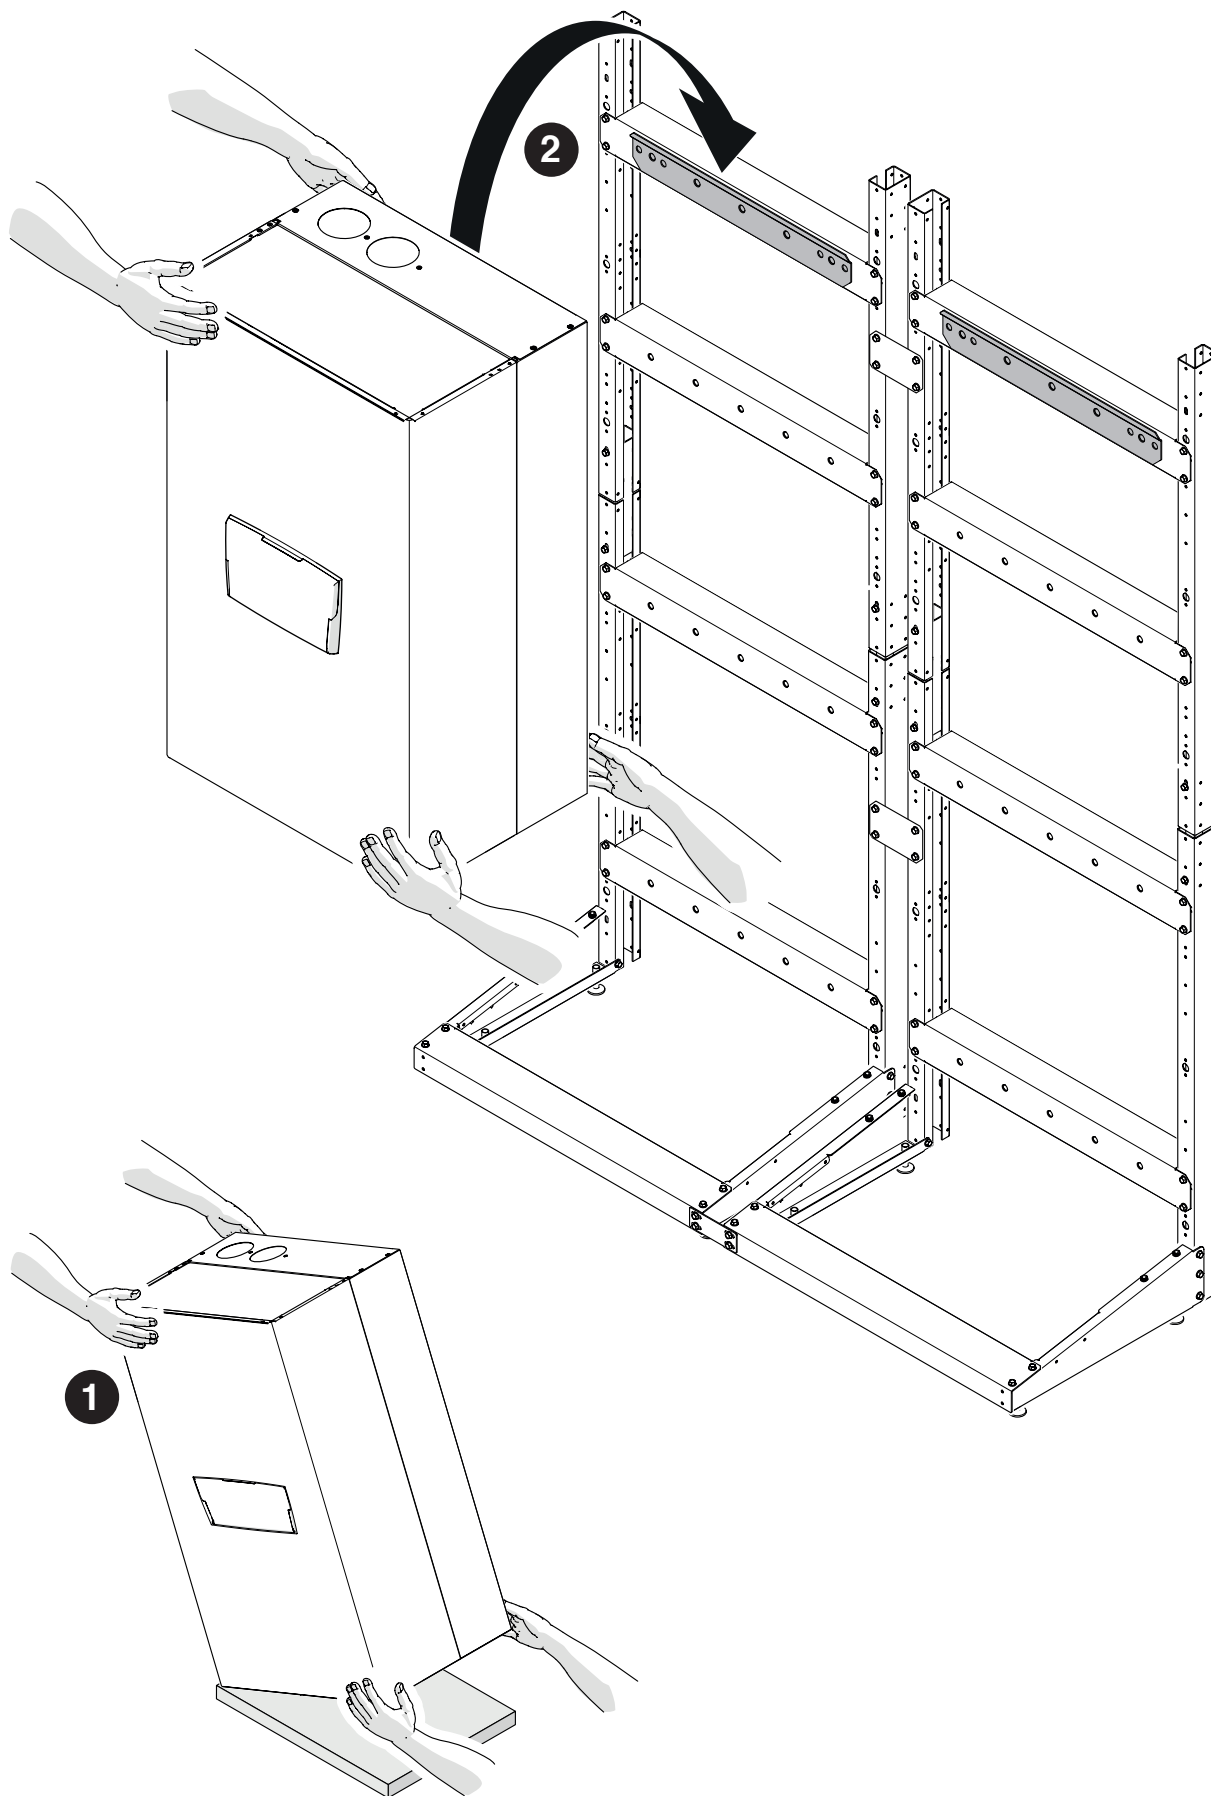

Removing the front panels

- 1 Remove the lock screw (A) and pull the front panel outwards.
- 2 Push the front panel upwards to release it from the points (B).

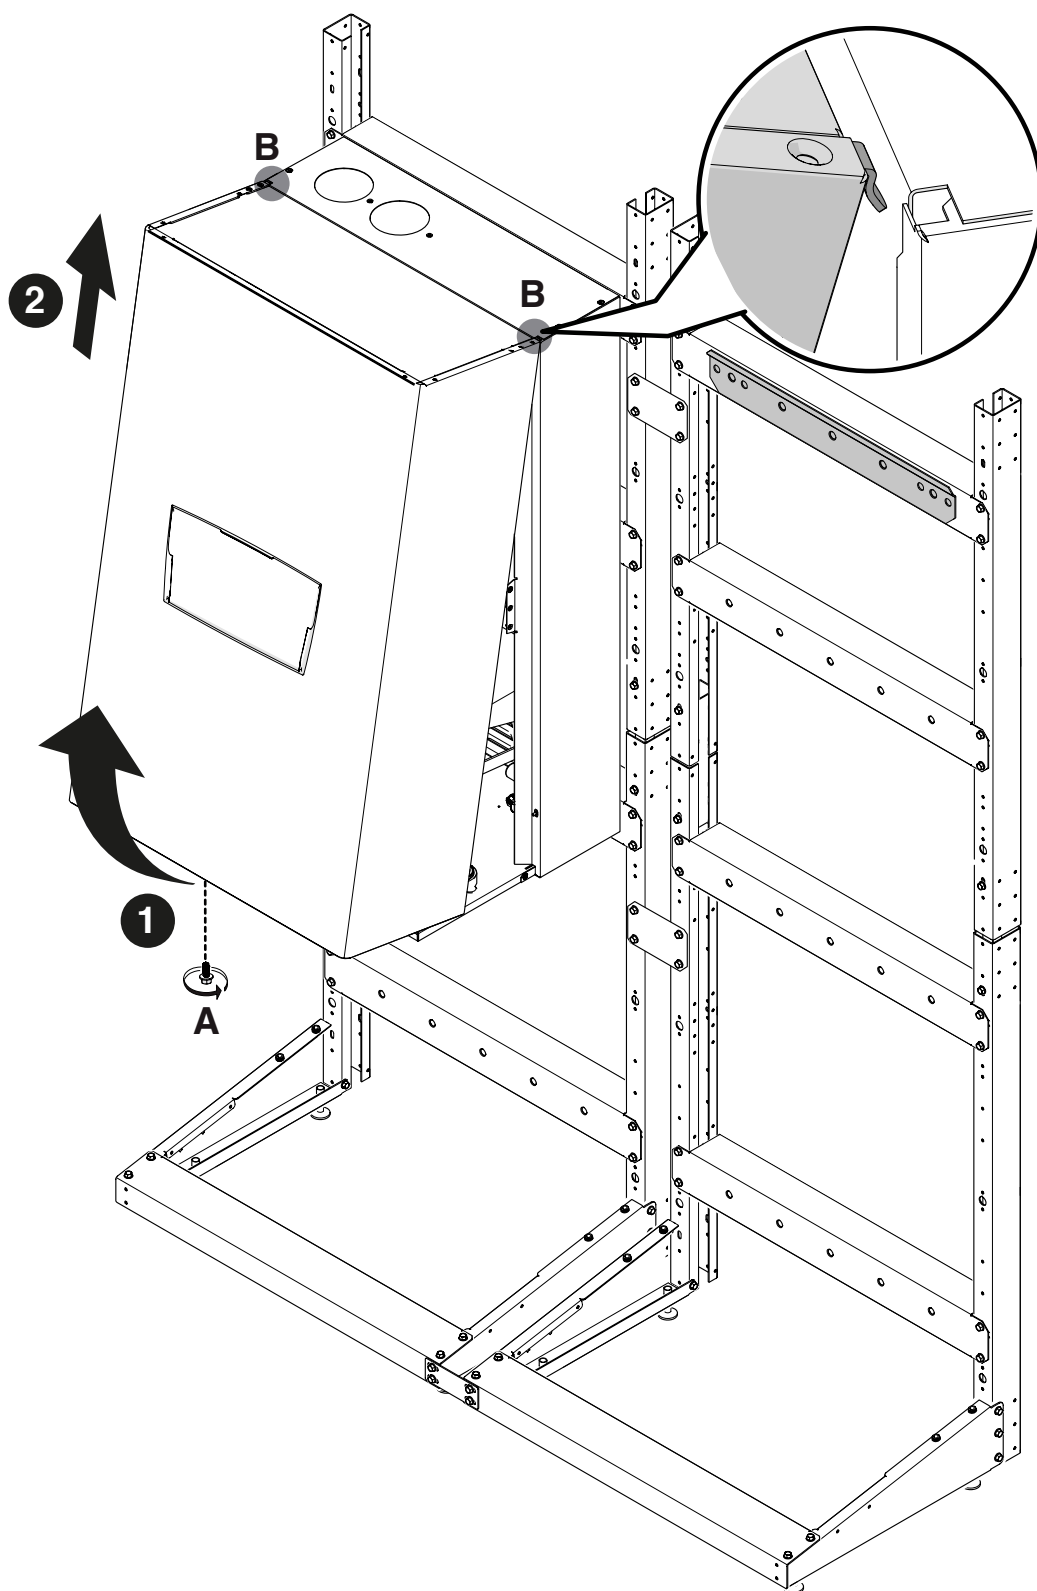


2.3 Positioning the CONDENSATE PIPES


Installation of the condensate outlet pipe. Components included in code 20130222 - 20130223

The figure refers to an installation with 2 modules in line or 3/4 modules B2B.

- 1 Position the seal on the side of the condensate outlet.
- 2 Position the plug on the opposite side of the condensate outlet.

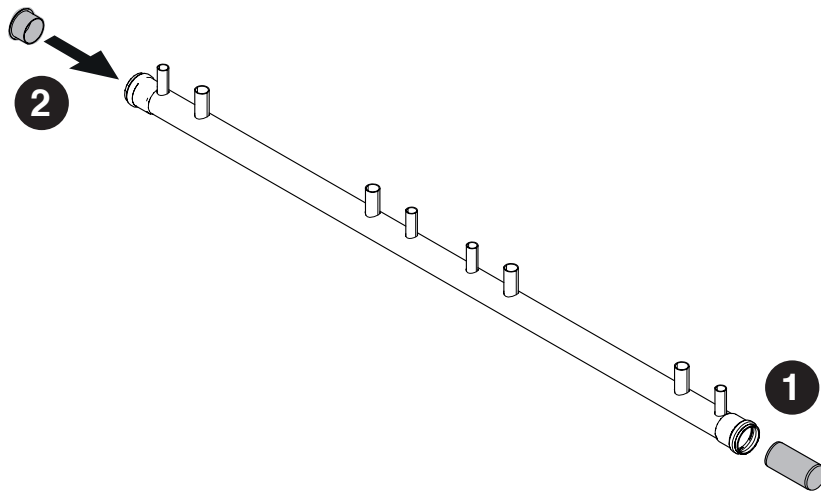

- 3 Position the condensate outlet pipe on the frames.
- 4 Secure it using the designated brackets.

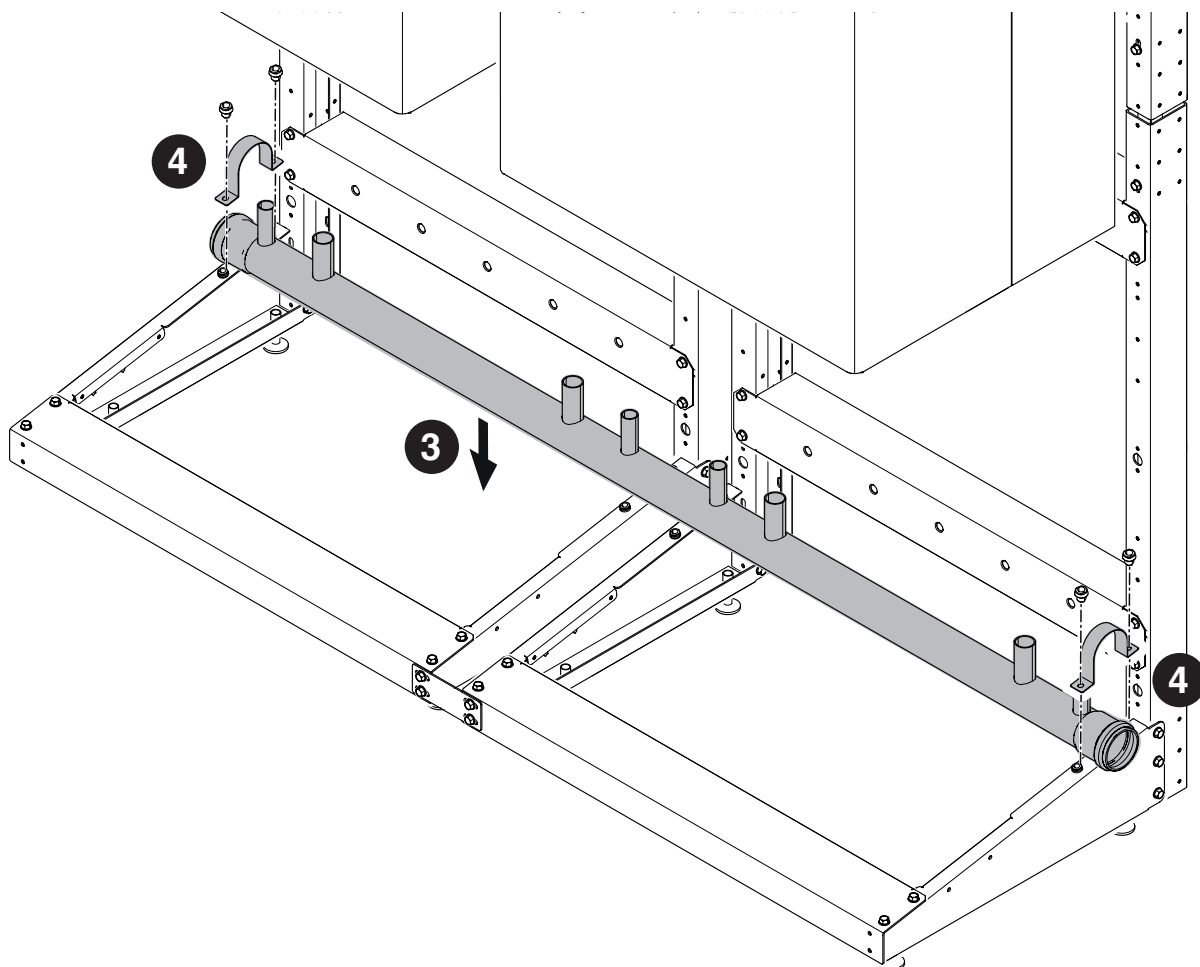

2.4 Positioning the 3" MANIFOLDS


Assembly of the gas, delivery and return manifolds. Components included in code 20133220 - 20130220 - 20130221

The figure refers to an installation with 2 modules in line or 3/4 modules B2B.


- 1 Secure the left support bracket.
- 2 Secure the right support bracket.
- 3 Position the RETURN manifold.




Make sure that the delivery and return manifolds are not inverted.

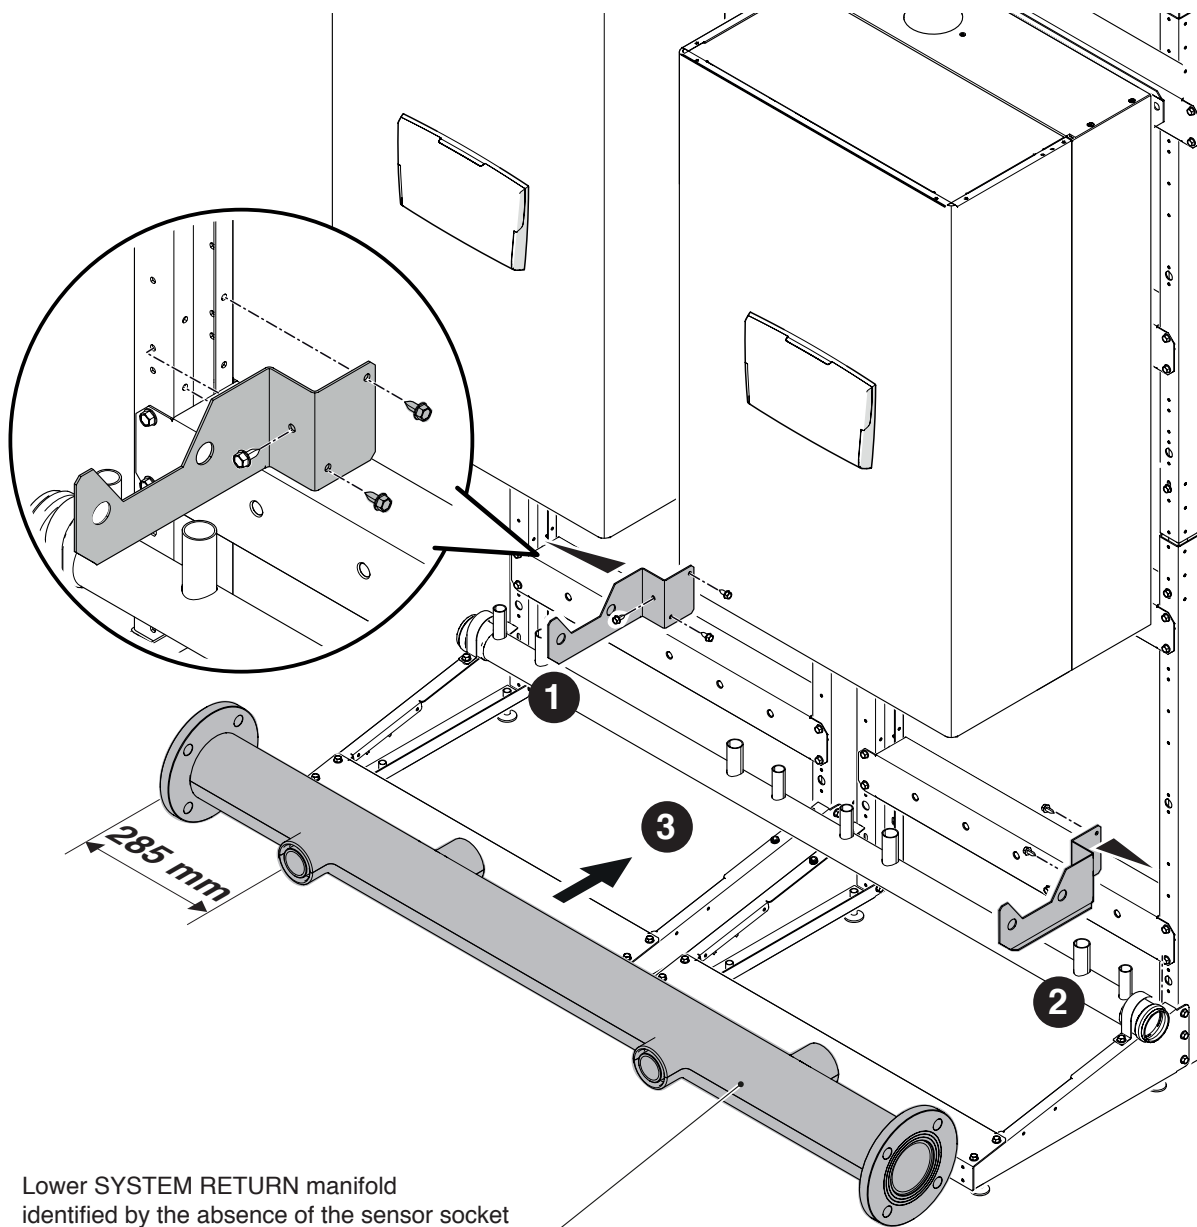


- 4 Secure the left support bracket.
- 5 Secure the right support bracket.
- 6 Position the DELIVERY manifold.

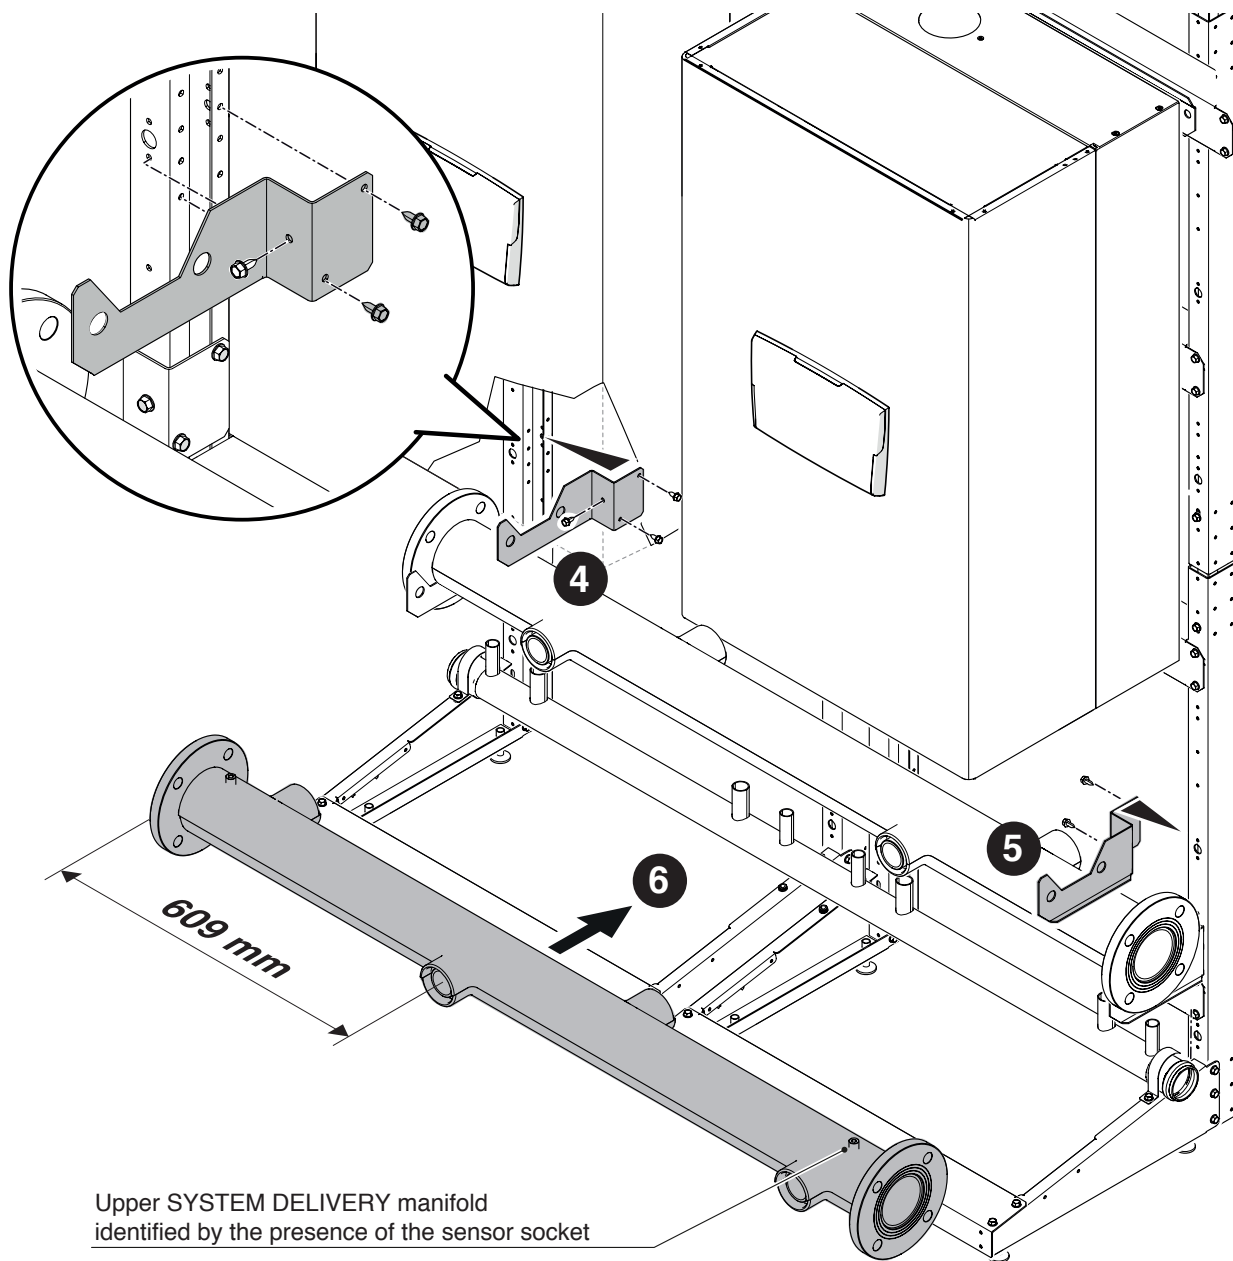

- 7 Position the GAS manifold.
- 8 Secure the GAS manifold to the frame.

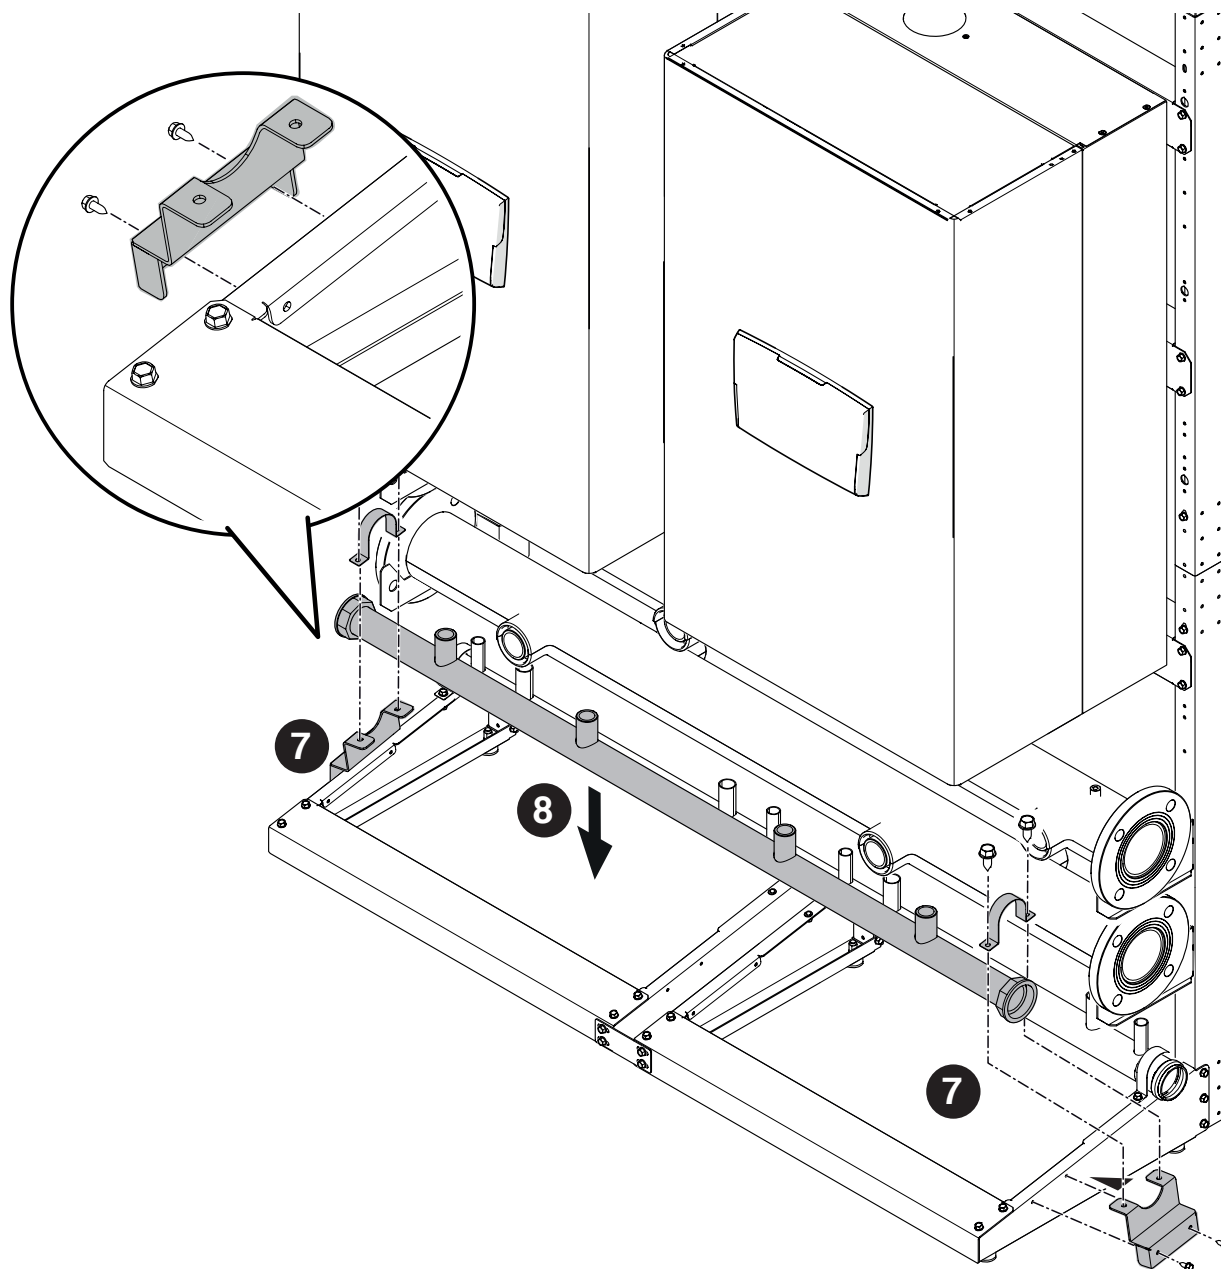

- 9 Position the manifold closing plugs from the required side.

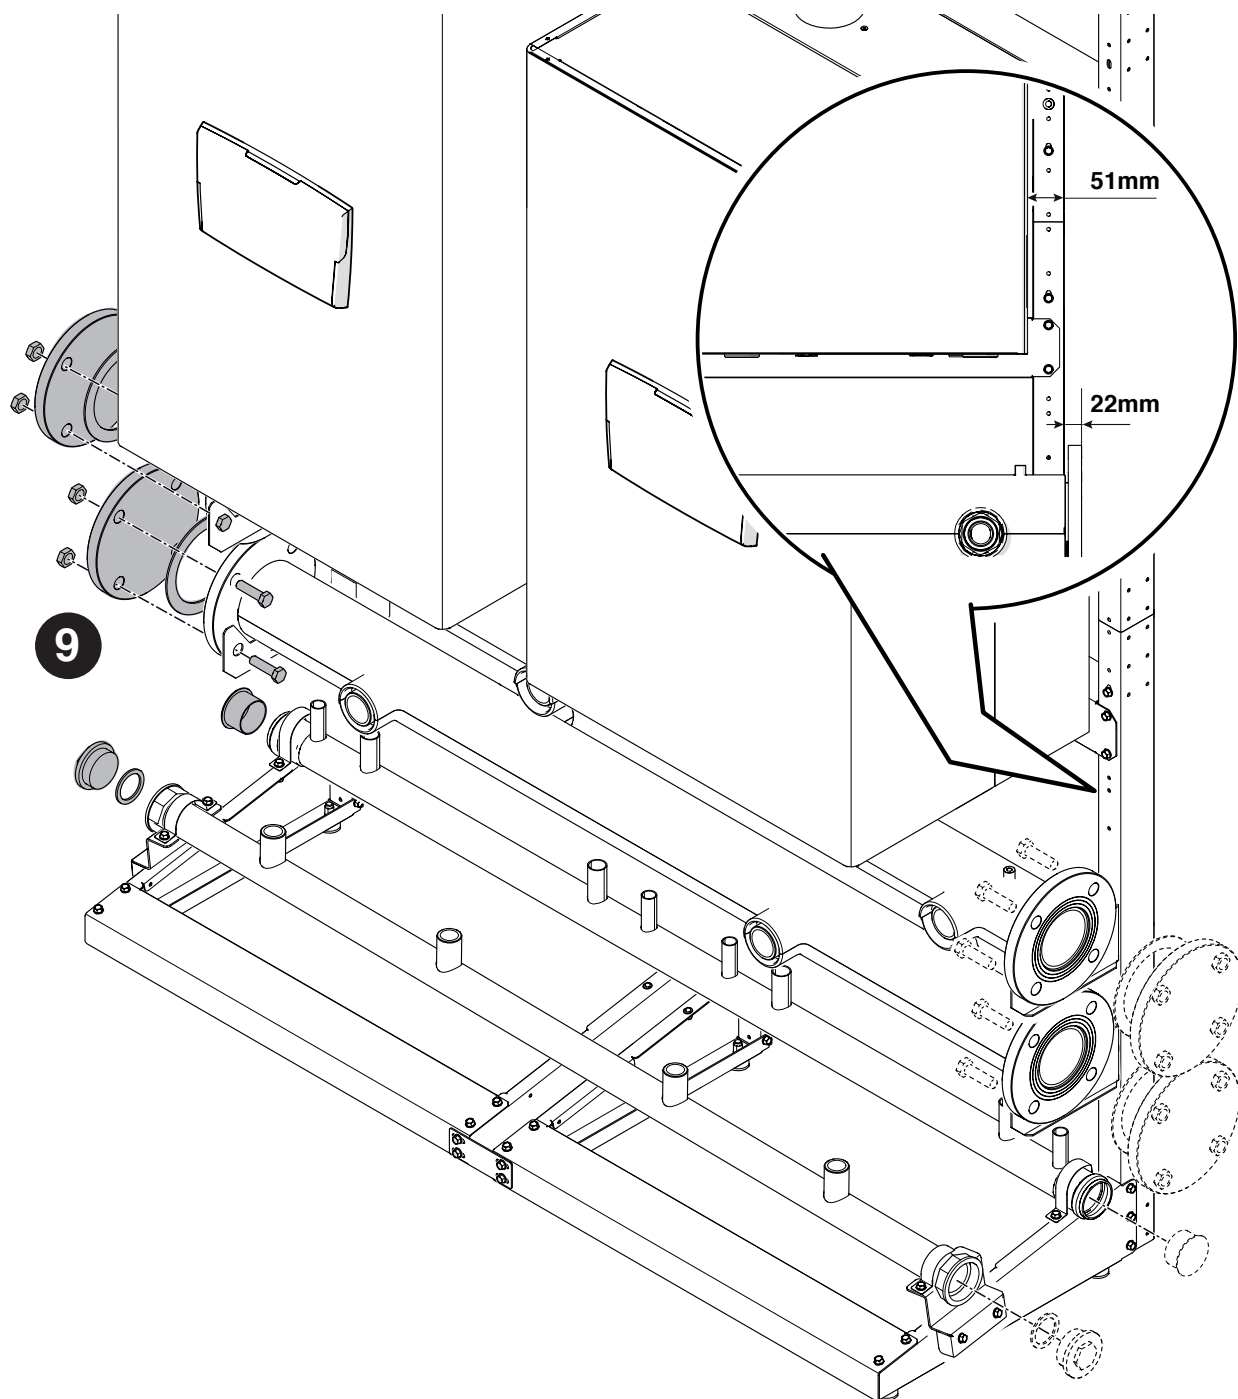

2.5 Positioning the 5" MANIFOLDS


Assembly of the gas, delivery and return manifolds. Components included in code 20130222 - 20130223

The figure refers to an installation with 2 modules in line or 3/4 modules B2B.


- 1 Secure the left support bracket.
- 2 Secure the right support bracket.
- 3 Position the RETURN manifold.




Make sure that the delivery and return manifolds are not inverted.

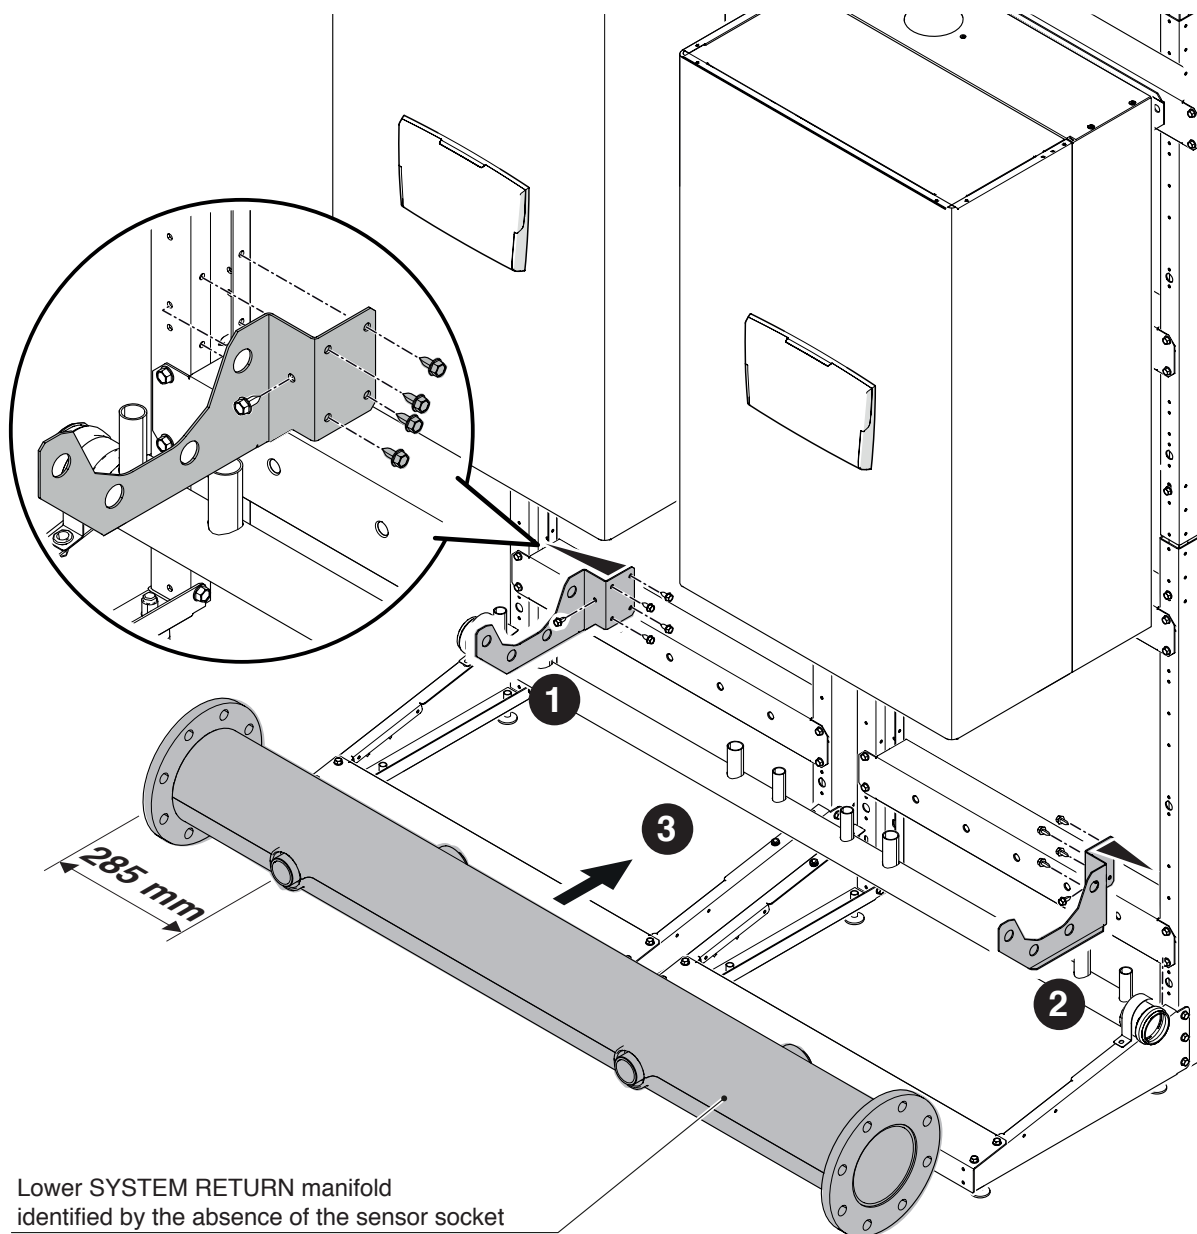


- 4 Secure the left support bracket.
- 5 Secure the right support bracket.
- 6 Position the DELIVERY manifold.

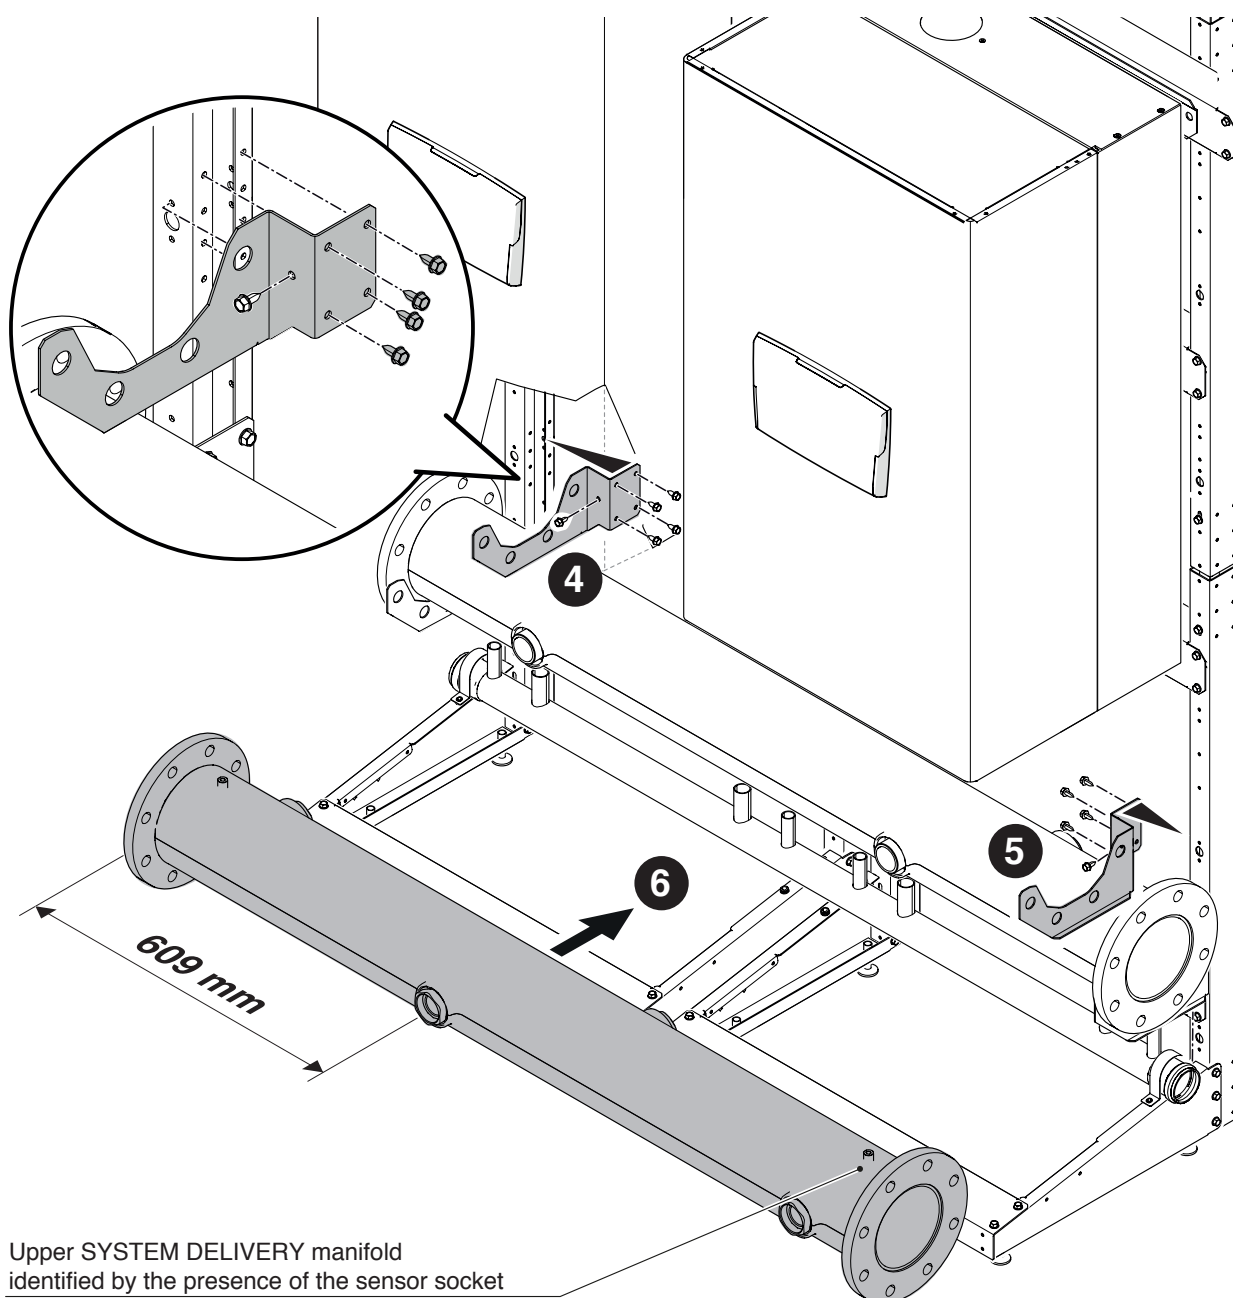

- 7 Position the GAS manifold.
- 8 Secure the GAS manifold to the frame.

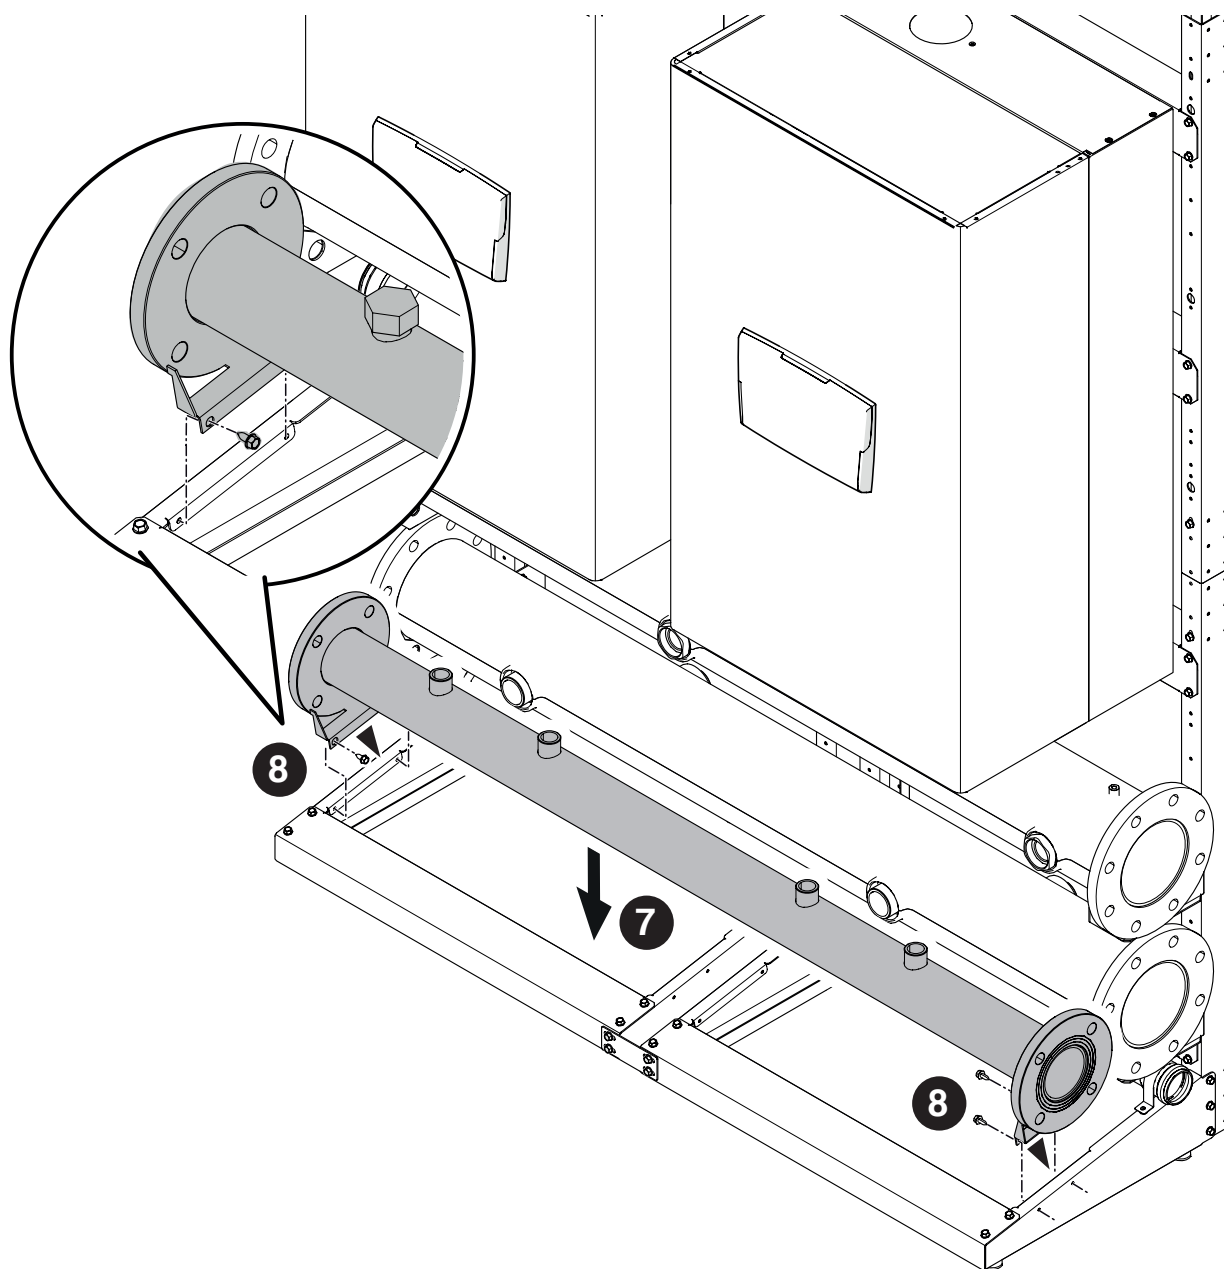

- 9 Position the manifold closing plugs from the required side.

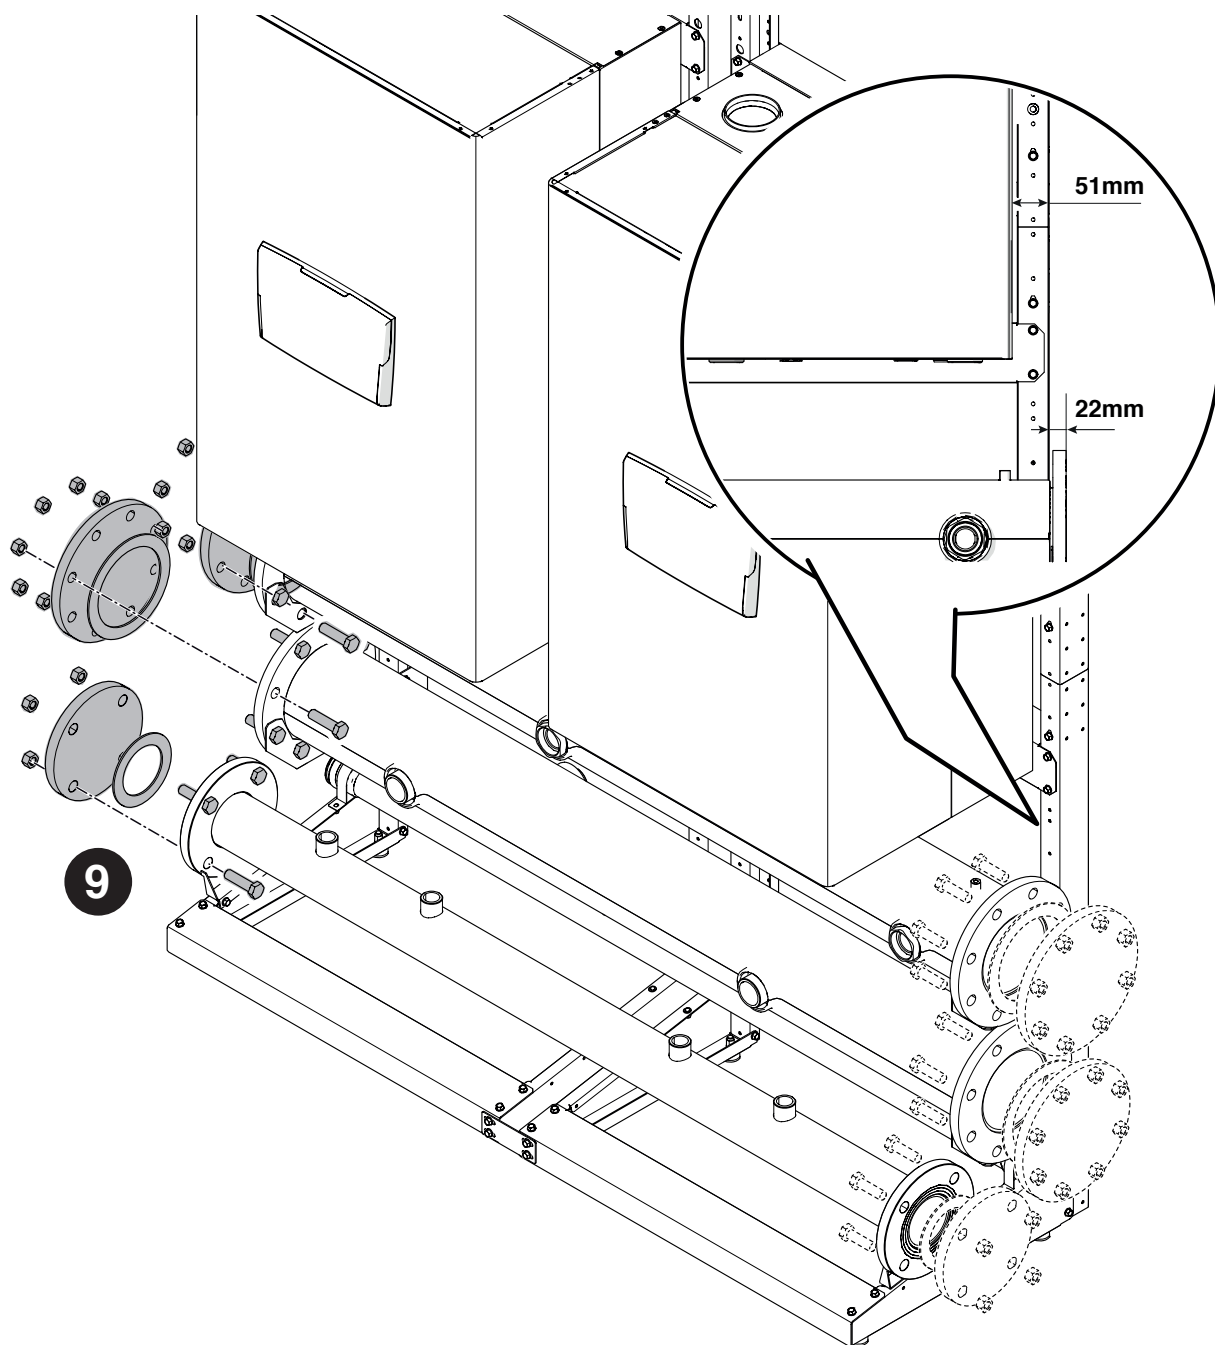


2.6 Positioning the CONDENSATE OUTLET

Assembly of the condensate outlet. Components included in code 20131267

The figure refers to an installation with 2 modules in line or 3/4 modules B2B.

- 1 Make a siphon using the outlet pipe and secure it using cable ties (not supplied).
- (*) For models POWER MAX 50 P DEP and POWER MAX 50 P do not make the siphon.
- 2 Connect the pipes to the other thermal modules working in the same way as described for the first.

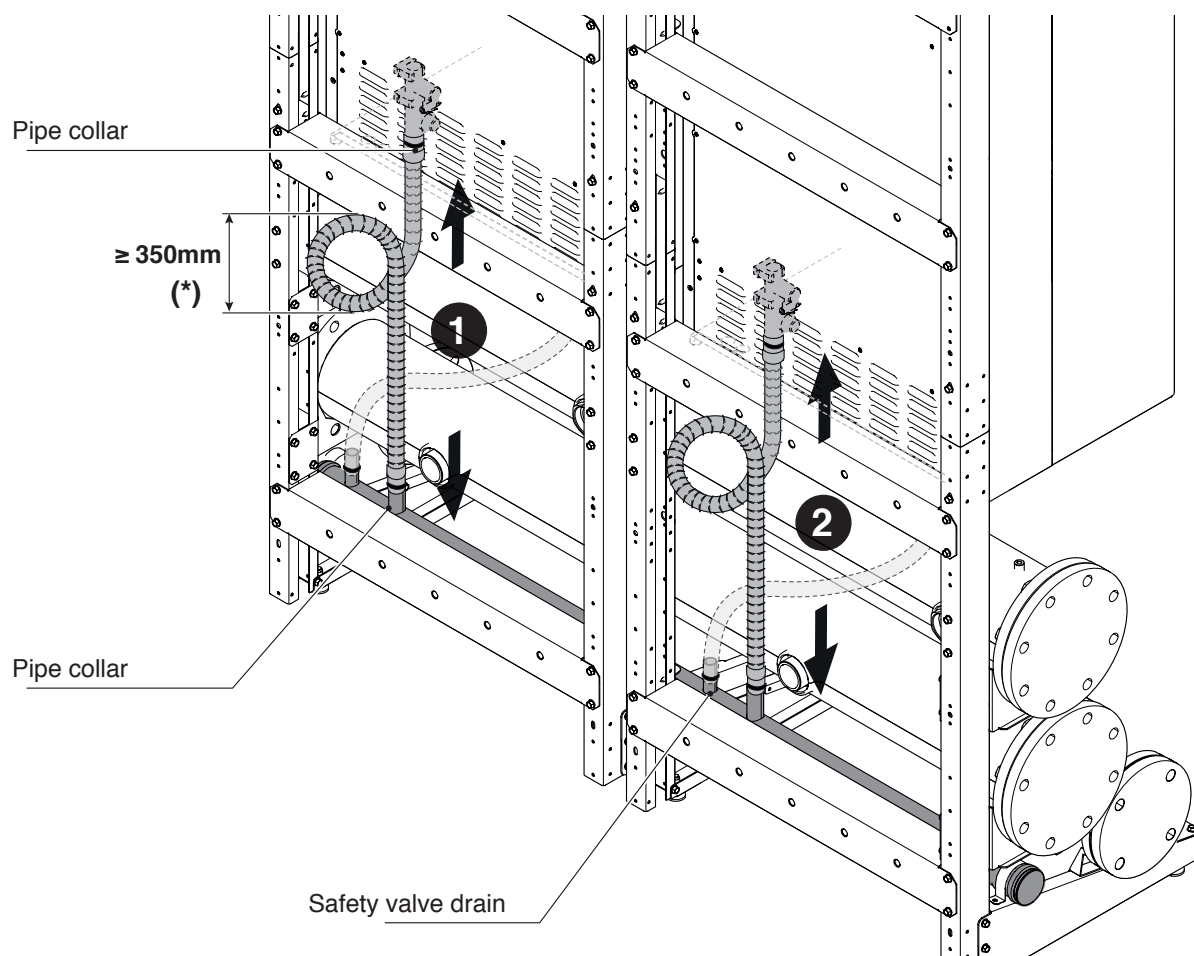


- ⚠ With thermal modules in BACK TO BACK configuration, use the dedicated coupling points.
- ⚠ Correctly position the plugs on the coupling points which are not used.
- ⚠ The coupling points which are not used can be used for the relief valve outlet

2.7 Positioning the GAS PIPES

CASCADE CONFIGURATION IN-LINE

Assembly of the gas pipes. Components included in code 20130658 – 20131121 – 20131122 – 20131123 – 20131124 – 20131125.


- 1 Install and seal the gas pipe to the thermal module.
- 2 Install and seal the cock to the pipe and the gas manifold.
- 3 Fit the plugs onto any unused coupling points ensuring tightness.

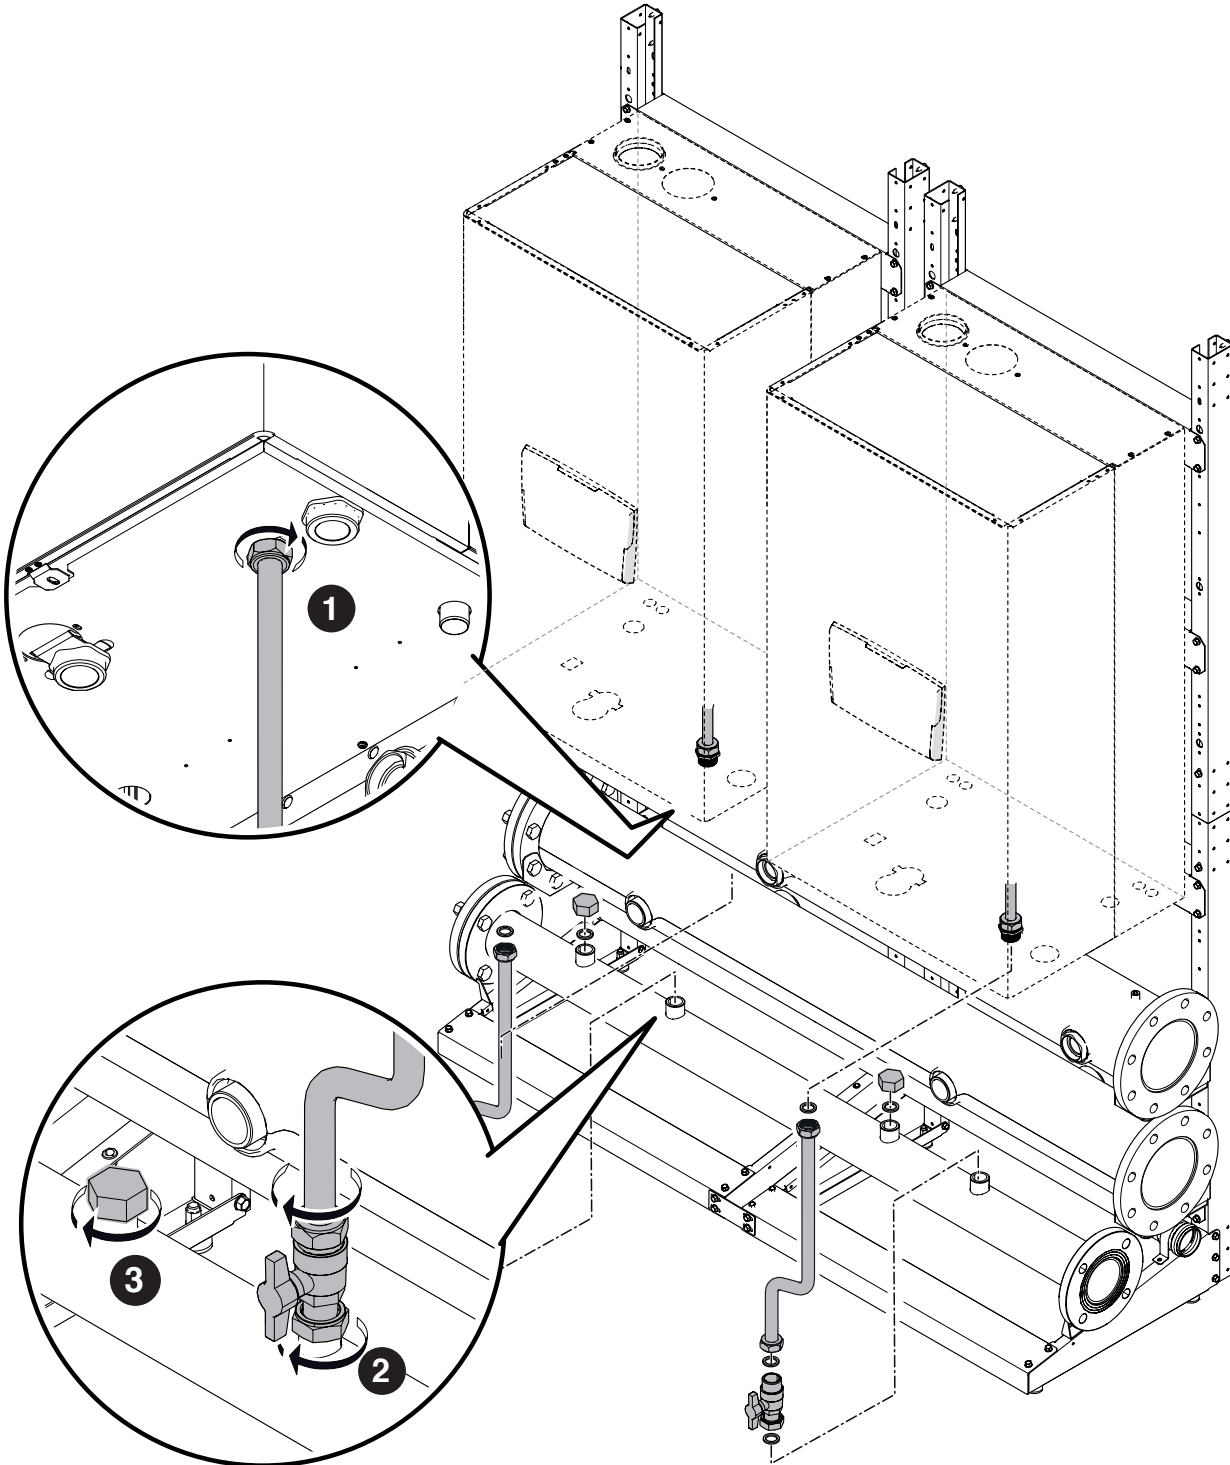


CASCADE CONFIGURATION B2B (BACK TO BACK)

Assembly of the gas pipes. Components included in code 20131787 – 20131788 – 20131789 – 20131790 – 20131791 – 20131792

- 1 Positioning the gas pipe.

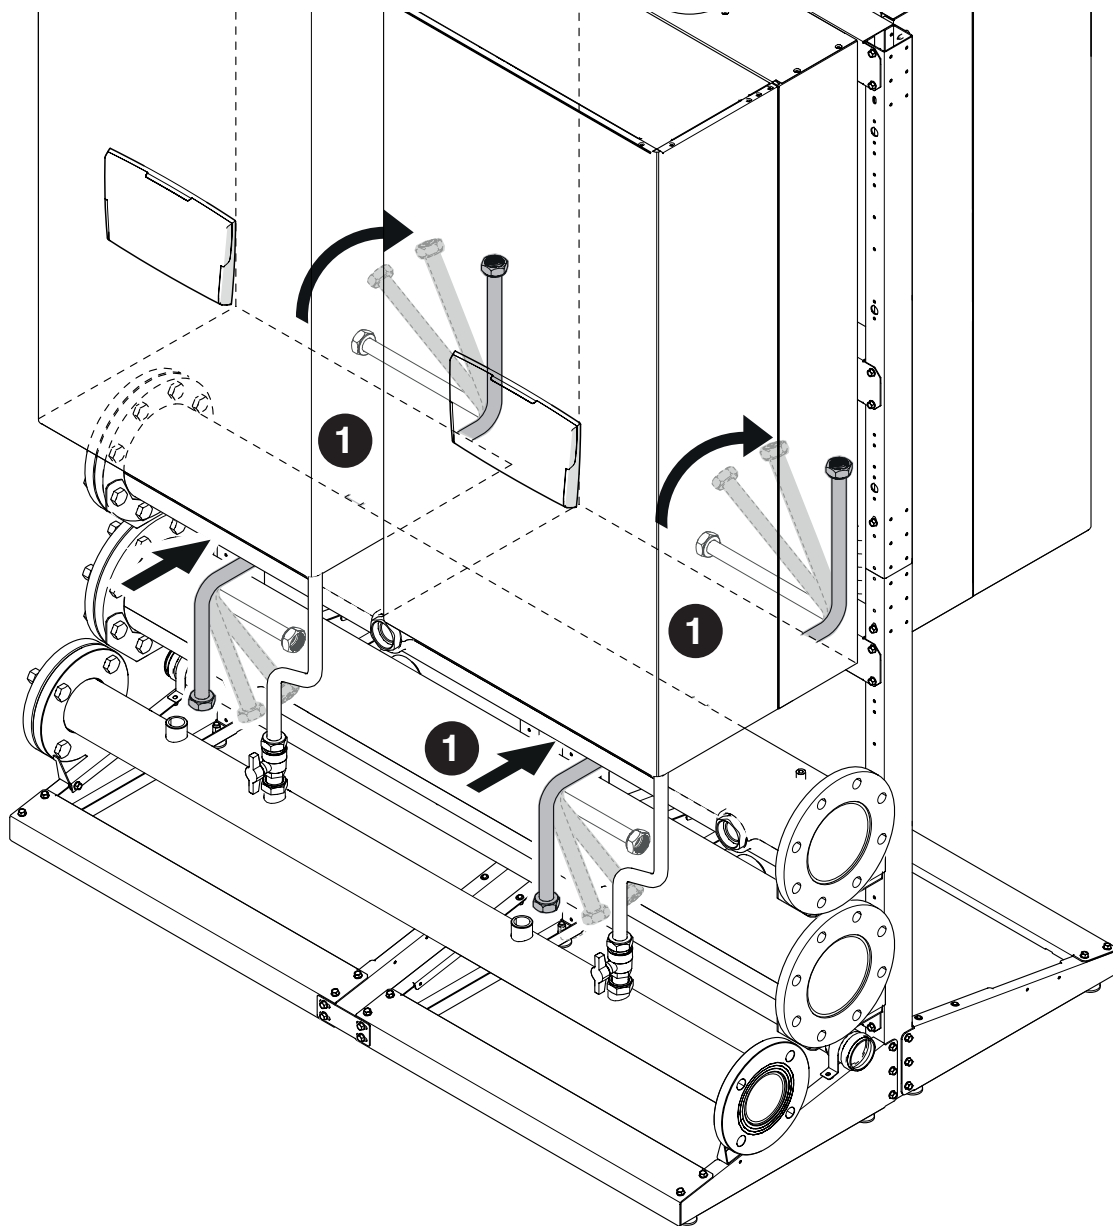

- 2 Installing and sealing the gas pipe to the thermal module.
- 3 Install and seal the cock to the pipe and the gas manifold.

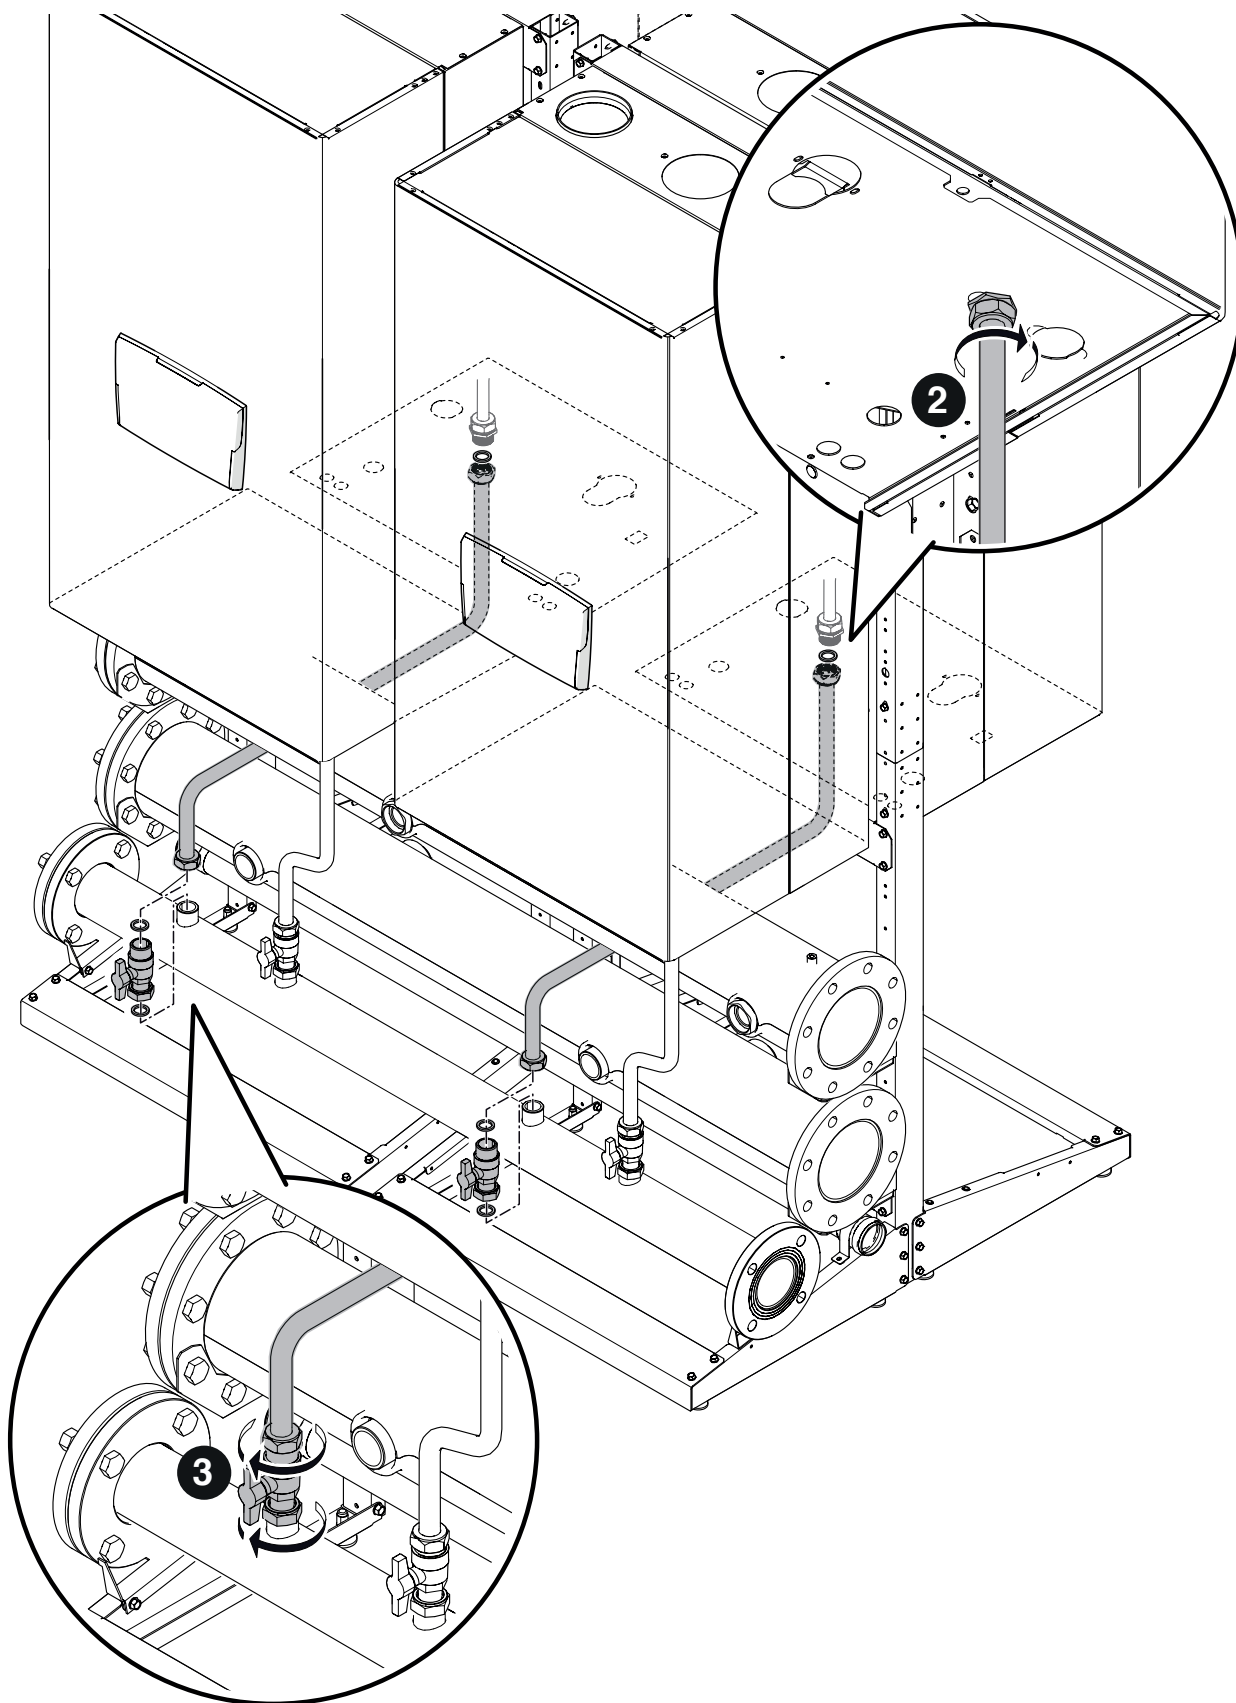


2.8 Positioning the DELIVERY-RETURN PIPES

CASCADE CONFIGURATION IN-LINE

Assembly of the RETURN pipes. Components included in code 20130658 – 20131121 – 20131122 – 20131123 – 20131124 - 20131125

- 1 Install and seal the RETURN unit selected between the thermal module coupling points (A) and (B) the return manifold.
- 2 Keep the insulation parts to one side and only fit them after testing has been completed.

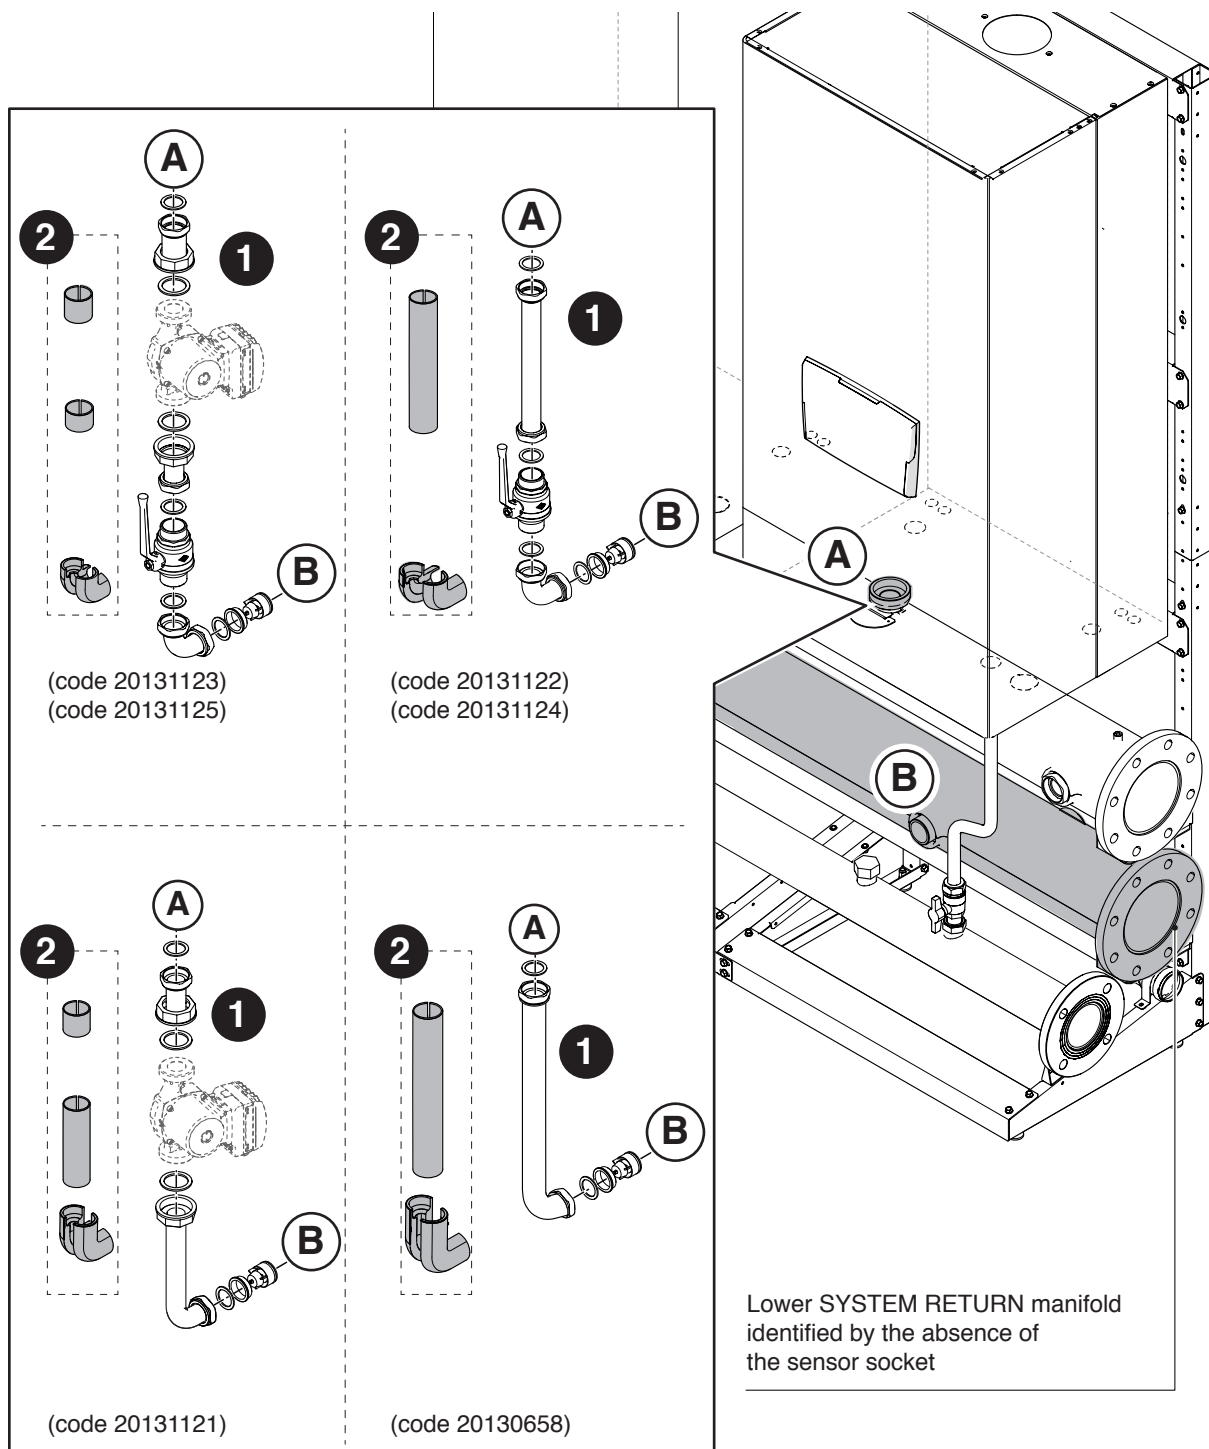


 Secure the plugs onto any unused coupling points.

CASCADE CONFIGURATION IN-LINE

Assembly of the DELIVERY pipes. Components included in code 20130658 – 20131121 – 20131122 – 20131123 – 20131124 - 20131125

- 3 Install and seal the DELIVERY unit selected between the thermal module coupling points (C) and (D) the return manifold.
- 4 Keep the insulation parts to one side and only fit them after testing has been completed.

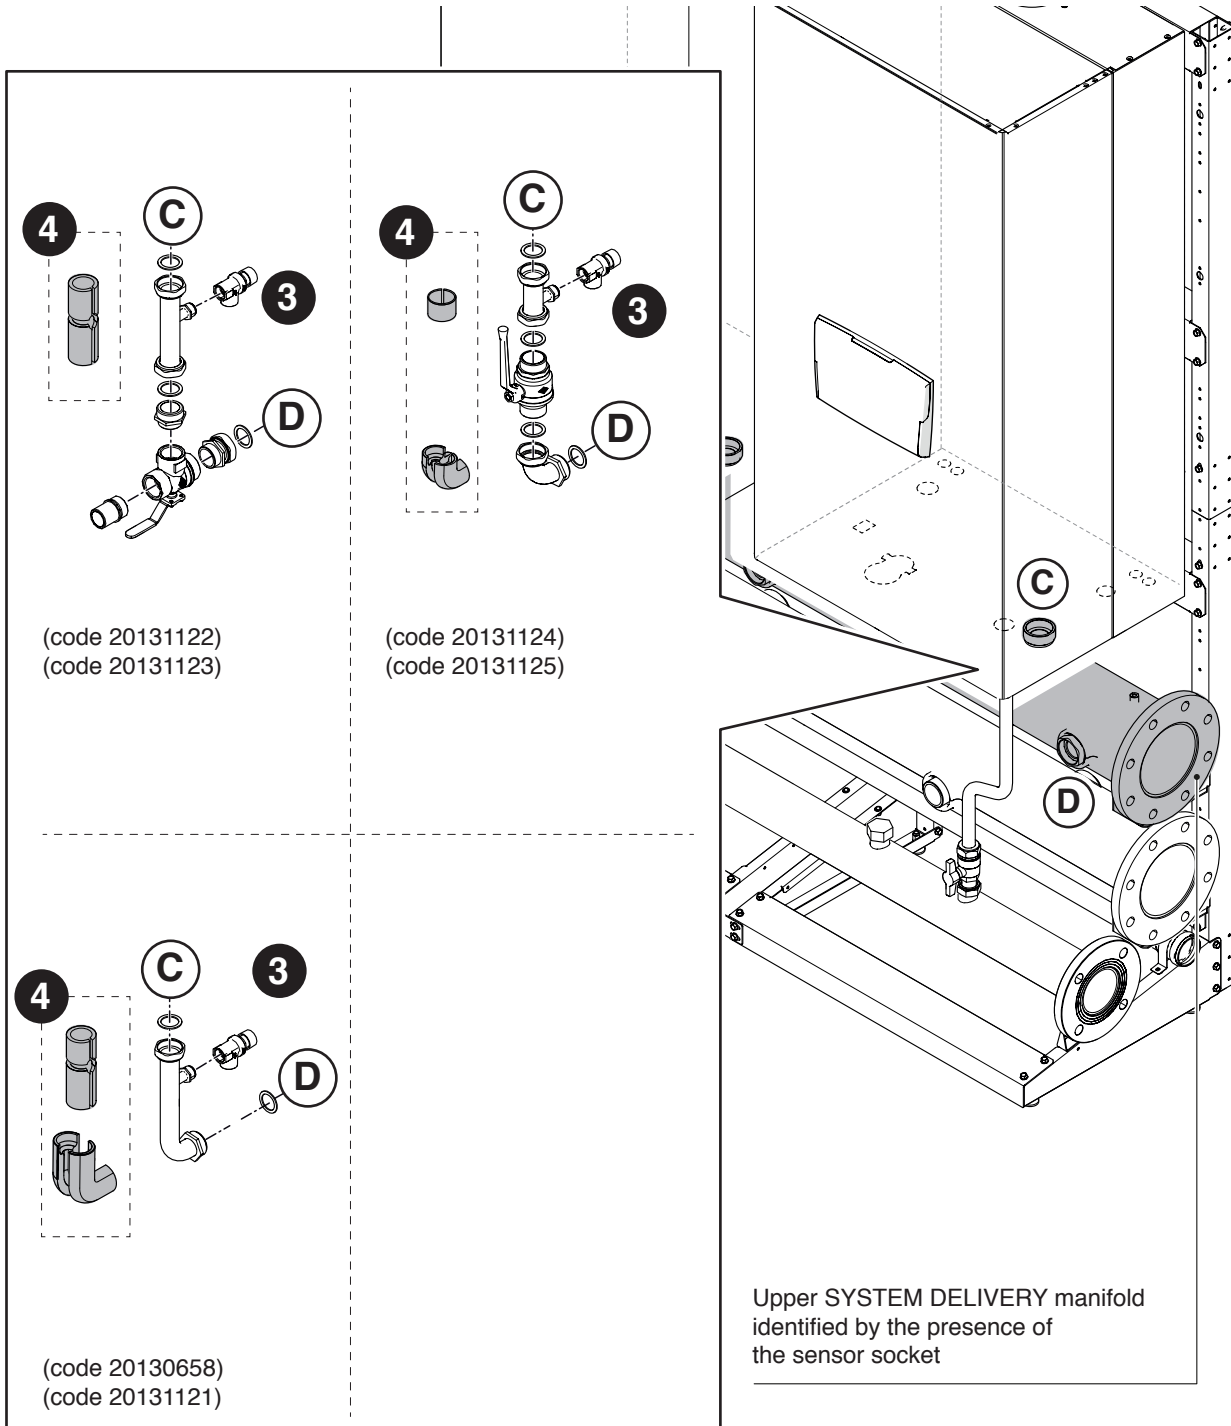


43

 Secure the plugs onto any unused coupling points.

CASCADE CONFIGURATION B2B (BACK TO BACK)

Assembly of the RETURN pipes. Components included in code 20131787 – 20131788 – 20131789 – 20131790 – 20131791 – 20131792

- 5 Install and seal the RETURN unit selected between the thermal module coupling points (E) and (F) the return manifold.
- 6 Keep the insulation parts to one side and only fit them after testing has been completed.

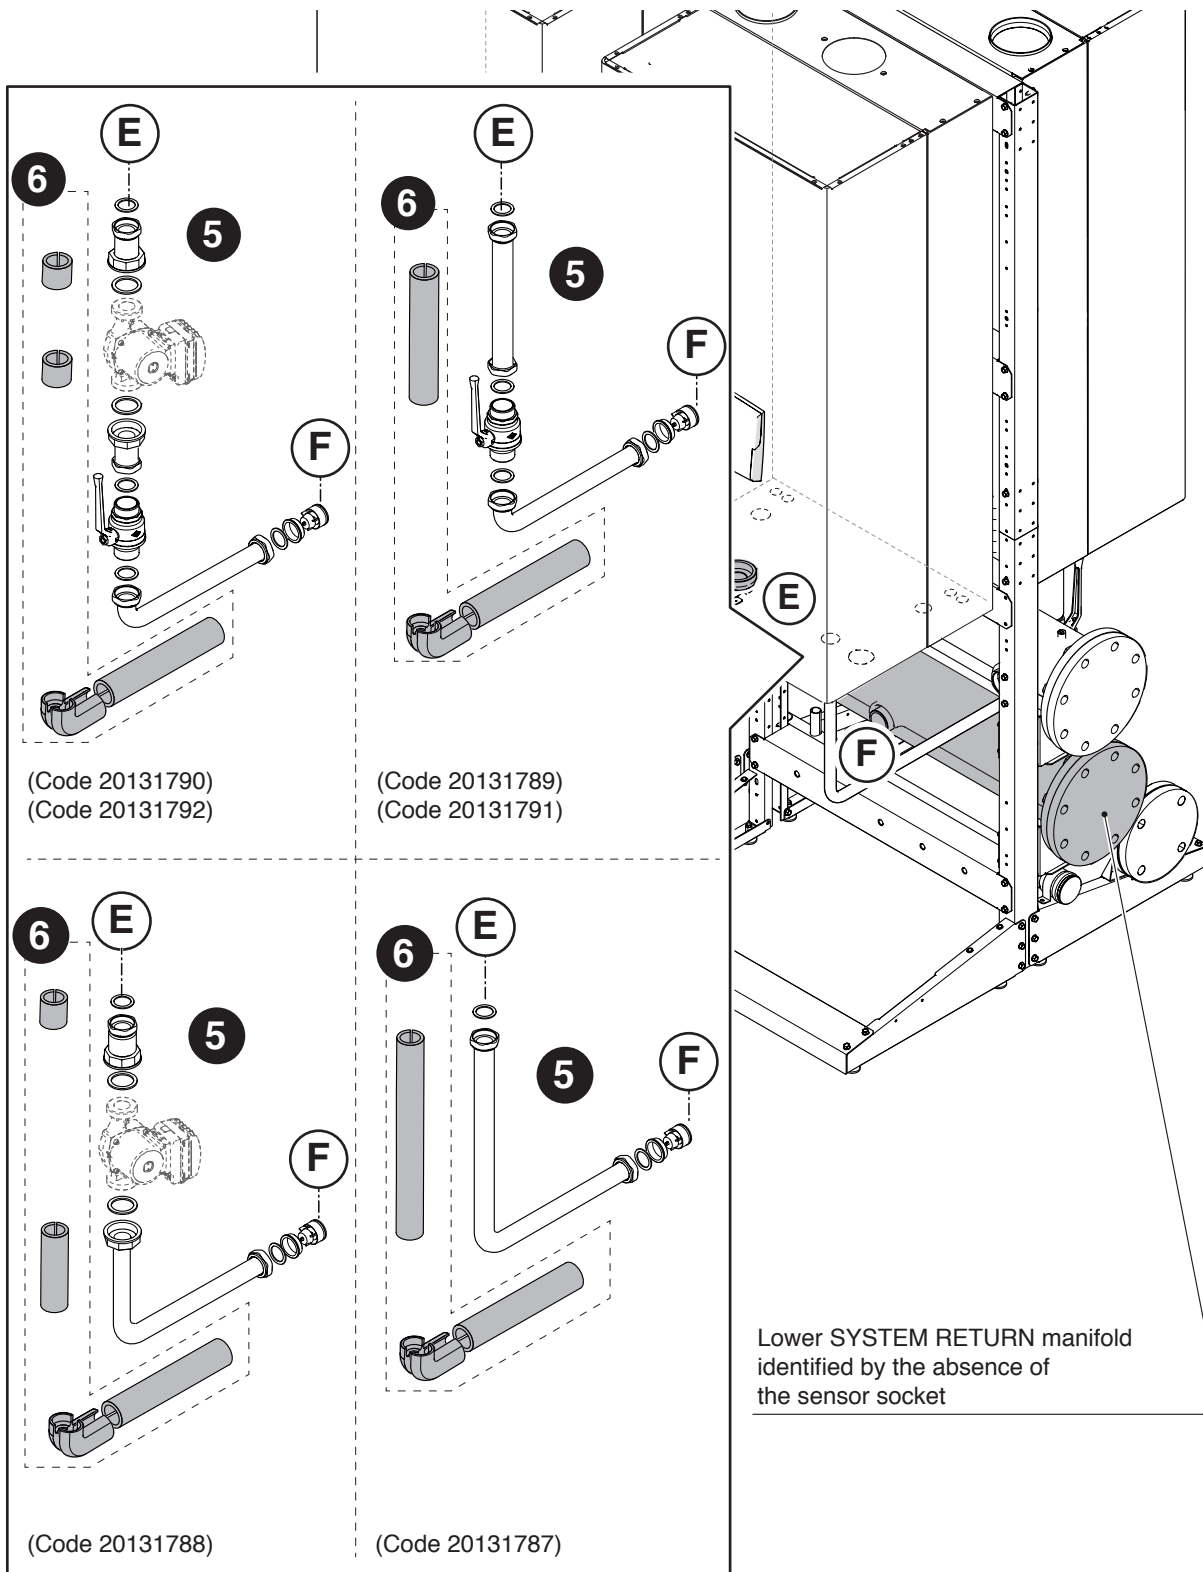


⚠ Secure the plugs onto any unused coupling points.

CASCADE CONFIGURATION B2B (BACK TO BACK)

Assembly of the DELIVERY pipes. Components included in code 20131787 – 20131788 – 20131789 – 20131790 – 20131791 - 20131792

- 7 Install and seal the DELIVERY unit selected between the thermal module coupling points (G) and (H) the return manifold.
- 8 Keep the insulation parts to one side and only fit them after testing has been completed.

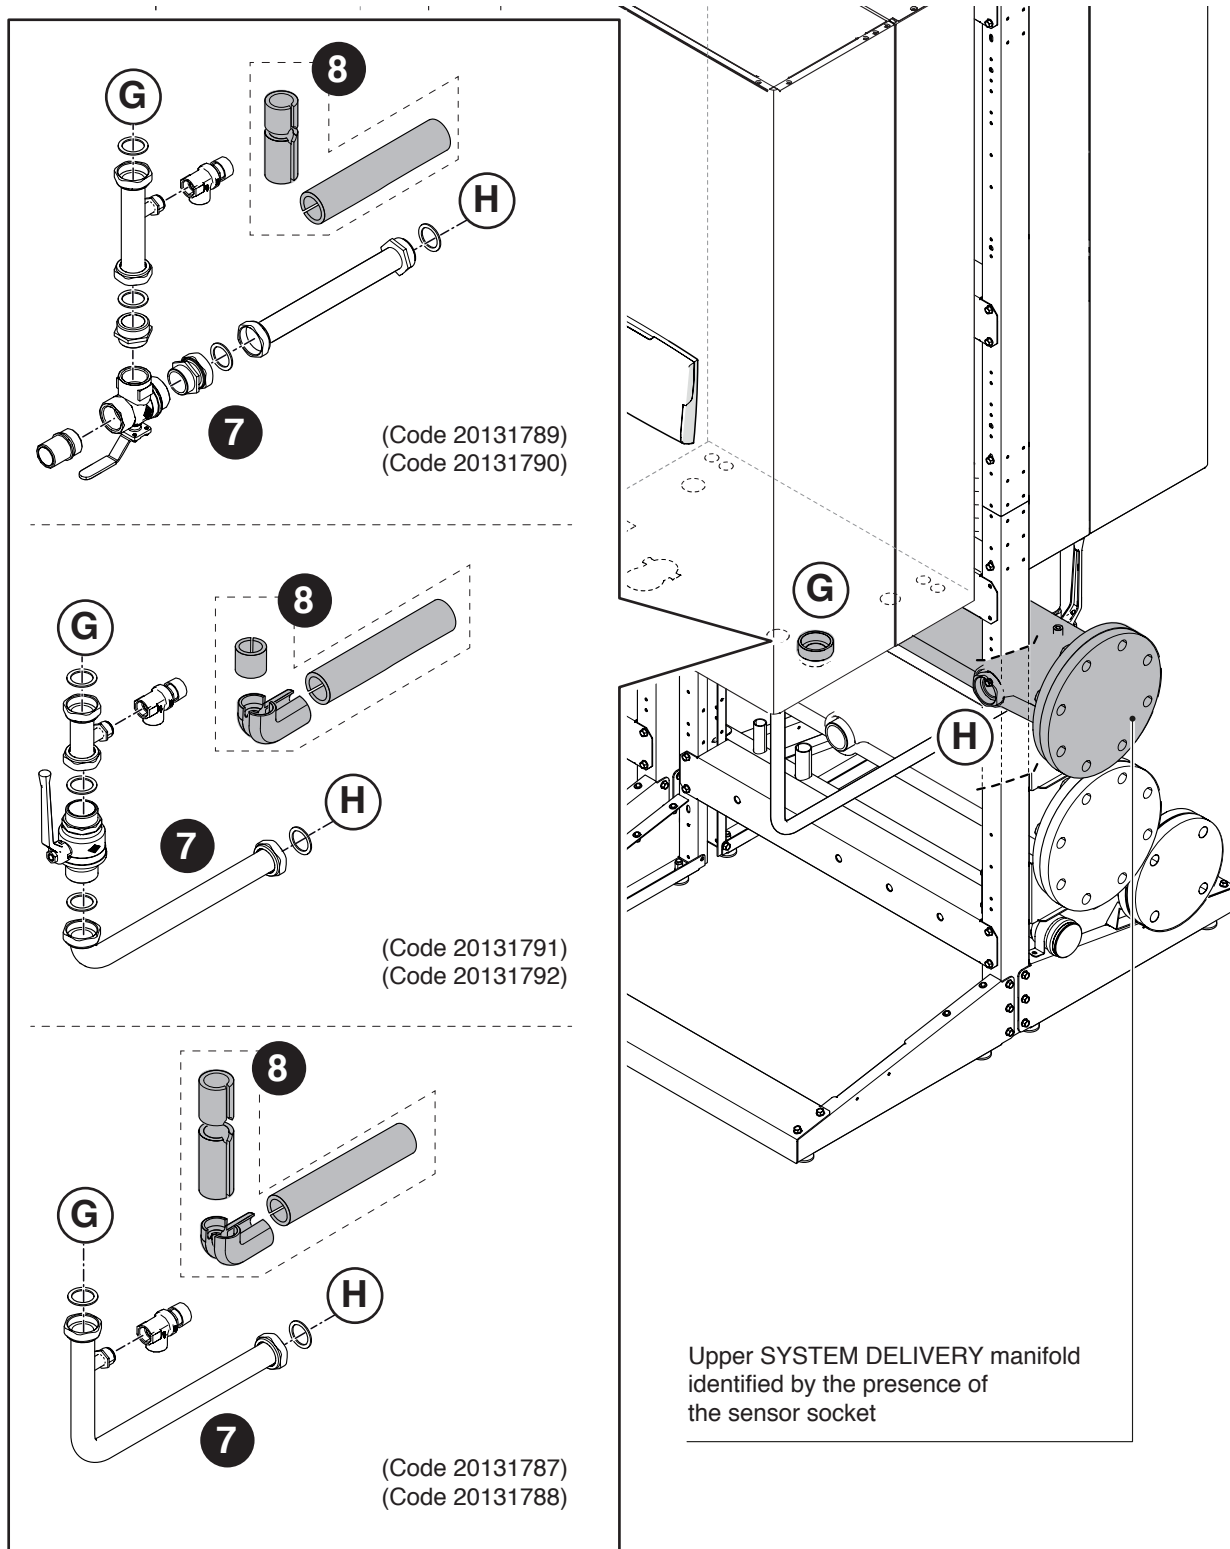

45


⚠ Secure the plugs onto any unused coupling points.

2.9 Positioning the SAFETY SECTION AND SEPARATOR

Assembly of the safety separator and separator. Components included in code 20070910 - 20070912 - 20132873 - 20070699 - 20070701 - 20070702 - 20132874 - 20070703 - 20070704 - 20070705 - 20071190 - 20023104 - 20023106 - 20009486 - 20009482 - 20009483 - 20061640

- 1 Install and seal the selected return unit at the return manifold.
- 2 Install and seal the selected return unit at the separator. Installing the primary pump (if present).
- 3 Install and seal the selected INAIL section at the delivery manifold.
- 4 Install and seal the selected INAIL section at the separator.

Proceed to install the safety elements contained in the specific kit.

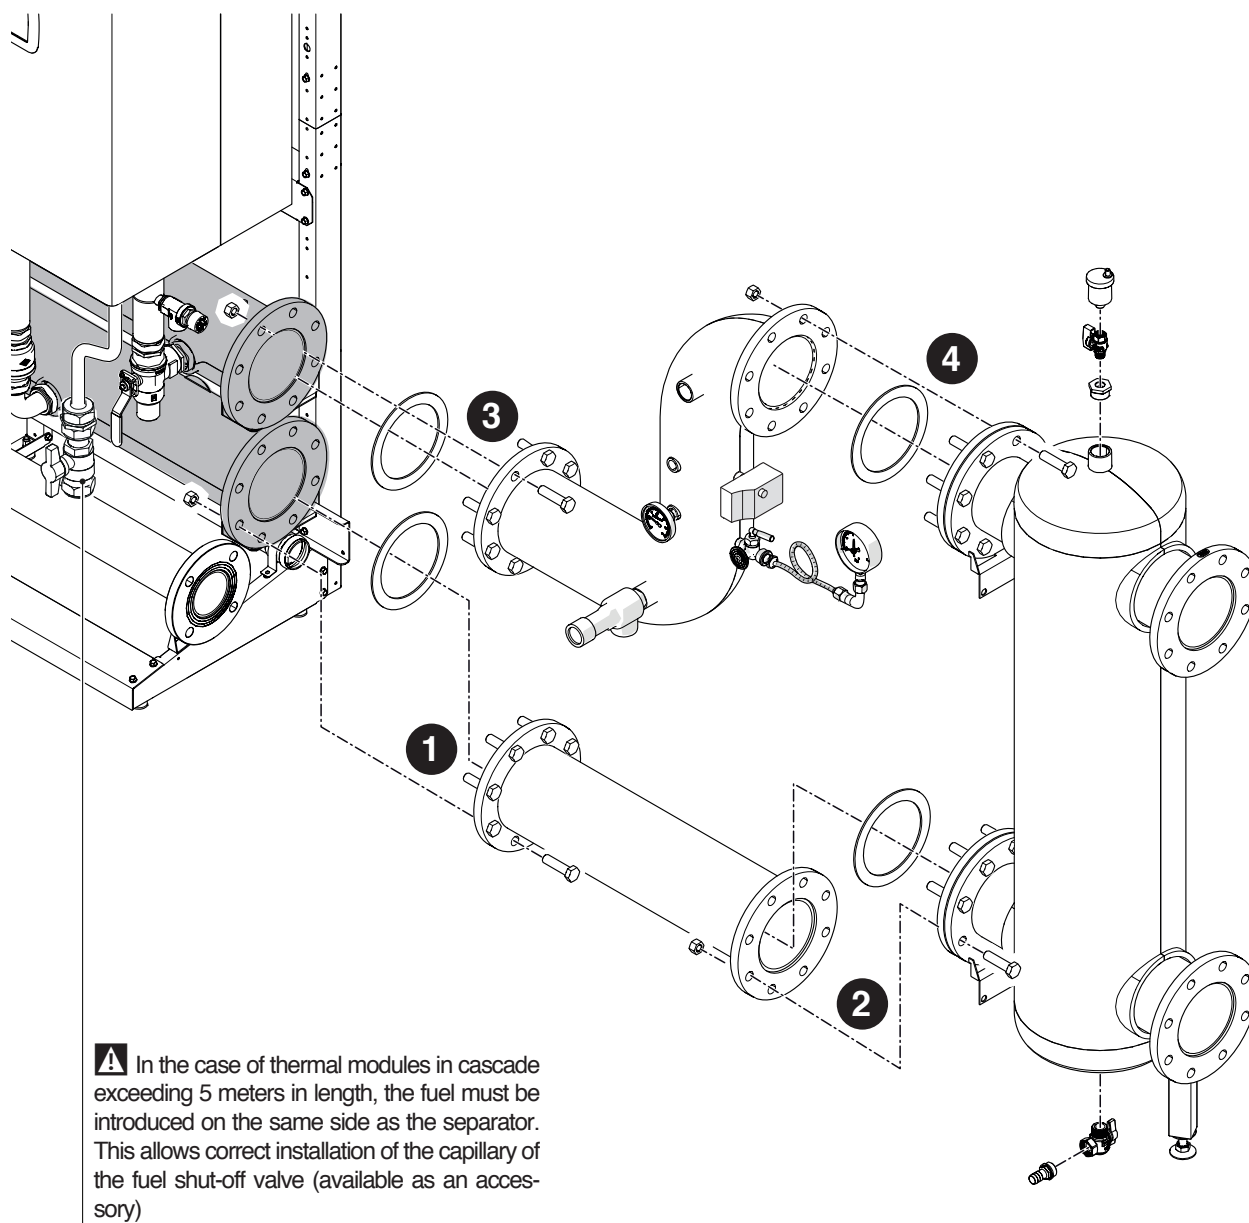


Once all the hydraulic connections have been made, the tightness test of the system can be carried out and the insulation parts can be fitted to complete the system.

⚠ Follow the safety and system filling procedures as indicated in the user manual of the individual appliances **POWER MAX**.

CASCADE CONFIGURATION IN-LINE


Assembly of the FLUE SYSTEM DN 160 - DN 200 - DN 250. Components included in code 20131266 - cod. 20132381 - cod. 20131218

- ⚠ For model installations POWER MAX 50 P DEP and POWER MAX 50 P it is COMPULSORY to use the Clapet accessory DN80 cod. 20164632.
- 1 Carefully cut the bends following the measurements indicated. This allows the flue gas outlet duct to slope by at least 3°

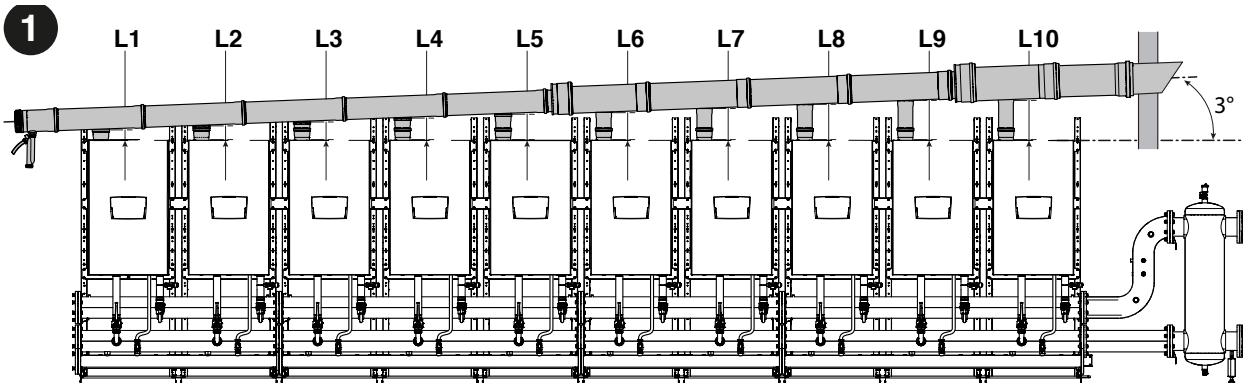

L1	L2	L3	L4	L5	
142	172	202	232	262	mm


L6	L7	L8	L9	L10	
292	322	352	382	412	mm

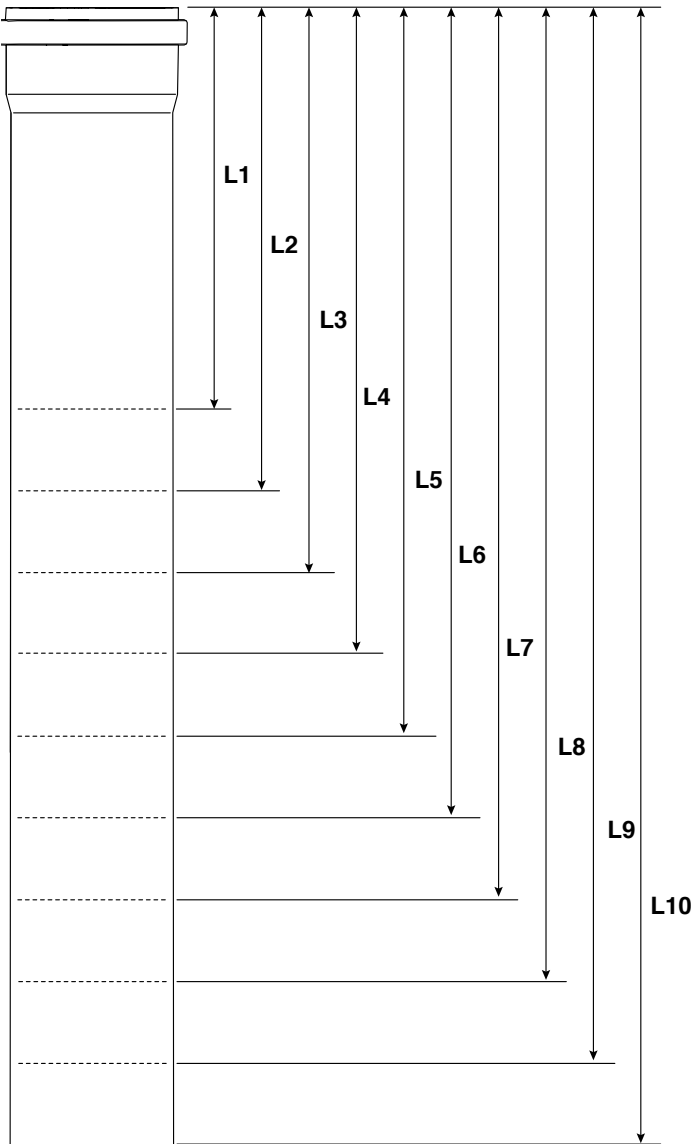


⚠ A DN80/DN110 adapter is required ONLY FOR POWER MAX 65 P and POWER MAX 80 P MODELS with flue gas outlet DN80. This adapter is to be installed on the flue outlet and subsequently the cutting lengths must be reduced by 60mm.

⚠ ONLY FOR POWER MAX 150 MODELS, no more than 8 modules.


⚠ ONLY FOR MODELS POWER MAX 50 P DEP and POWER MAX 50 P having a DN80 flue gas outlet, a DN80 / DN110 adapter is required to be installed on the flue gas outlet after mounting the DN80 clapper; this means that in this case the cutting lengths must be reduced by 60mm.

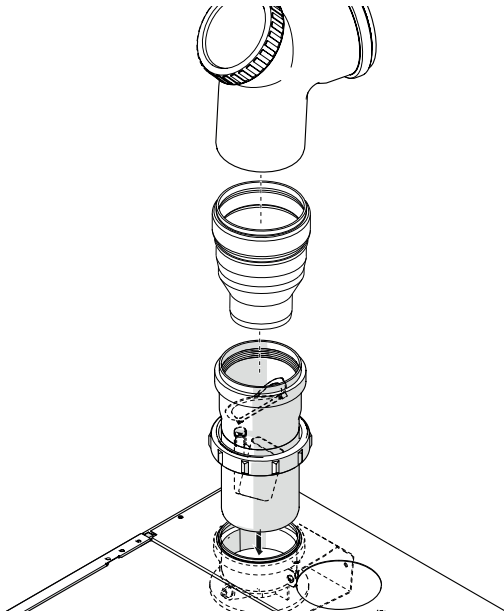

- 2 Pre-assemble the flue gas outlet duct on the ground. Moisten the seals with non-corrosive lubricant (water-based additive with polymers and silicone oil) and make sure that they can be adjusted during the final positioning operations.

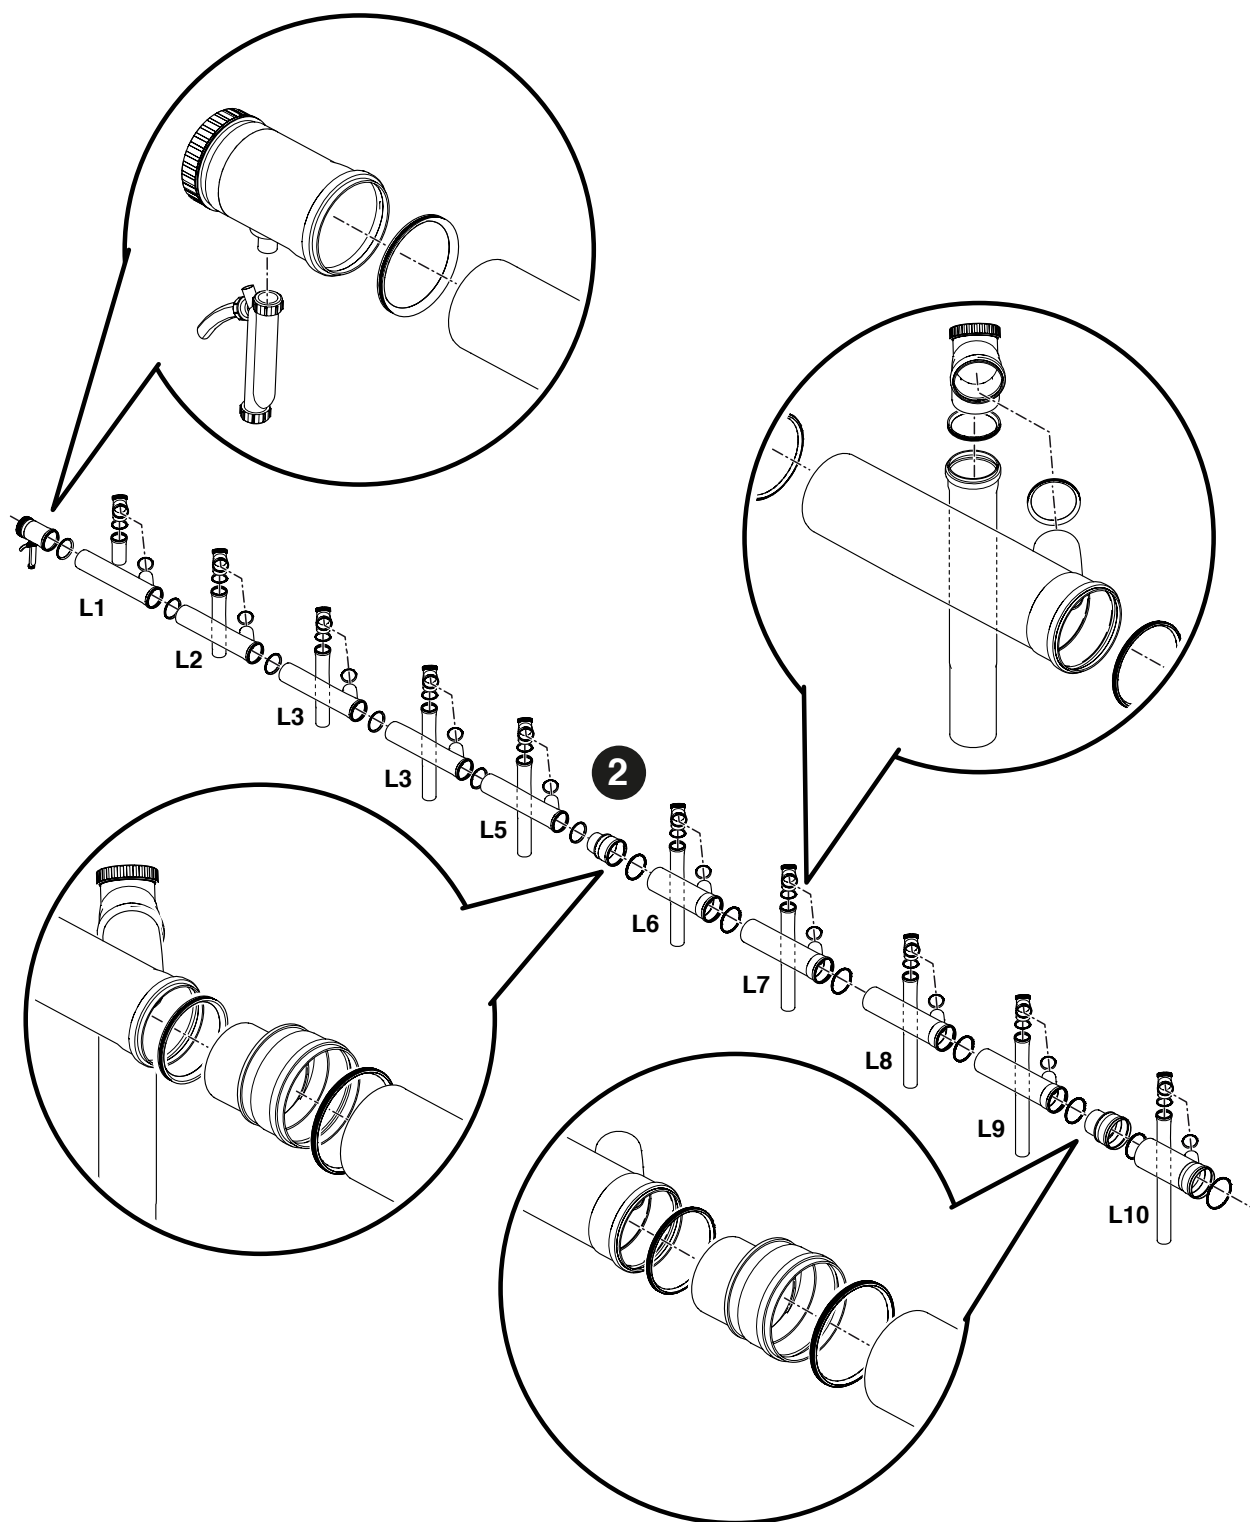

- 3 Position the flue gas outlet manifold above the thermal modules. Check that a slope of at least 3° towards the condensate outlet siphon is guaranteed.
- 4 Connect the siphon outlet to the condensate drainage system.

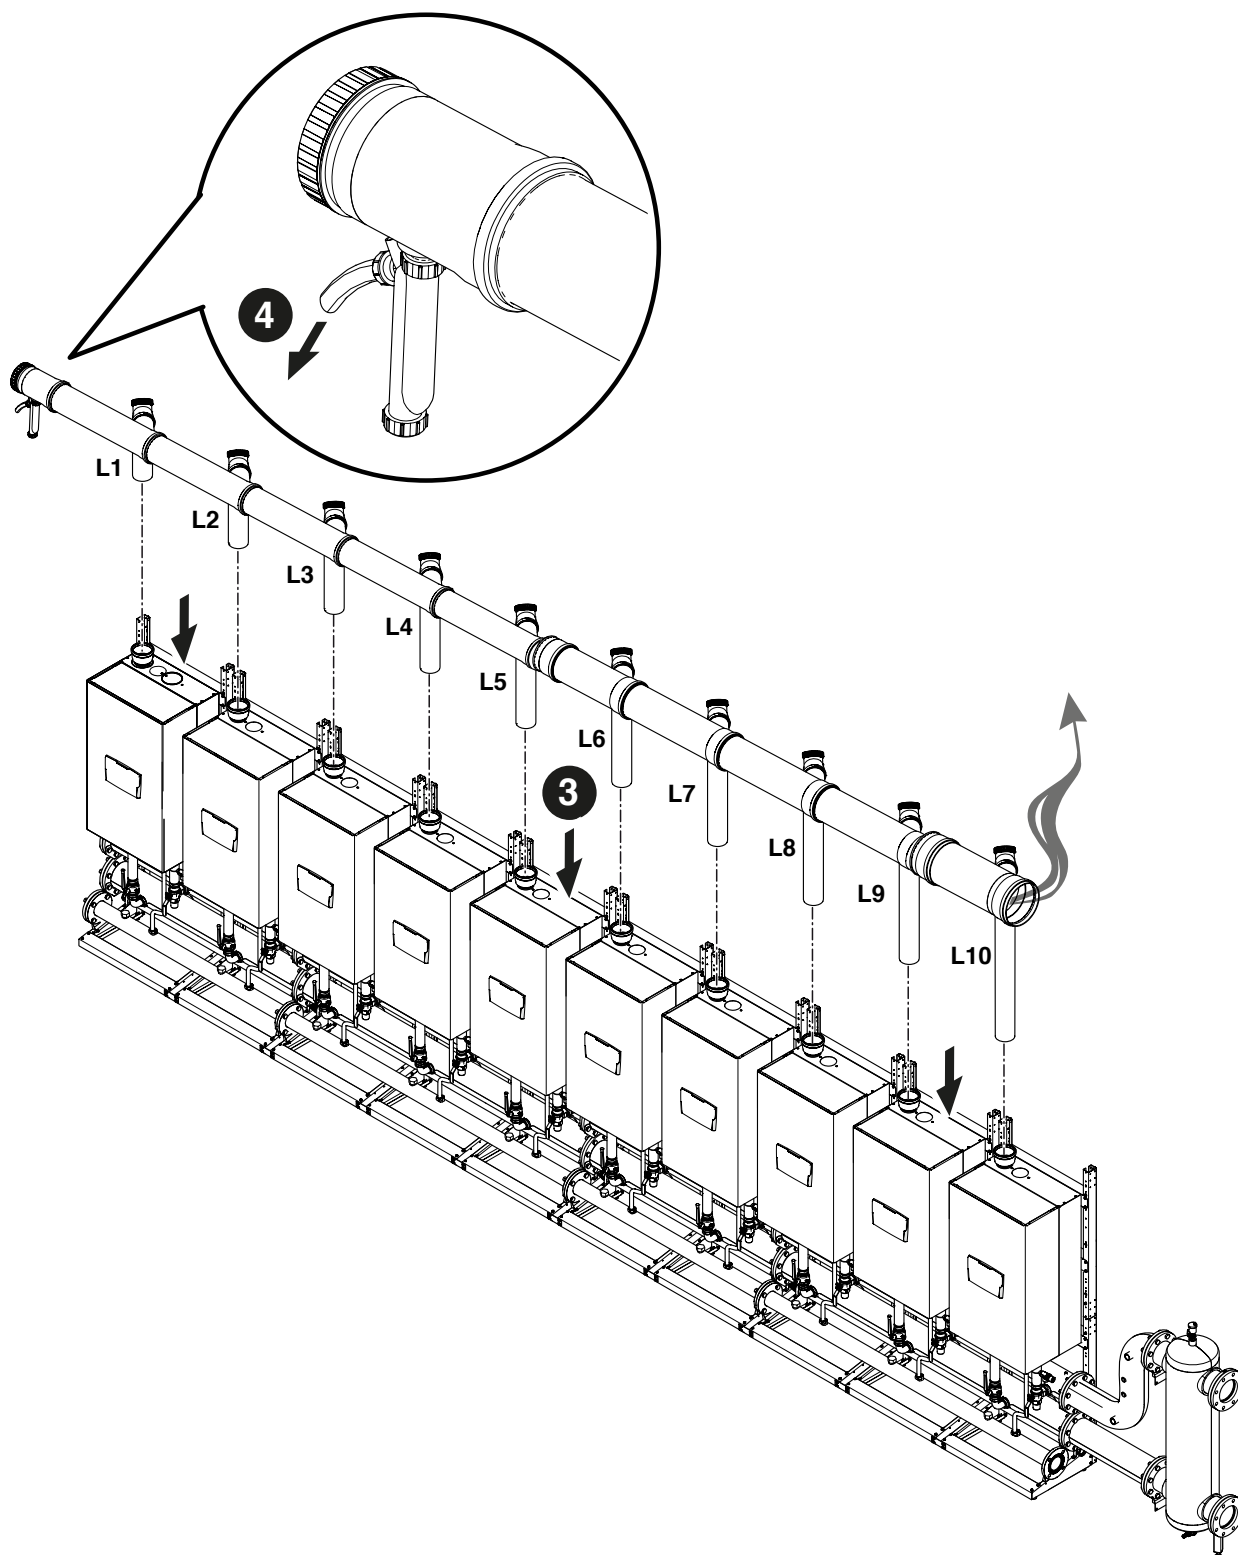


CASCADE CONFIGURATION B2B (BACK TO BACK)

Assembly of the FLUE SYSTEM DN 160 - DN 200 - DN 250. Components included in code 20131266 - cod. 20132381 - cod. 20131218



For model installations POWER MAX 50 P DEP and POWER MAX 50 P it is COMPULSORY to use the Clapet accessory DN80 cod. 20164632.

- 1 Carefully cut the bends following the measurements indicated. This allows the flue gas outlet duct to slope by at least 3°

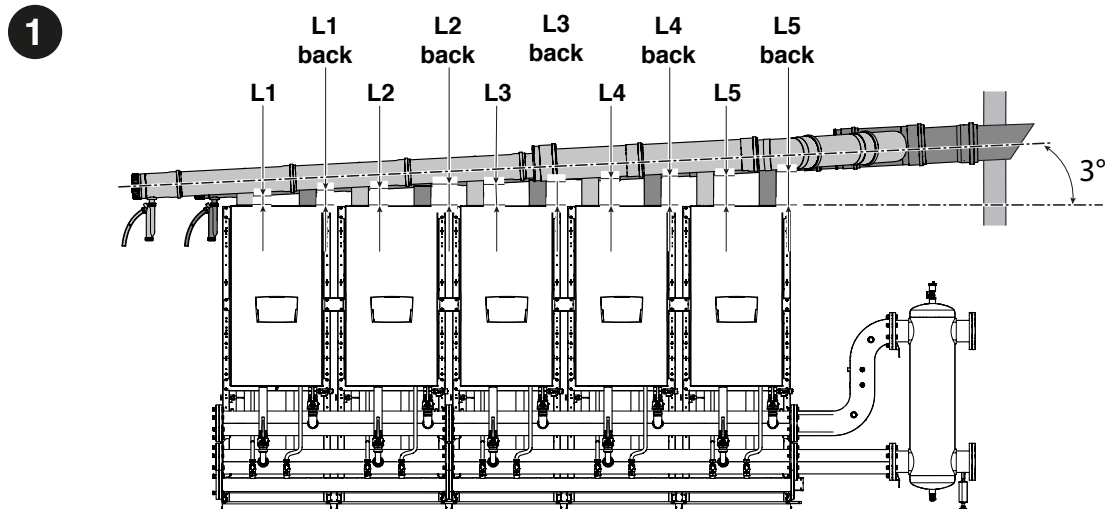

L1 L1 back	L2 L2 back	L3 L3 back	L4 L4 back	L5 L5 back	
172	197	236	275	315	mm





A DN80/DN110 adapter is required ONLY FOR POWER MAX 65 P and POWER MAX 80 P MODELS with flue gas outlet DN80. This adapter is to be installed on the flue outlet and subsequently the cutting lengths must be reduced by 60mm.



ONLY FOR POWER MAX 150 MODELS, no more than 8 modules.




ONLY FOR MODELS POWER MAX 50 P DEP and POWER MAX 50 P having a DN80 flue gas outlet, a DN80 / DN110 adapter is required to be installed on the flue gas outlet after mounting the DN80 clapper; this means that in this case the cutting lengths must be reduced by 60mm.

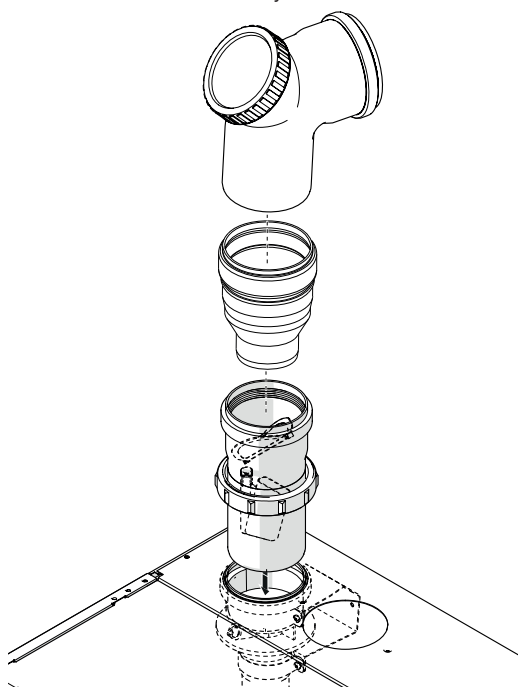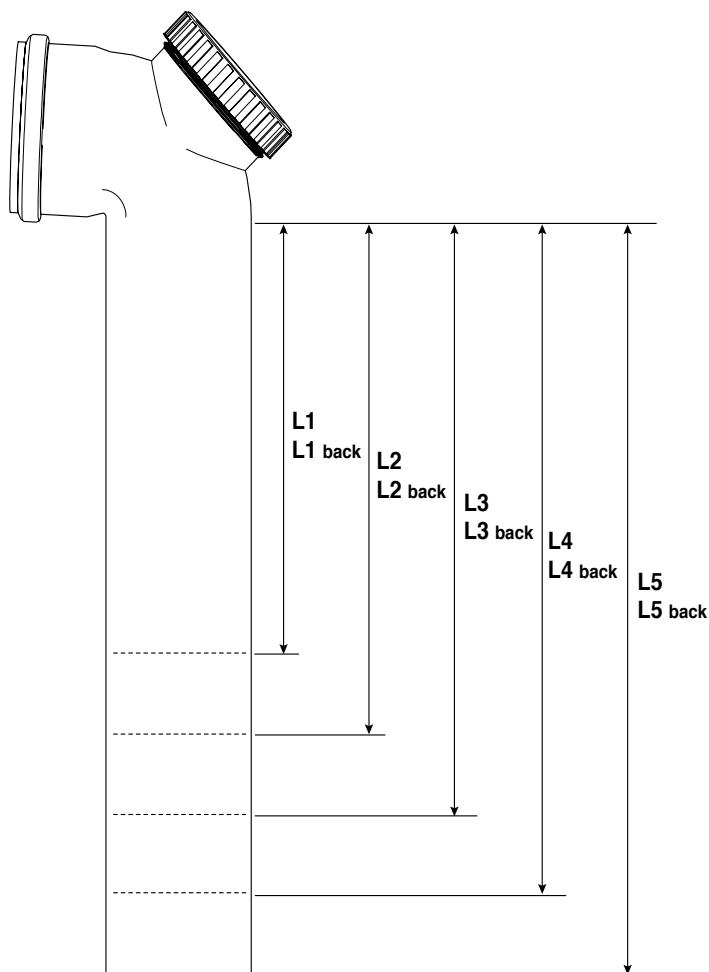


50

- 2 Pre-assemble the flue gas outlet duct on the ground. Moisten the seals with non-corrosive lubricant (water-based additive with polymers and silicone oil) and make sure that they can be adjusted during the final positioning operations.

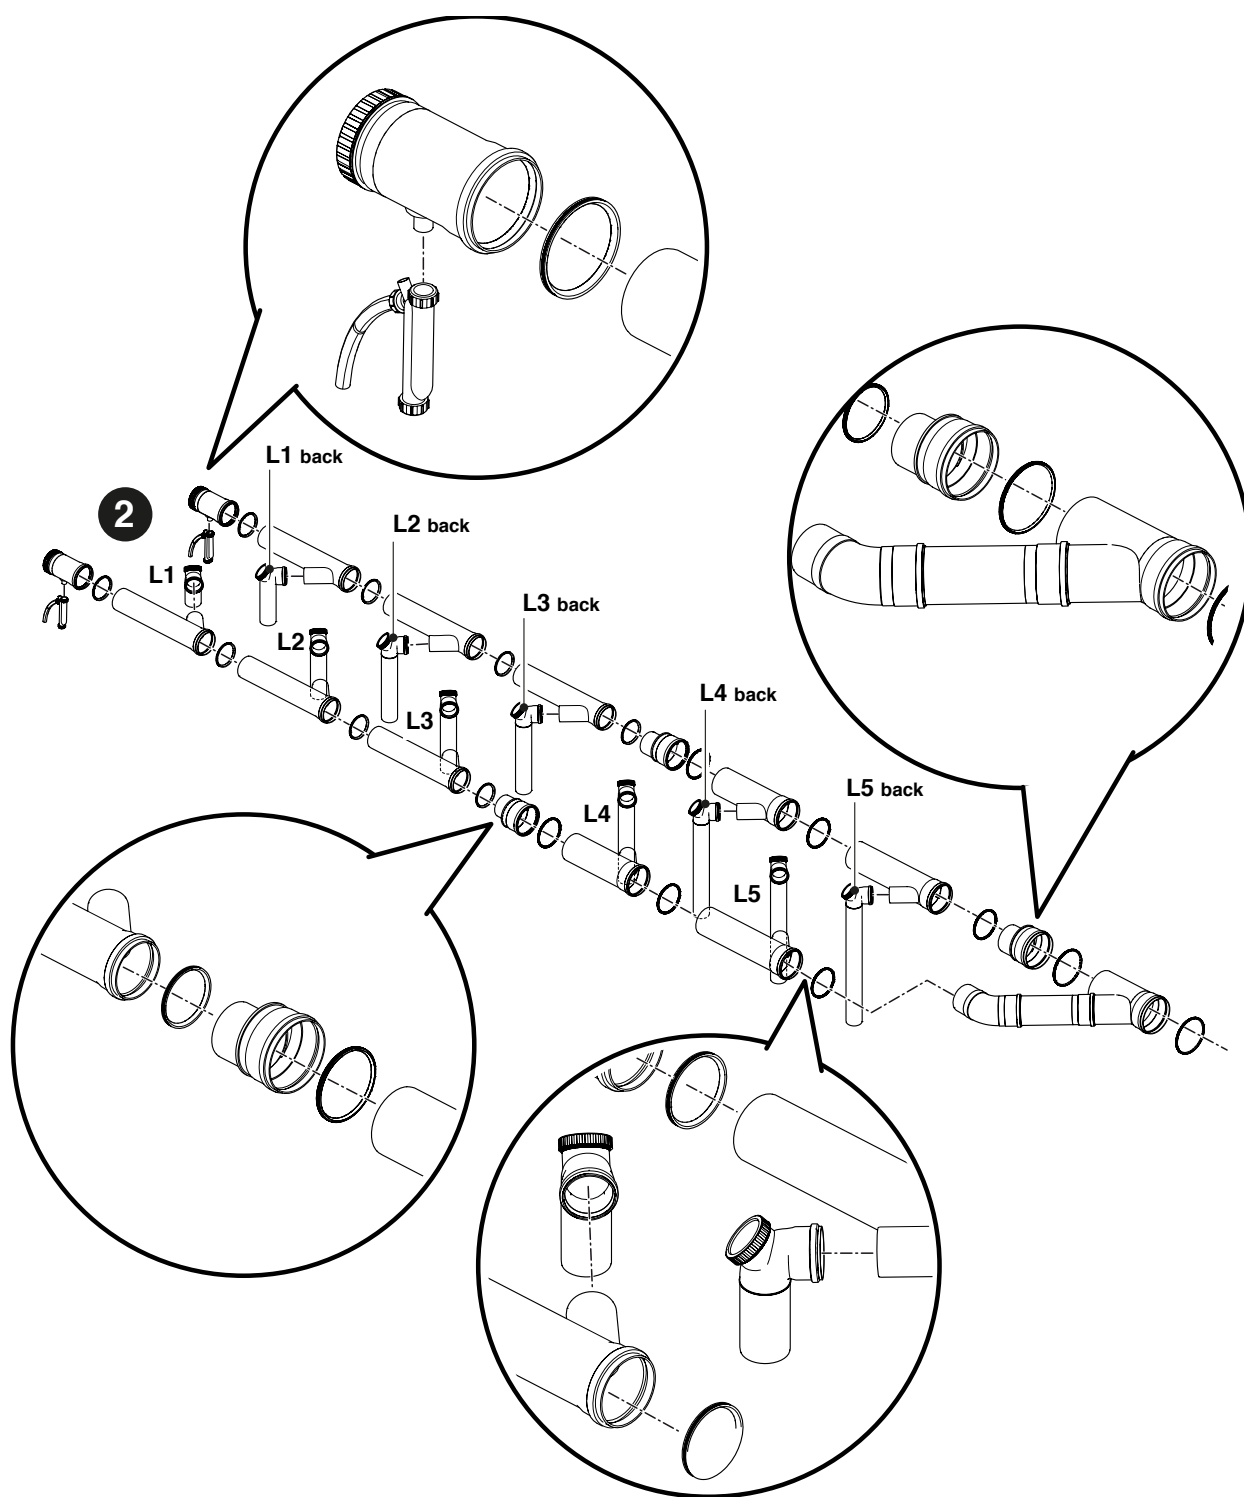

- 3 Position the flue gas outlet manifold above the thermal modules. Check that a slope of at least 3° towards the condensate outlet siphon is guaranteed.
- 4 Connect the siphon outlet to the condensate drainage system.

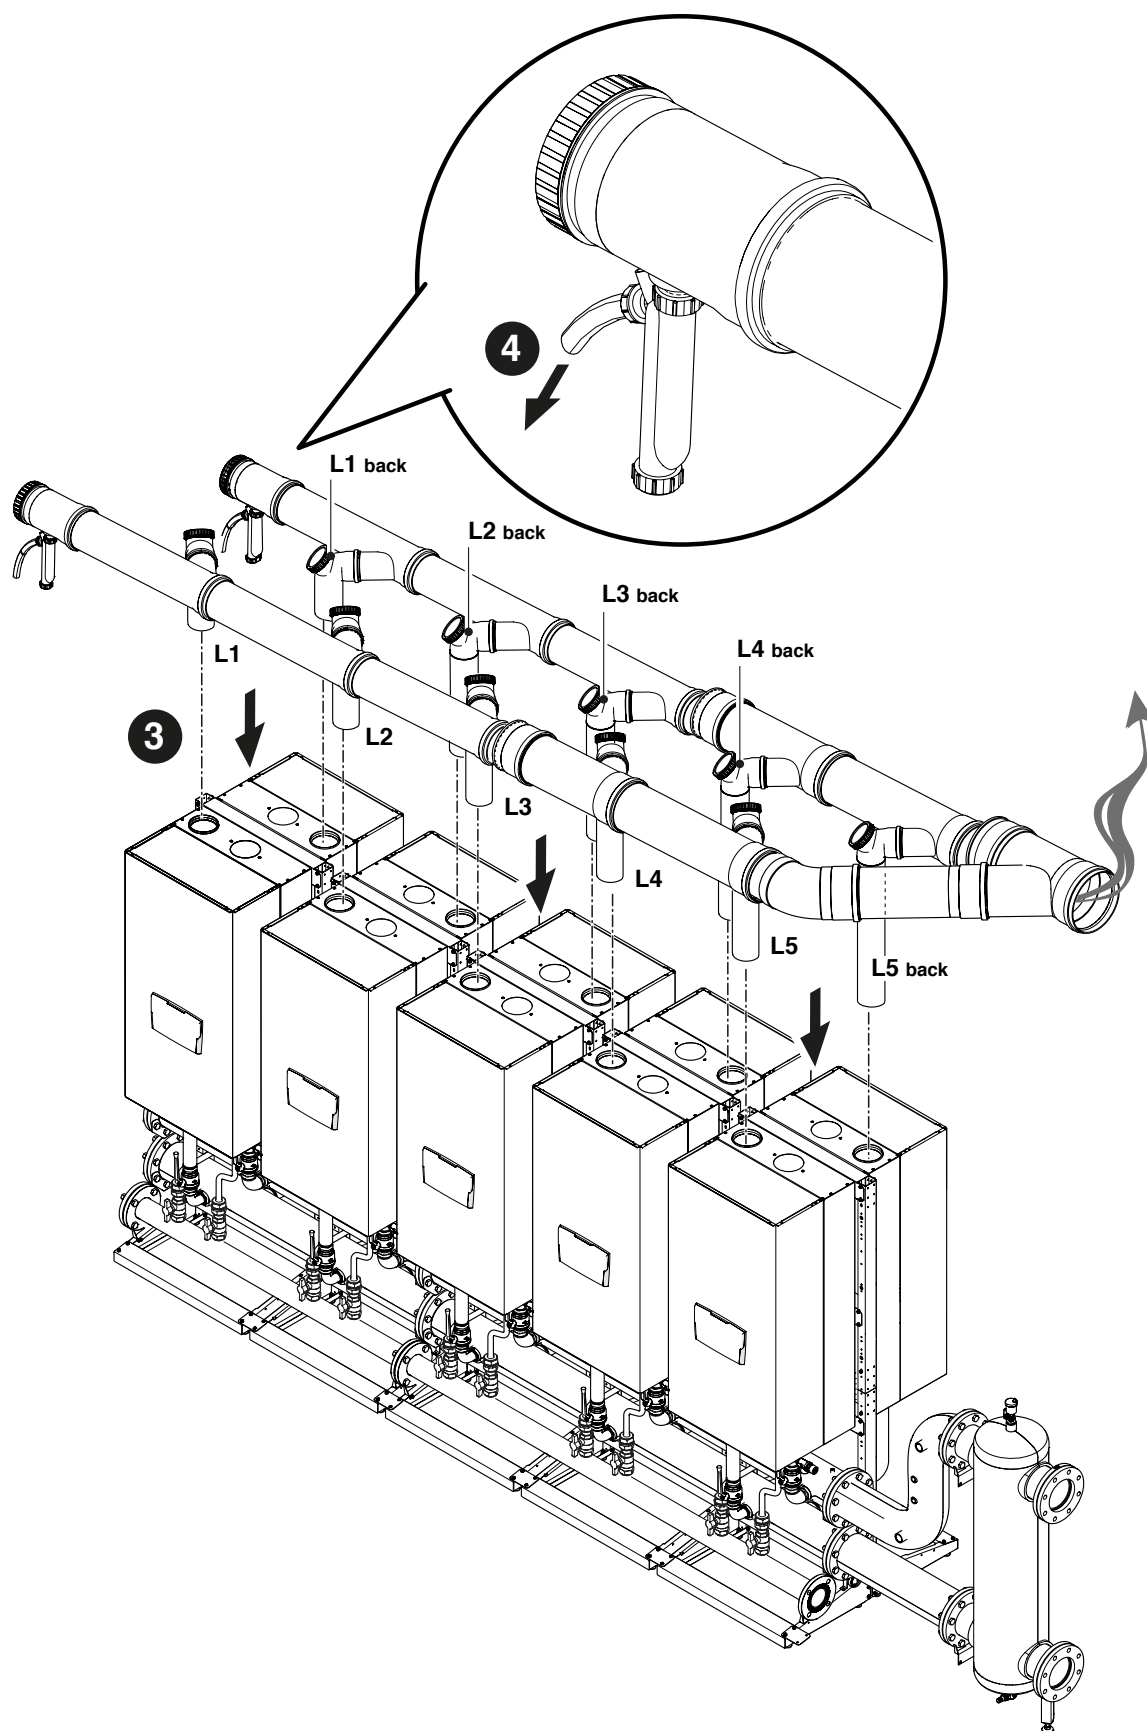


- 5 Complete the flue gas outlet pipe sizing it appropriately and taking into consideration the data in the table indicated below.

	Number of modules	DN flue gas manifold	Maximum length expressed in meters
POWER MAX 50 P	2	160	30
	3	160	30
	4	160	30
	5	160	30
	6	160	30
	7	160	30
	8	160	30
	9	200	30
POWER MAX 80 P	10	200	30
	2	160	30
	3	160	30
	4	160	30
	5	160	30
	6	160	30
	7	200	30
	8	200	30
POWER MAX 110	9	200	30
	10	200	30
	2	160	30
	3	160	30
	4	160	30
	5	200	30
	6	200	30
	7	200	30
POWER MAX 130	8	250	30
	9	250	30
	10	250	30
	2	160	30
	3	160	30
	4	160	30
	5	200	30
	6	200	30
POWER MAX 150	7	250	30
	8	250	30
	9	250	30
	10	250	30
	2	160	30
	3	160	30
	4	200	30
	5	200	30
	6	250	30
	7	250	30
	8	250	30

2.10 Neutralization of the condensate

To correctly eliminate the combustion condensate, check if the condensate needs to be neutralized using a designated accessory.

- For systems with a nominal heat input greater than 200 kW, the condensate always needs to be neutralized
- For systems with a nominal heat input greater than 35 kW but less than 200 kW, the selection and evaluation criteria is provided in the figure below

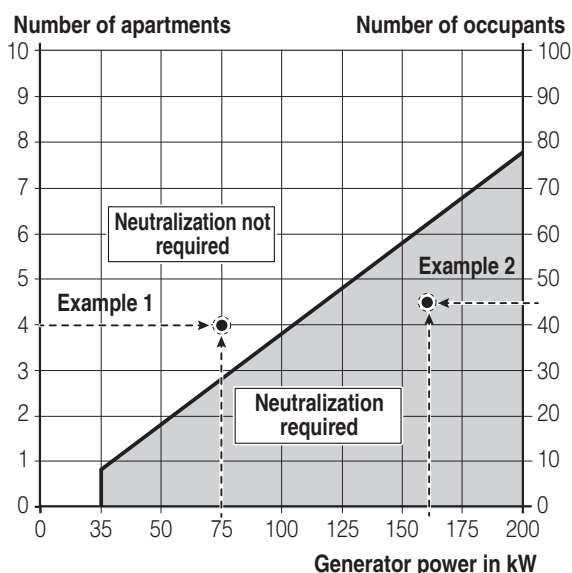

Example 1

For a residential building with 4 apartments, a 75 kW condensing boiler needs to be installed. The 4 apartments / 75 kW intersection point is within the range "neutralization not required", therefore the condensate does not need to be neutralized.

Example 2

For an office block with 45 users, a 160 kW condensing boiler needs to be installed. The 45 users / 160 kW intersection point is within the range "neutralization required", therefore the condensate needs to be neutralized.

In the case of residential applications, reference must be made to the number of apartments served by the system, while in the case of non-residential applications, reference must be made to the number of users.

In the case of mixed applications, the number of apartments must be converted into equivalent users, or conversely, according to the alignment of the two vertical axes, therefore refer only to one axis (for example, 2 apartments equate to 20 users).



The condensate drainage system must be sized and installed to ensure correct elimination of the effluents produced by the appliance and/or by the evacuation system of the combustion products in any and all operating conditions.

3 CONFIGURATION OF THE MAIN BLOCK DIAGRAMS

⚠ The DHW and heating circuits must be completed with expansion vessels of a suitable capacity and correctly sized relief valves. The discharge of the relief valves and the appliances must be connected to an evacuation and collection system (see paragraph Neutralization of the condensate).


⚠ The installer is responsible for selecting and installing the system components and must work in full compliance with correct technical regulations and legislation in force.

⚠ Special supply/refill water must be conditioned using suitable treatment systems.

⚠ For the electrical connections, use H05-VV-F power cables with a minimum cross-section of 1.5 mm², complete with terminal ferrules. For the low voltage connections, use H05-VV-F power cables with a minimum cross-section of between 0.5 and 1 mm², complete with terminal ferrules.

⚠ For the connection of the devices connected to the jig (pumps, circulators and diverting / mixing valves) use interposed relays unless the maximum absorption of all components connected to the board (including the module circulator) is less than or equal to 1.5 A. Relays sizing lays on the installer depending on the type of connected device.

⊖ It is prohibited to operate the thermal module without water.

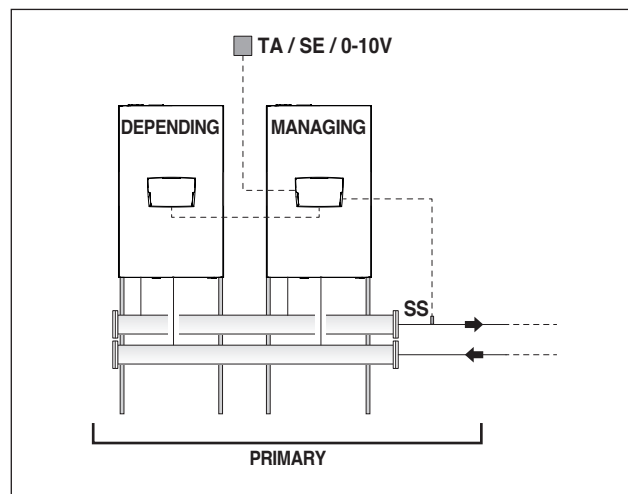

Operation of the primary system can be:

- Mode 0 - With fixed setpoint.
This configuration requires the connection of an ambient thermostat or heat request contact (TA).
- Mode 1 - In climatic mode with variable setpoint based on the outdoor temperature.
This configuration requires the connection of an ambient thermostat or heat request contact (TA) and an external sensor (SE), available as an accessory.
- Mode 2 - In climatic mode with intensity controlled by the ambient thermostat/heat request signal and variable setpoint based on the outdoor temperature.
This configuration requires the connection of an ambient thermostat or heat request contact (TA) and an external sensor (SE), available as an accessory.
- Mode 3 - With fixed setpoint with intensity controlled by the ambient thermostat/heat request signal.
This configuration requires the connection of an ambient thermostat or heat request contact (TA).
- Mode 4 - With delivery setpoint adjustment on the basis of the analogue input 0-10V.
This configuration requires an external device (for example, PLC of the central heating plant) able to generate this signal connected to the analogue input 0-10 V.

The functions described can be set using the parameterization carried out on the "Managing" thermal module. This is described in the manual of the individual thermal modules in the paragraph "Setting the heating system".

The electrical and hydraulic connections of the primary system are to be completed selecting from:

- Use of the thermal module circulator (as standard in POWER MAX 50 P DEP ÷ POWER MAX 80 P and available as an accessory for POWER MAX 100 ÷ POWER MAX 150 models).
- Use of the system circulator (PS) and two-way valves (V1) for each thermal module (these devices are available as accessories).

3.1 Configuration of the primary system



The basic cascade configuration consists of at least two thermal modules, One is assigned "Managing" role and the others are assigned the "Depending" role.

The cascade of thermal modules can be seen as the primary system of a generation system. This configuration could be ideal for replacing one or more larger generators in an existing system if system reliability and efficiency is to be increased.

In order for cascade operation to be possible, the "Managing" thermal module must be connected to the primary sensor (SS) at least, available as an accessory.

The primary sensor is required in order to manage the cascade setpoint and is essential for managing the thermal modules as a single generator.

Optimal use of the modules in cascade occurs by placing a hydraulic separator (available as an accessory) between the primary system (thermal modules in cascade for thermal generation) and the secondary system (users, such as heat distribution systems, DHW production). This device allows a different flow rate to be compensated between the primary and secondary systems.

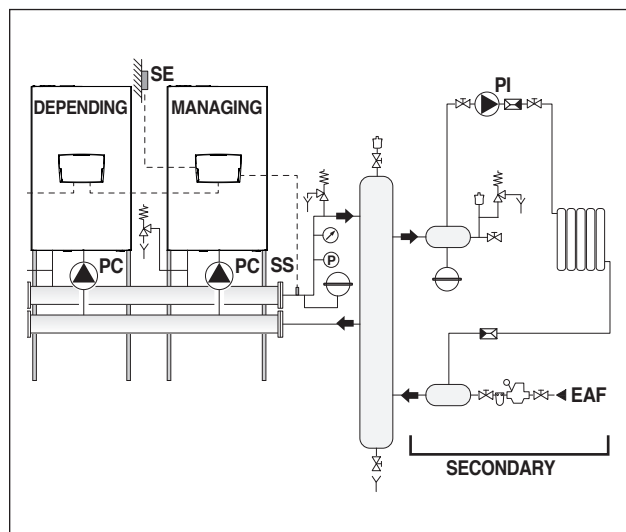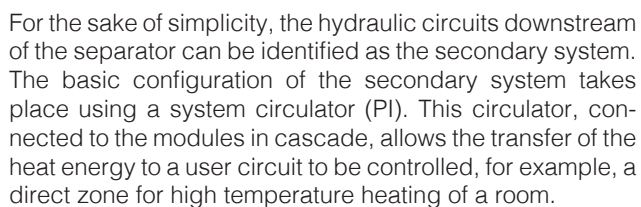

- Secondary sensor (SC)


This is required in order to manage the setpoint, and therefore the required temperature, downstream of the hydraulic separator.

The secondary sensor is connected to the controller of the first "Depending" module.

- Hot water tank sensor (SB)

This is required in order to manage the production of DHW in combination with a hot water tank circulator (PB).

The hot water tank sensor is connected to the controller of the "Managing" module.

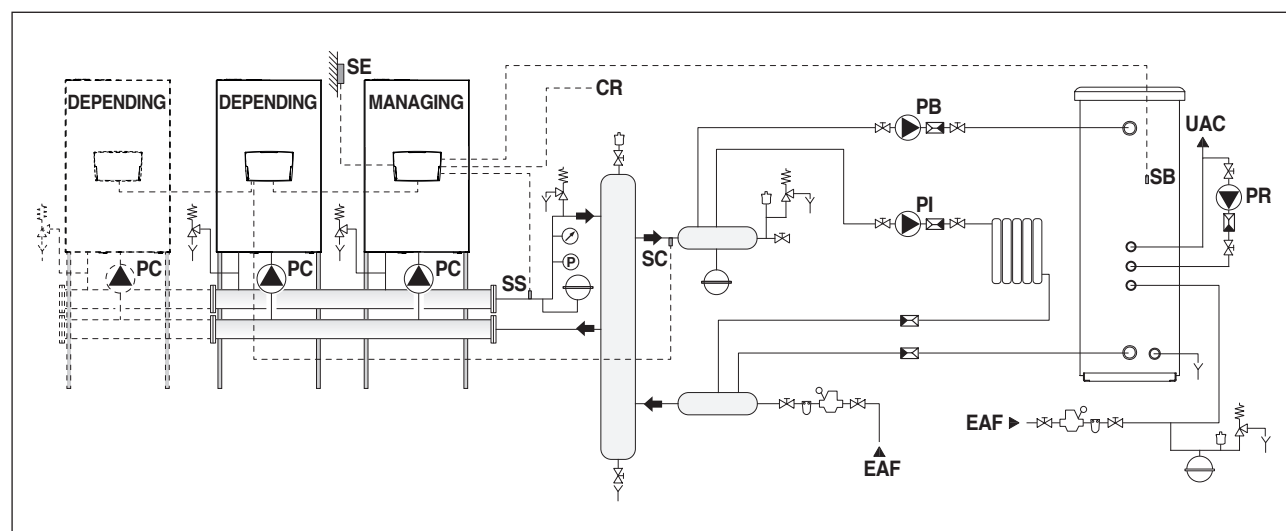


- Zone sensor (S2)

This is required to adjust and control an additional direct zone managed by the "Depending" thermal module in combination with the zone circulator (P2).

The zone sensor is used to adjust and control an additional mixed zone in combination with the zone circulator (P2) and the mixer valve (V2).

The zone sensor (S2), circulator (P2) and the mixer valve (if present) (V2) must be connected to the "Depending" thermal module, which communicates via bus with the "Managing" thermal module.

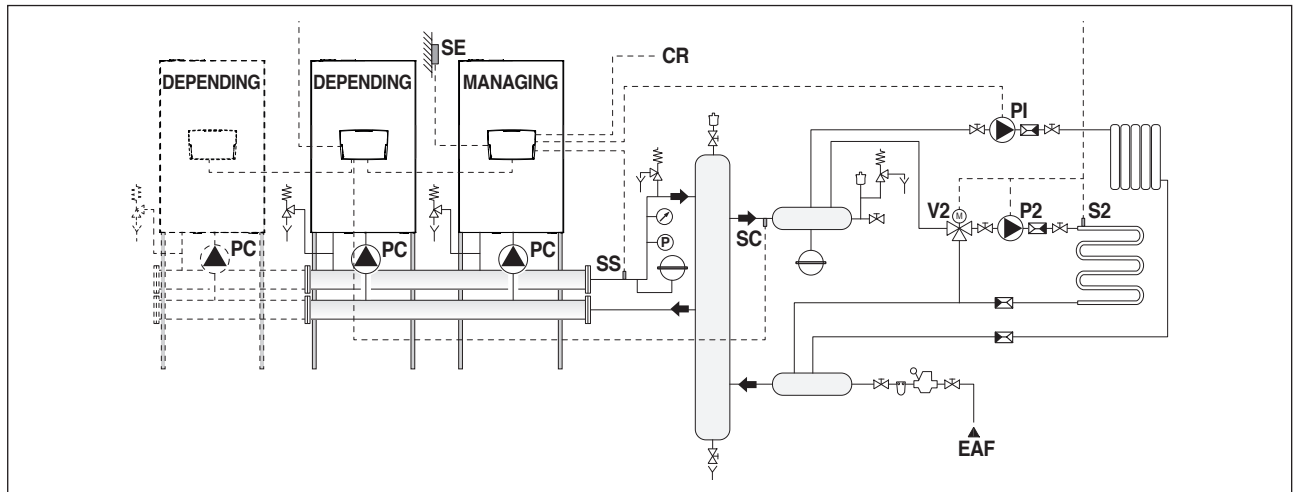

- Zone sensor (S3)


This is required to adjust and control an additional direct zone in combination with an electronic device for zone management (ZM) and the zone circulator (P3).

The zone sensor is used to adjust and control an additional mixed direct zone in combination with an electronic device for zone management (ZM), the zone (P3) circulator and the mixer valve (V3).

The zone sensor (S3), the circulator (P3) and the mixer valve (if present) (V3) must be connected to the electronic device for zone management (ZM), which communicates via Bus with the "Managing" thermal module.


To make the electrical connections, refer to the wiring diagrams of the selected system.

For the Bus connection mode, refer to the section "System management".

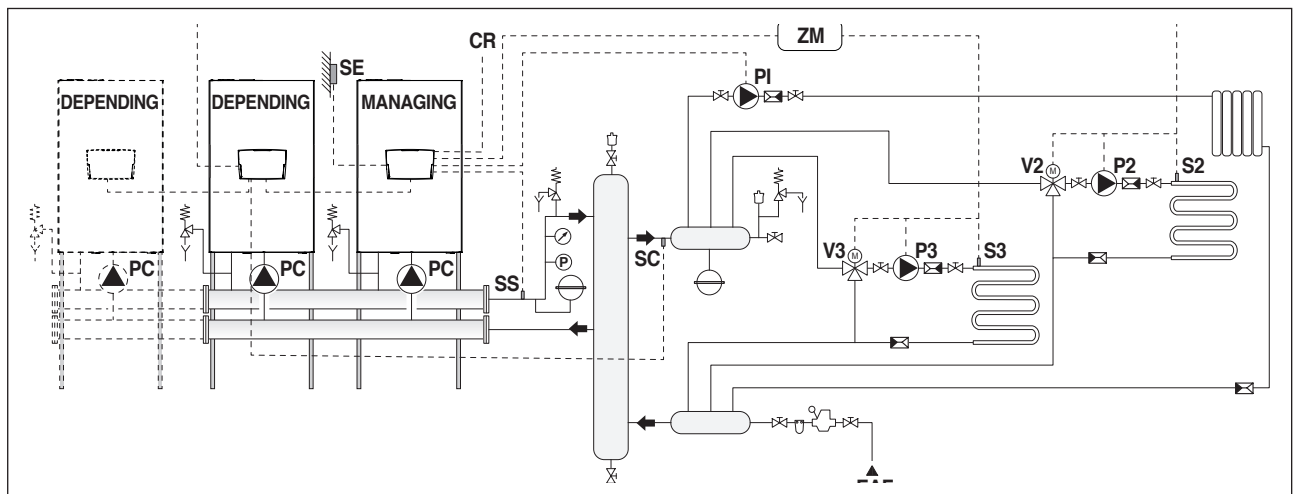


3.3 Block diagram 1

Circuit with thermal modules with their own circulator, connected in cascade.

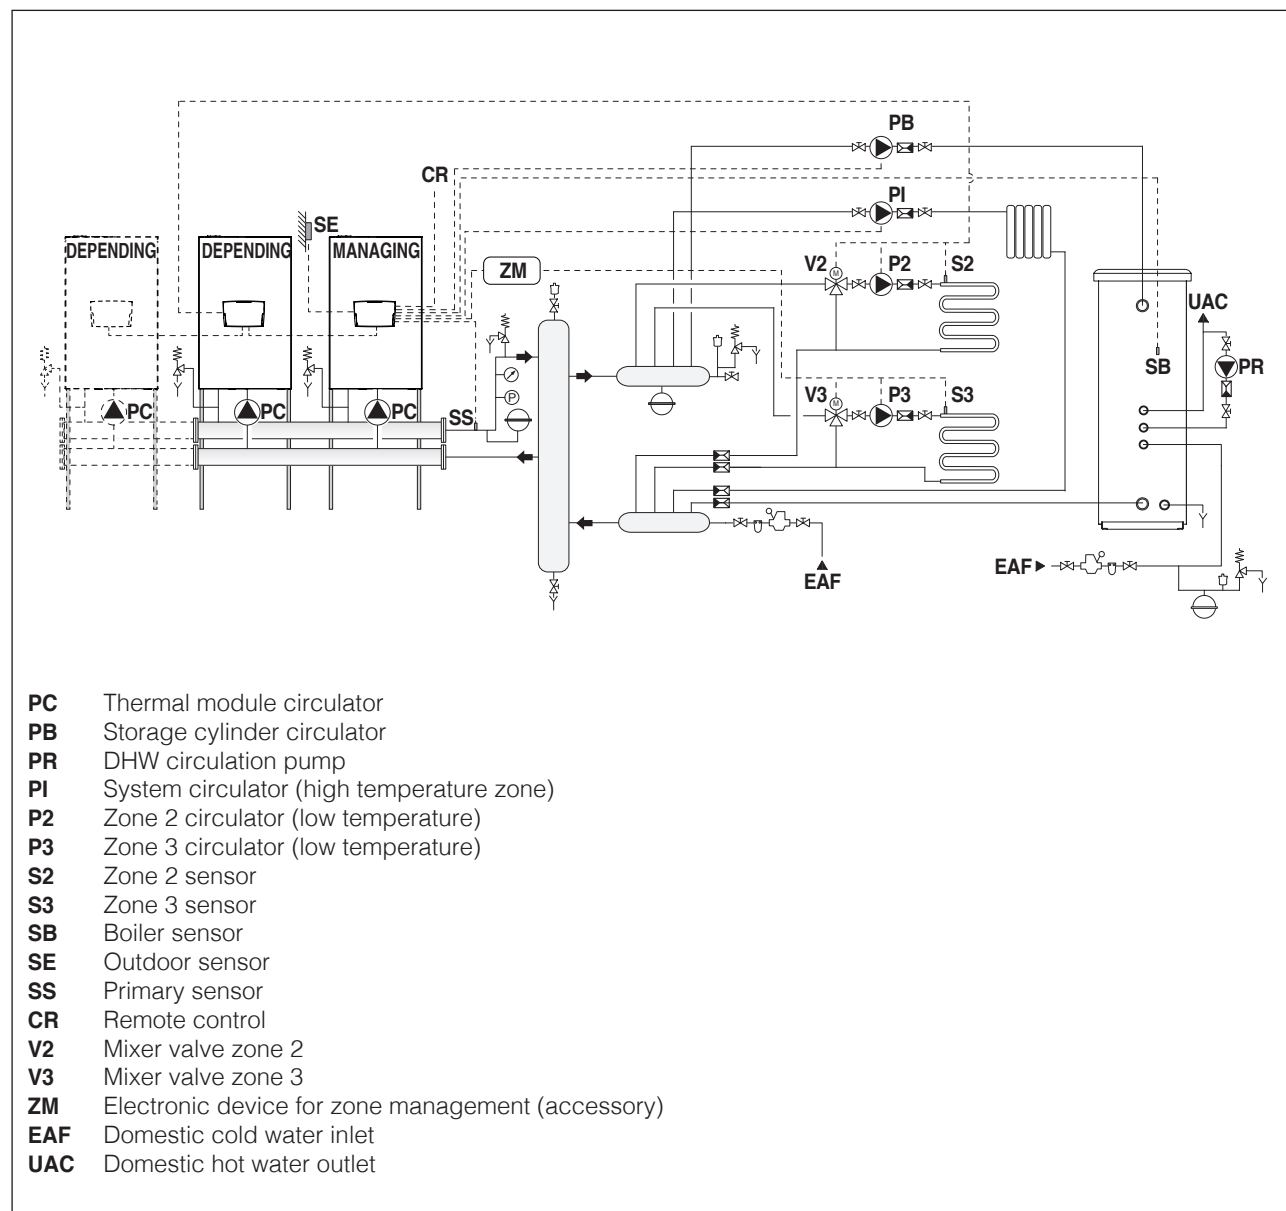


3.3.1 Electrical power connections Block diagram 1


MANAGING CONNECTIONS

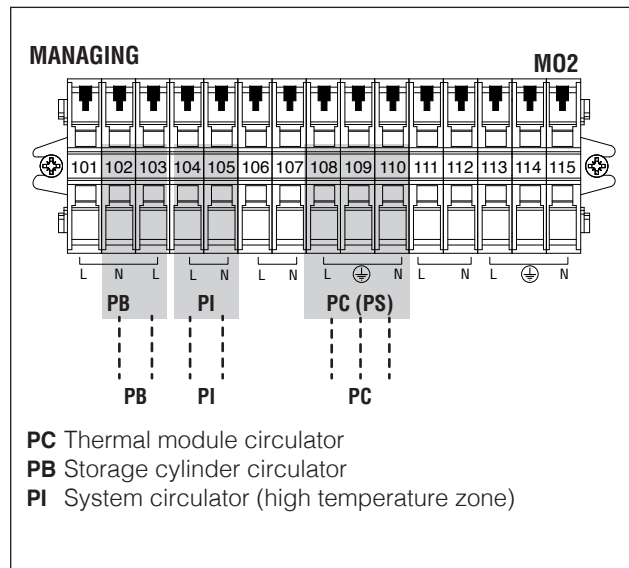

DEPENDING CONNECTIONS

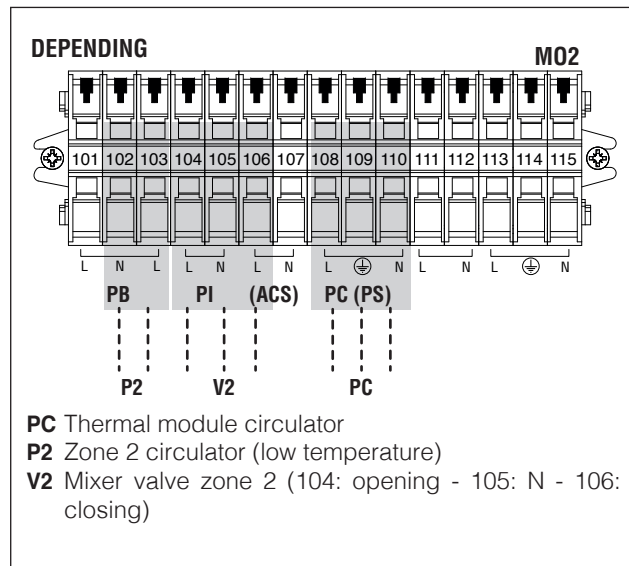


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

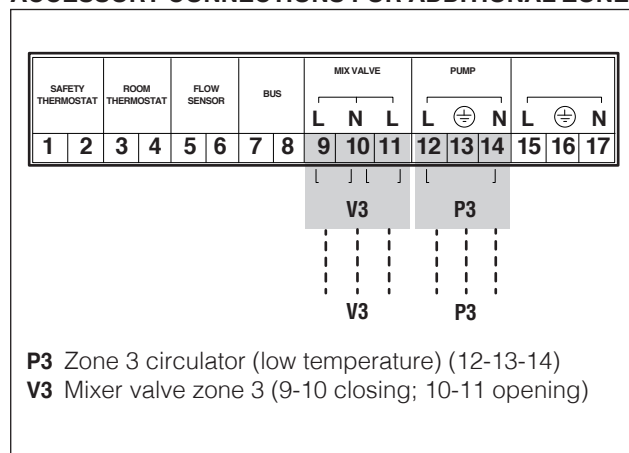


3.3.2 Sensor connections Block diagram 1


MANAGING CONNECTIONS

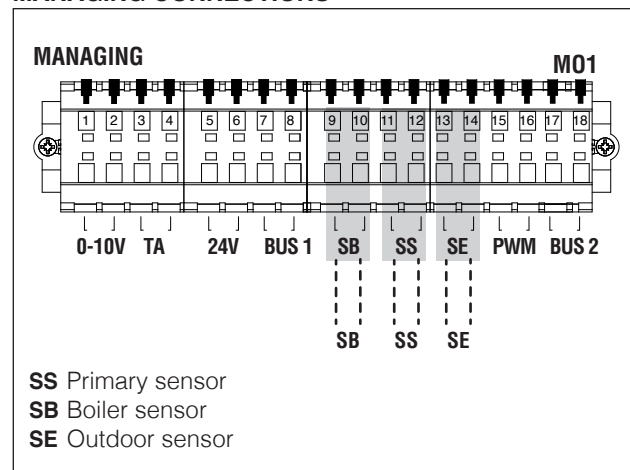

DEPENDING CONNECTIONS

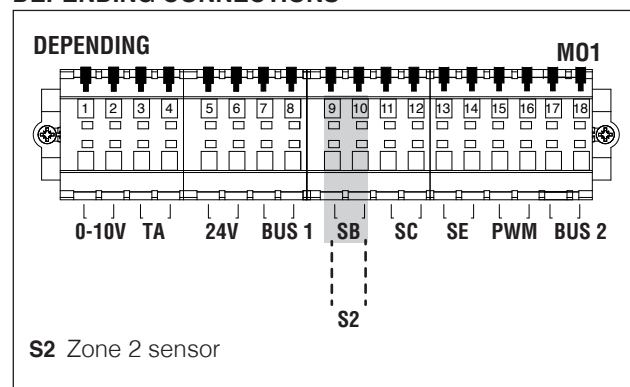


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

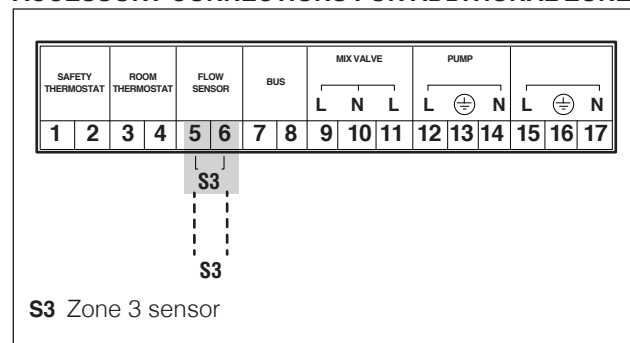


3.3.3 Bus connections Block diagram 1

See the section "System management" for a detailed description of the connections between the modules.


MANAGING CONNECTIONS

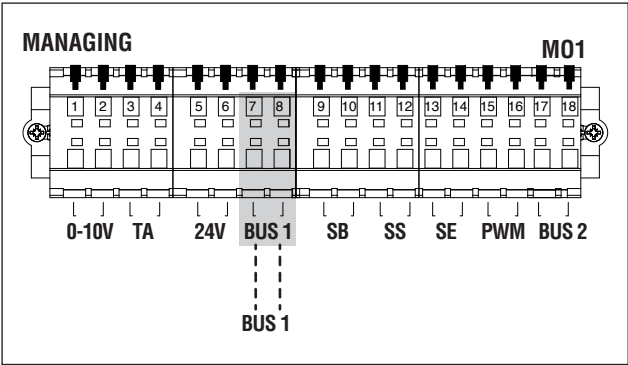

DEPENDING CONNECTIONS

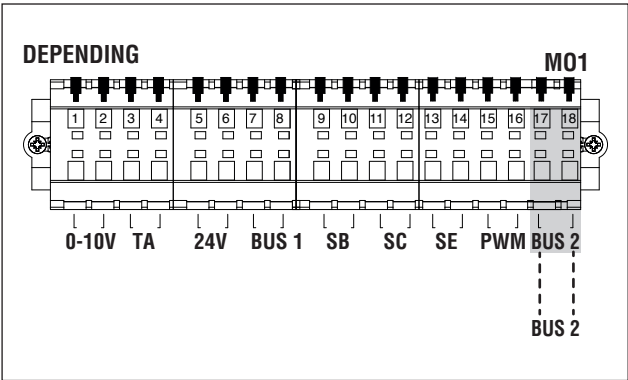


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

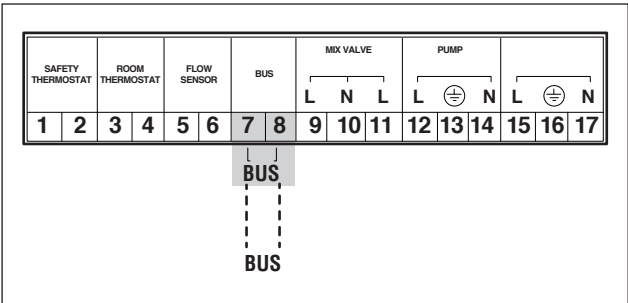

3.4 System parameters Block diagram 1

See section "Commissioning and maintenance" for a detailed description of how the parameters work

Setting switch S1=OFF

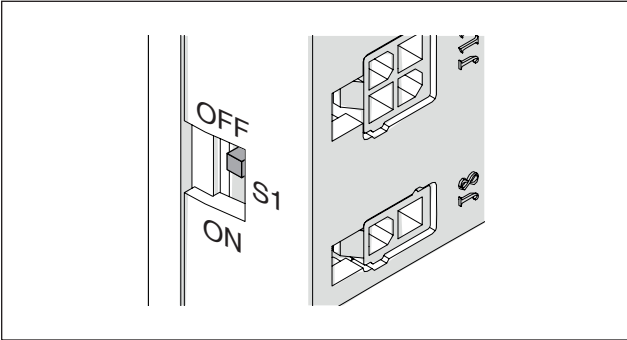

Essential parameters to be configured for the block diagram 1:

	Managing	Depending
S1	OFF	OFF
Dip-switch	1 to ON	2-10 to ON
Par.5073	Stand-alone	Dependent
Par.4147	no. of depending modules installed	/
Par.2007	greater than/equal to 10°C	greater than/equal to 10°C
Par.9097	1	1 (*)


(*) Par.9097 = 9 (Zone control with Depending module)
Par.9097 = 49 (Zone control with Depending module)
for models POWER MAX 50 P DEP - POWER MAX 50 P.

Specific parameters to be configured for the block diagram 1:

	Managing	Depending
Par.4079	adjust according to requirements	/
Par.4080	adjust according to requirements	/
Par.4081	adjust according to requirements	/
Par.4086	adjust according to requirements	/
Par.4087	adjust according to requirements	/


3.5 Block diagram 2

Circuit with thermal modules with their own circulator, connected in cascade. Using the secondary sensor.

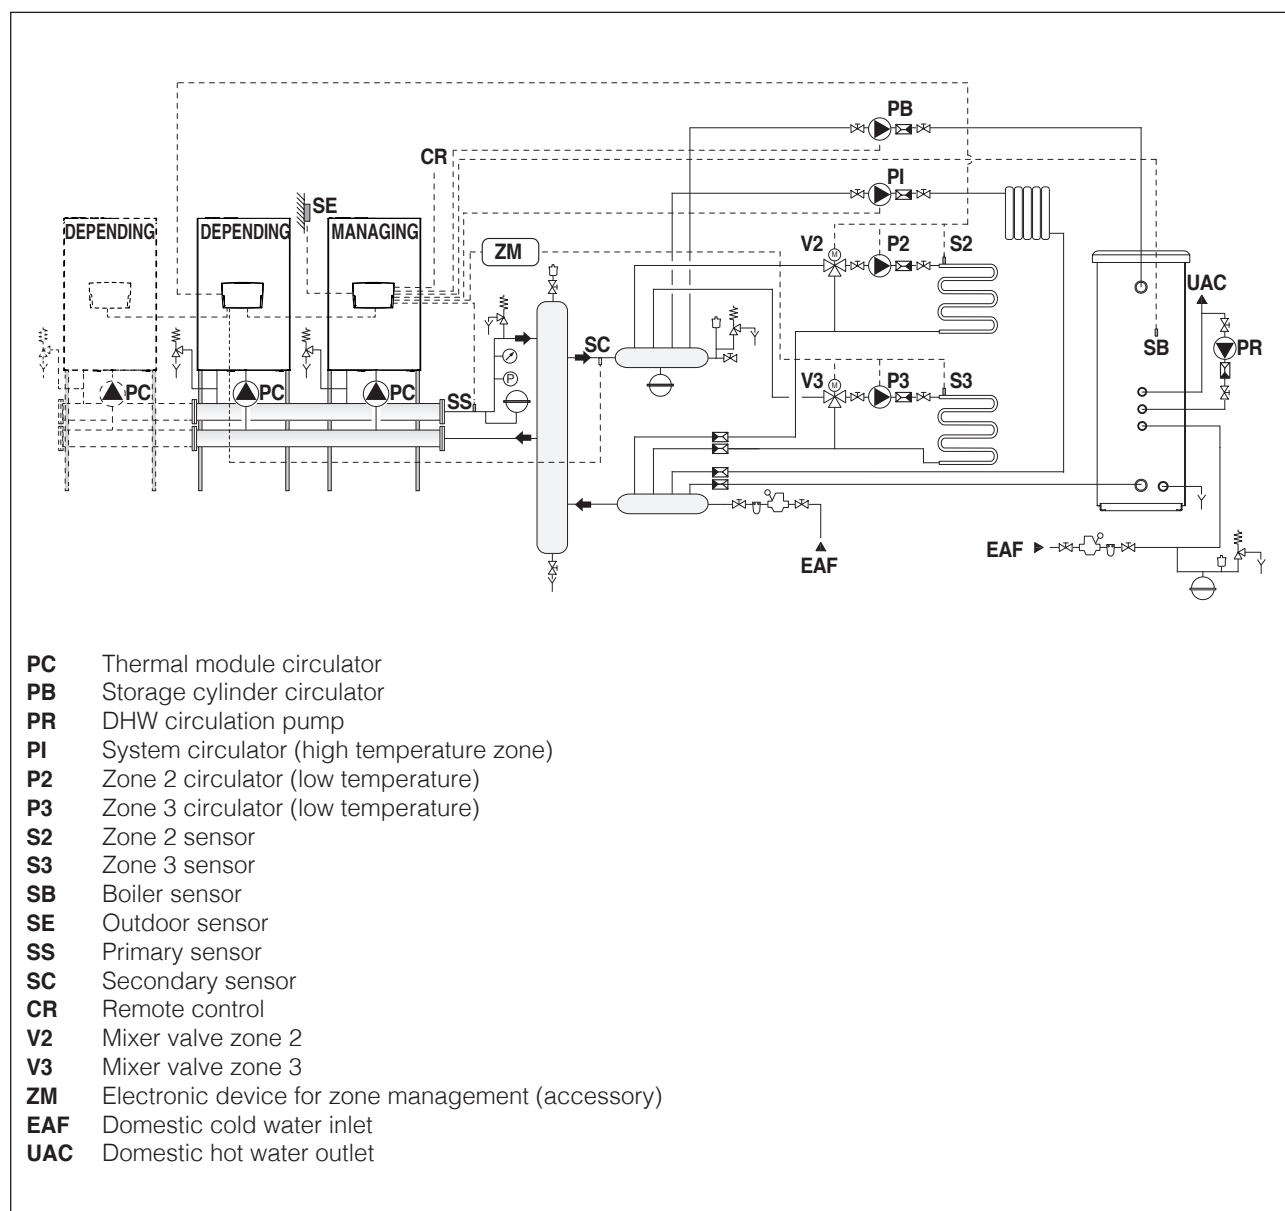


3.5.1 Electrical power connections Block diagram 2


MANAGING CONNECTIONS

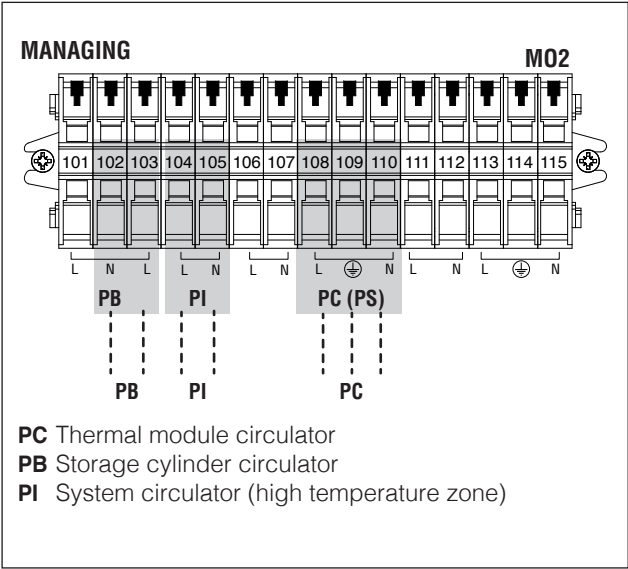

DEPENDING CONNECTIONS

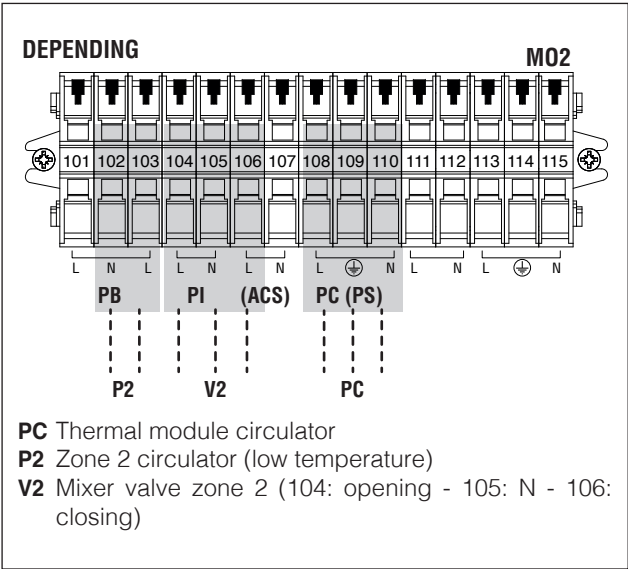


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

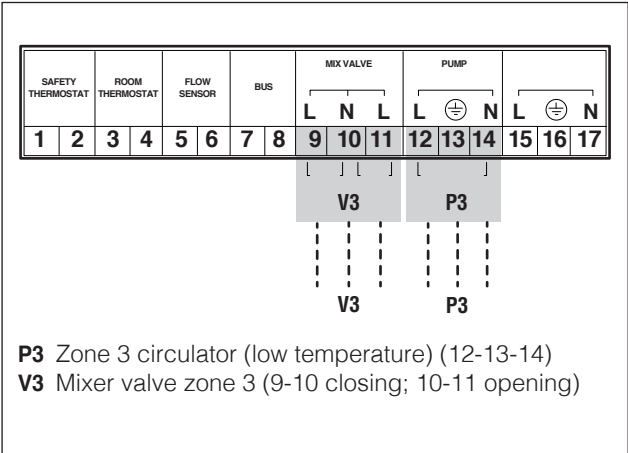


3.5.2 Sensor connections Block diagram 2

MANAGING CONNECTIONS

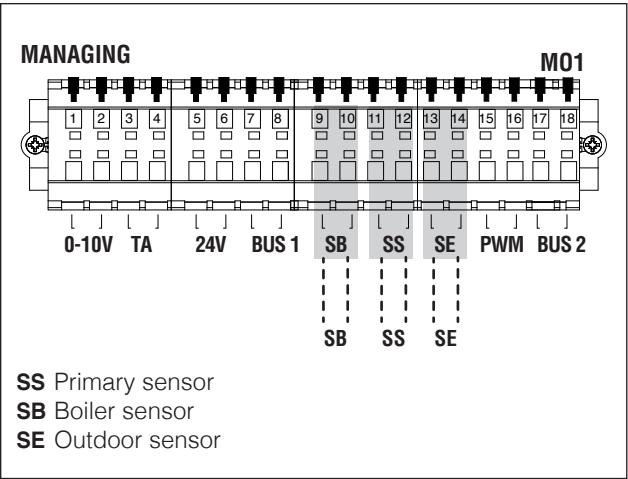


DEPENDING CONNECTIONS

⚠ Connections to be made on the first depending module only.

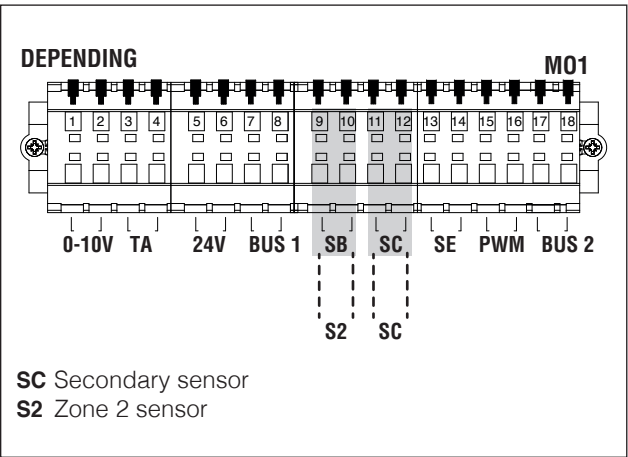


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

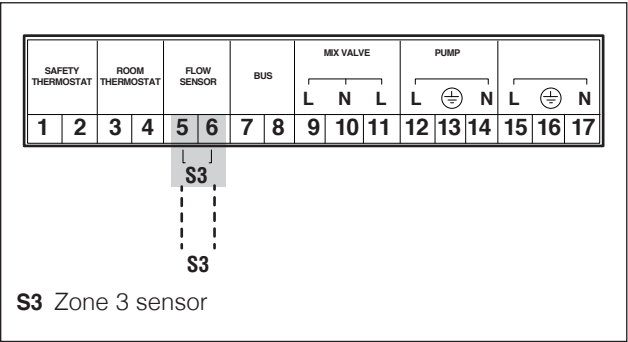


3.5.3 Bus connections Block diagram 2

See the section "System management" for a detailed description of the connections between the modules.


MANAGING CONNECTIONS

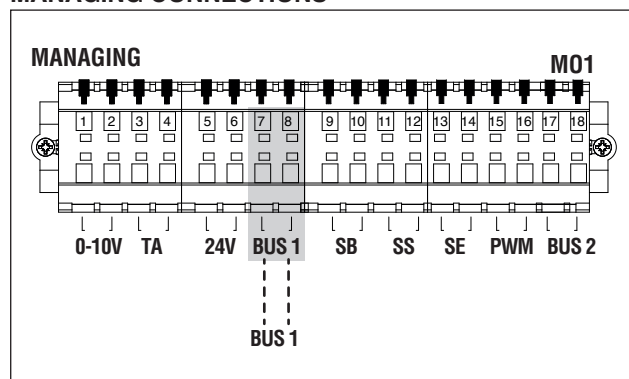

DEPENDING CONNECTIONS

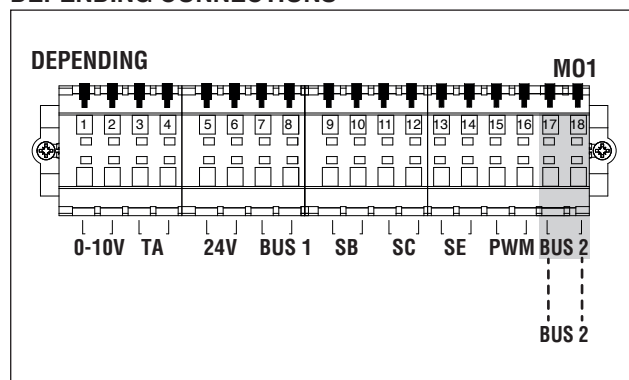

ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

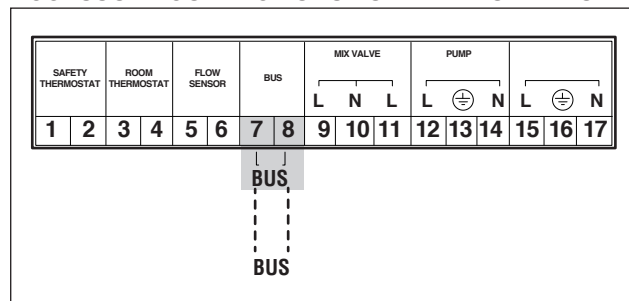


3.6 System parameters Block diagram 2



See section "Commissioning and maintenance" for a detailed description of how the parameters work

Setting switch S1=OFF

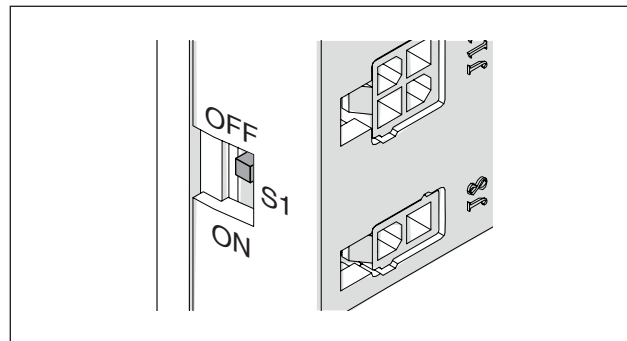

Essential parameters to be configured for the block diagram 2:

	Managing	Depending
S1	OFF	OFF
Dip-switch	1 to ON	2-10 to ON
Par.5073	Managing	Dependent
Par.4147	no. of depending modules installed	/
Par.2007	greater than/equal to 10°C	greater than/equal to 10°C
Par.9097	1	1(*)


(*) Par.9097 = 9 (Zone control with Depending module)
 Par.9097 = 49 (Zone control with Depending module)
 for models POWER MAX 50 P DEP - POWER MAX 50 P.

Specific parameters to be configured for the block diagram 2:

	Managing	Depending
Par.4079	adjust according to requirements	/
Par.4080	adjust according to requirements	/
Par.4081	adjust according to requirements	/
Par.4086	adjust according to requirements	/
Par.4087	adjust according to requirements	/
Par.5169	adjust according to requirements	/
Par.5170	adjust according to requirements	/
Par.5171	adjust according to requirements	/
Par.5176	adjust according to requirements	/
Par.5177	adjust according to requirements	/


3.7 Block diagram 3

Circuit with thermal modules with their own two-way valve, connected in cascade. Primary system with system circulator.

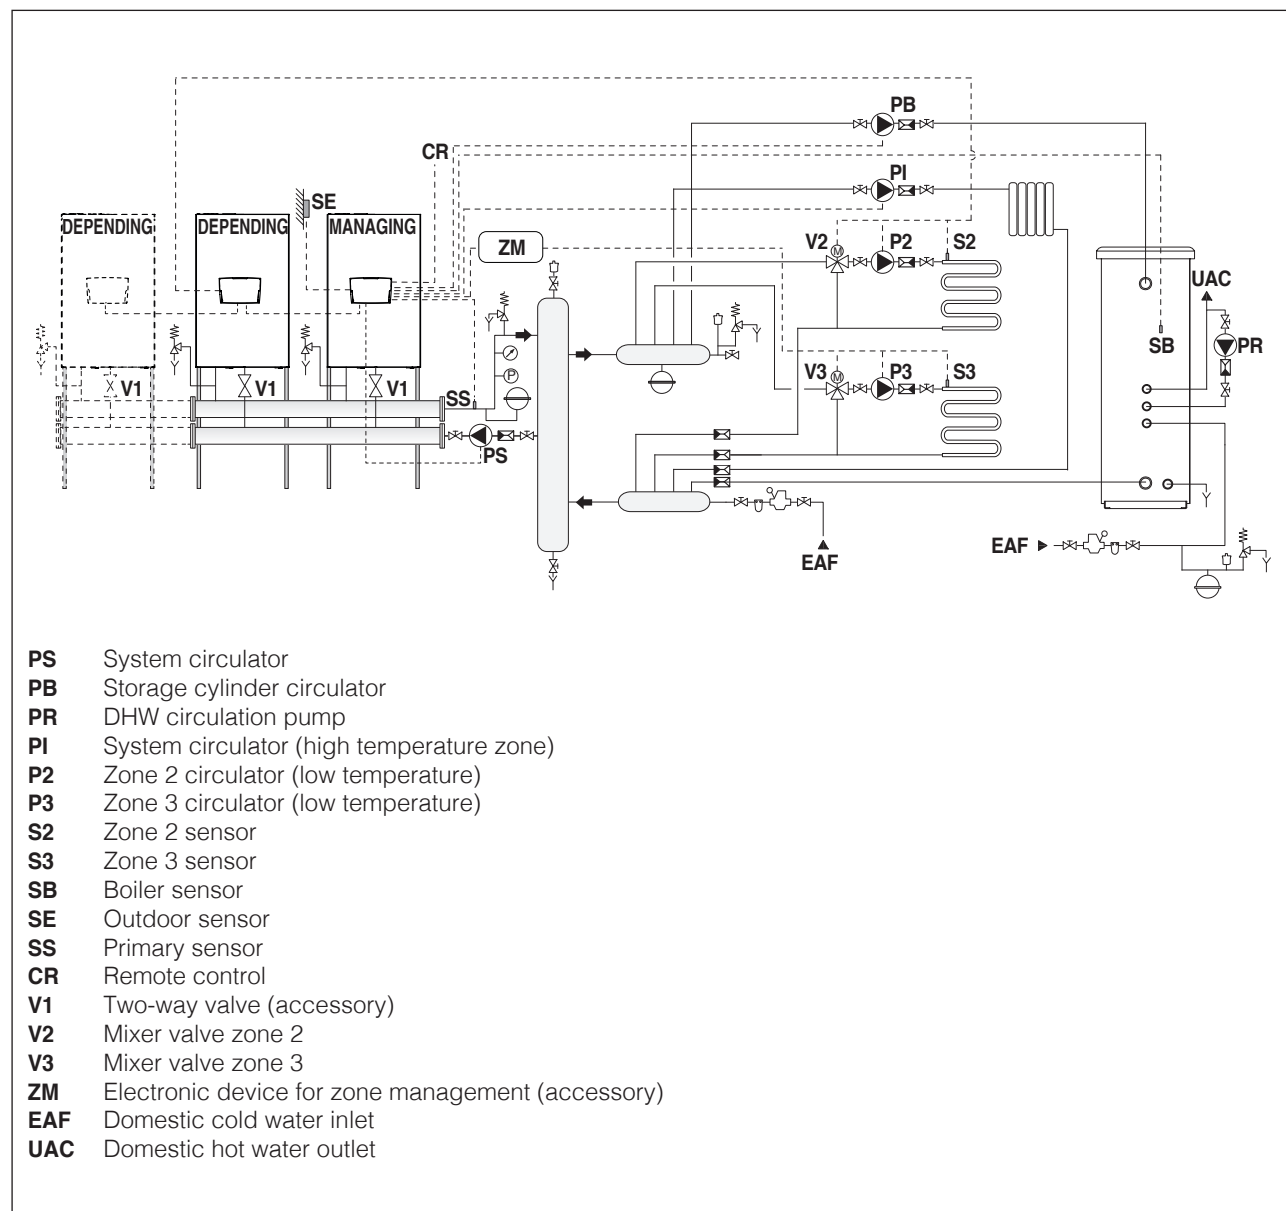


3.7.1 Electrical power connections Block diagram 3


MANAGING CONNECTIONS

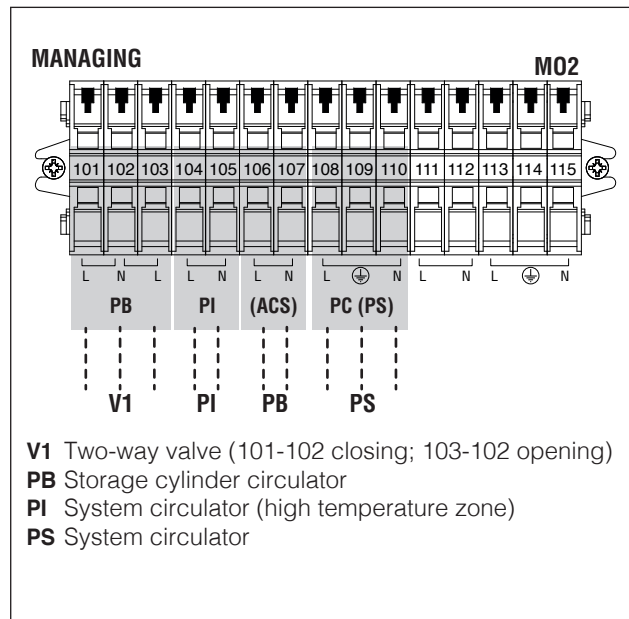

DEPENDING CONNECTIONS

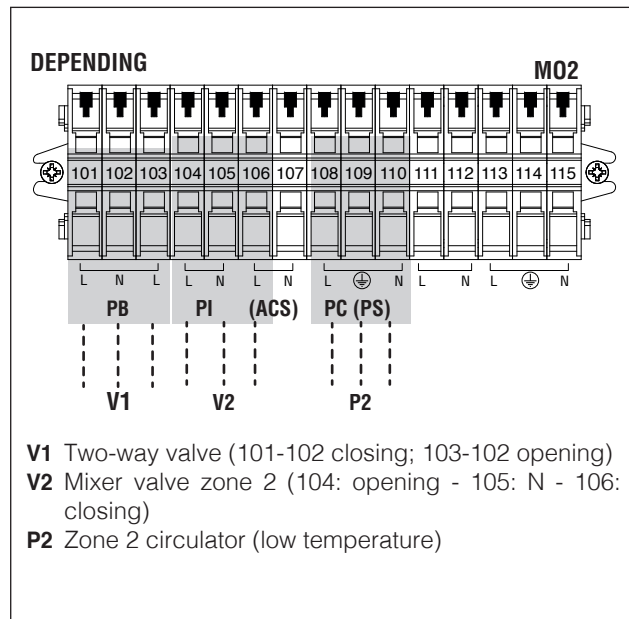


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

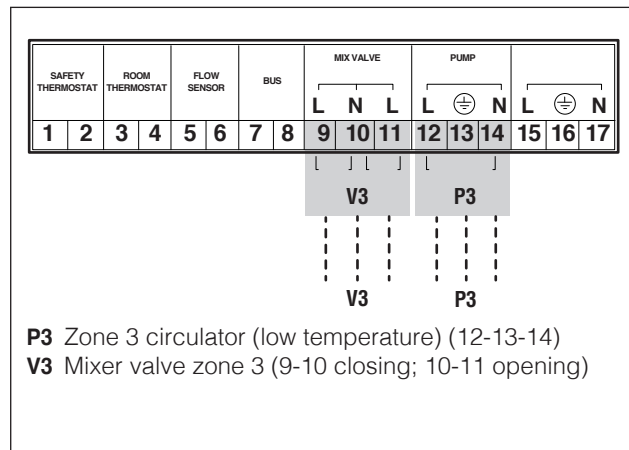


Some electric connections of the power jig have a double function. The hot water tank circulator PB must be connected to the terminals 106-107 of the thermal module configured as the Managing module. The two-way valve V1 of each thermal module must be connected to terminals 101-102-103 for both the Managing module and the Depending module.

3.7.2 Sensor connections Block diagram 3


MANAGING CONNECTIONS

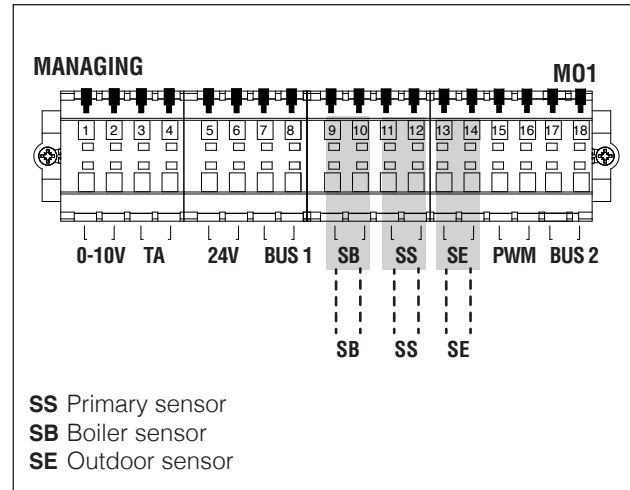

DEPENDING CONNECTIONS

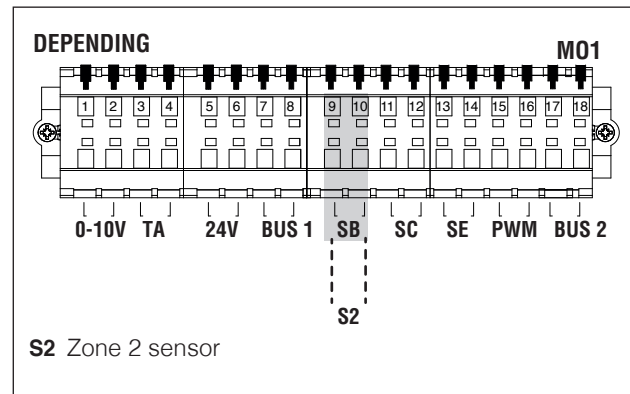


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

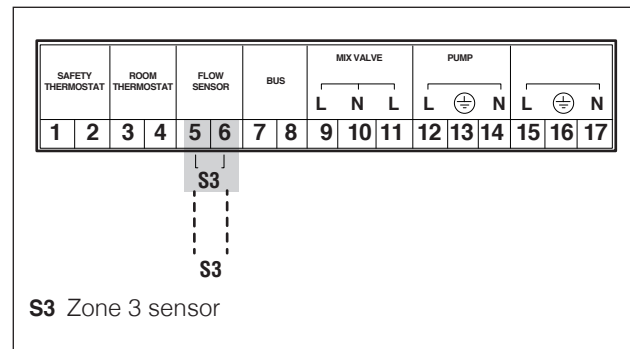


3.7.3 Bus connections Block diagram 3

See the section "System management" for a detailed description of the connections between the modules.


MANAGING CONNECTIONS

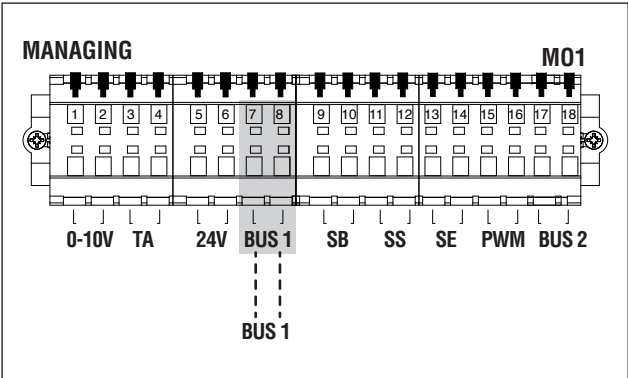

DEPENDING CONNECTIONS

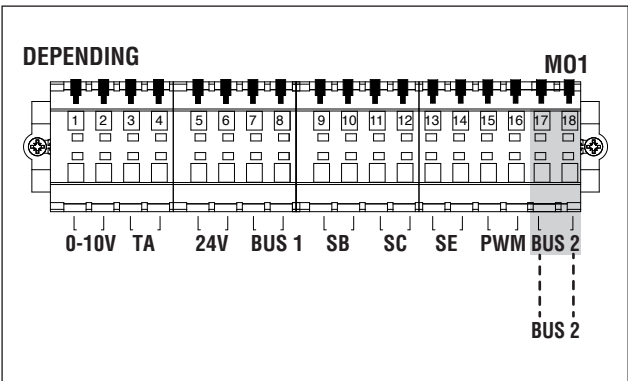


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

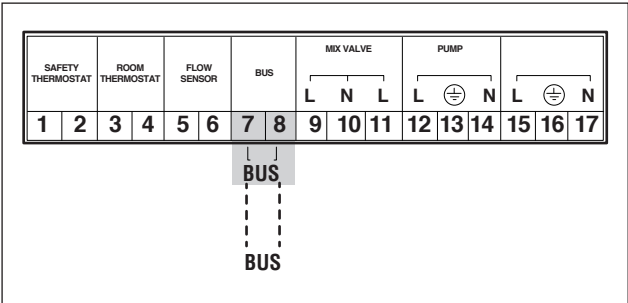

3.8 System parameters Block diagram 3

⚠ See section "Commissioning and maintenance" for a detailed description of how the parameters work

Setting switch S1=OFF

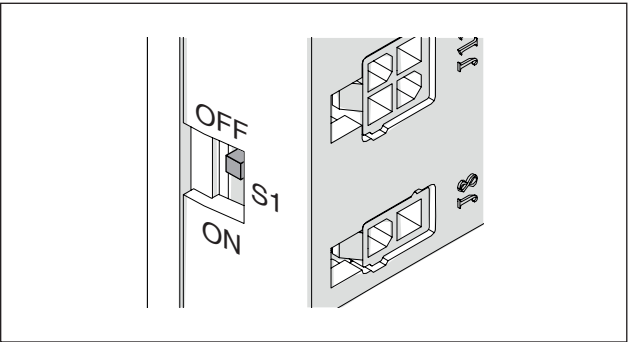

Essential parameters to be configured for the block diagram 3:

	Managing	Depending
S1	OFF	OFF
Dip-switch	1 to ON	2-10 to ON
Par.5073	Stand-alone	Dependent
Par.4147	no. of depending modules installed	/
Par.2007	greater than/equal to 10°C	greater than/equal to 10°C
Par.9097	2	2(*)

(*) Par.9097 = 8 (Zone control with Depending module)


⚠ The 9097=8 configuration CANNOT be applied to models with a boiler circulator installed as standard.

Specific parameters to be configured for the block diagram 3:

	Managing	Depending
Par.4079	adjust according to requirements	/
Par.4080	adjust according to requirements	/
Par.4081	adjust according to requirements	/
Par.4086	adjust according to requirements	/
Par.4087	adjust according to requirements	/


3.9 Block diagram 4

Circuit with thermal modules with their own two-way valve, connected in cascade. Primary system with system circulator. Using the secondary sensor.

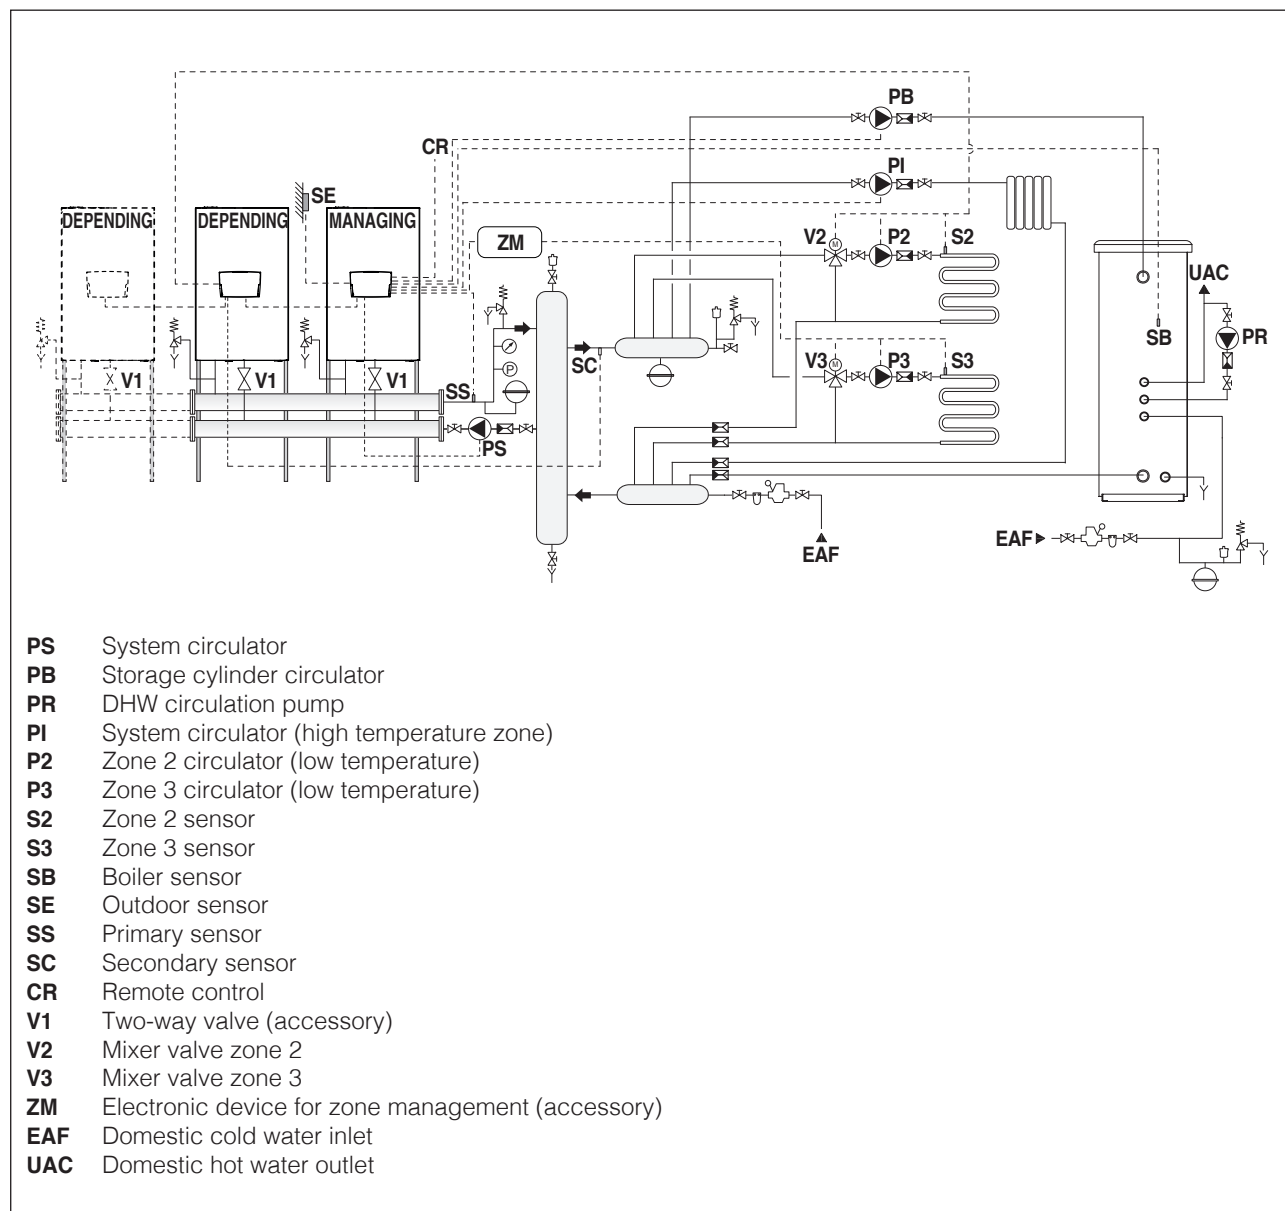


3.9.1 Electrical power connections Block diagram 4


MANAGING CONNECTIONS

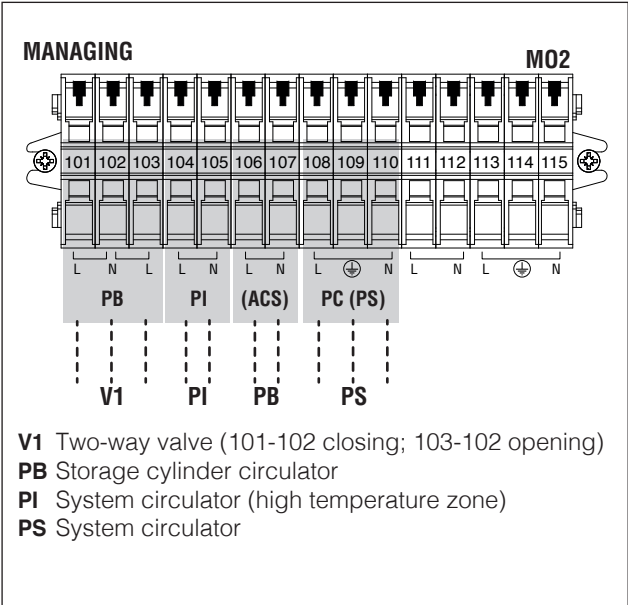

DEPENDING CONNECTIONS

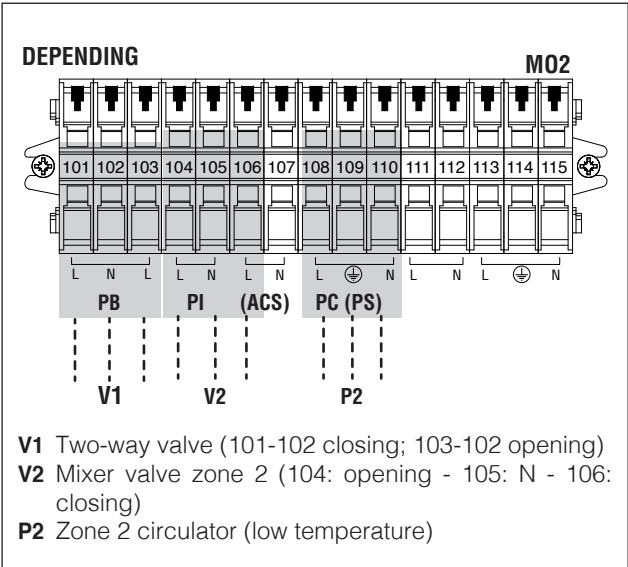


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

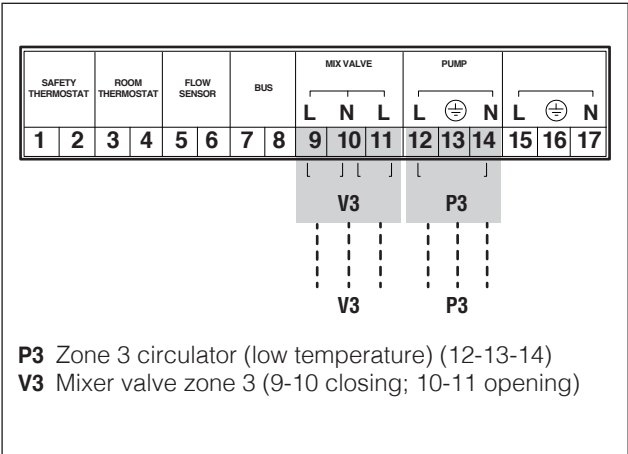

Some electric connections of the power jig have a double function. The hot water tank circulator PB must be connected to the terminals 106-107 of the thermal module configured as the Managing module. The two-way valve V1 of each thermal module must be connected to terminals 101-102-103 for both the Managing module and the Depending module.


3.9.2 Sensor connections Block diagram 4

MANAGING CONNECTIONS

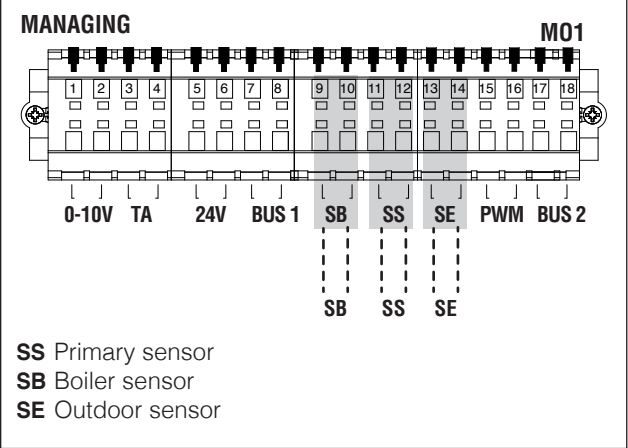


DEPENDING CONNECTIONS

Connections to be made on the first depending module only.

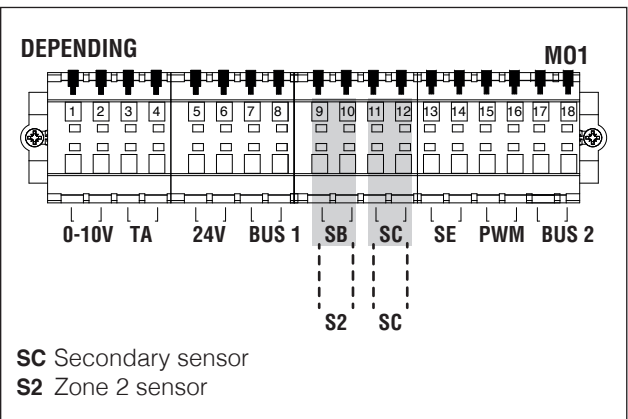


ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

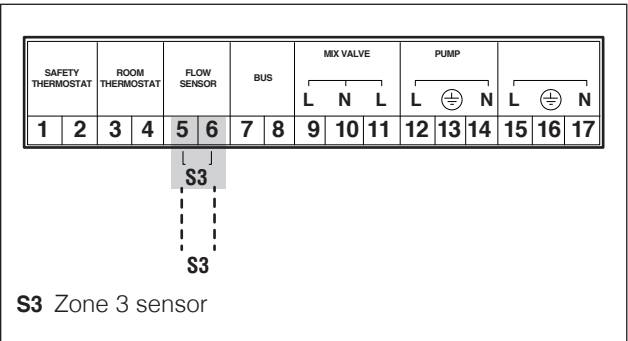


3.9.3 Bus connections Block diagram 4

See the section "System management" for a detailed description of the connections between the modules.


MANAGING CONNECTIONS

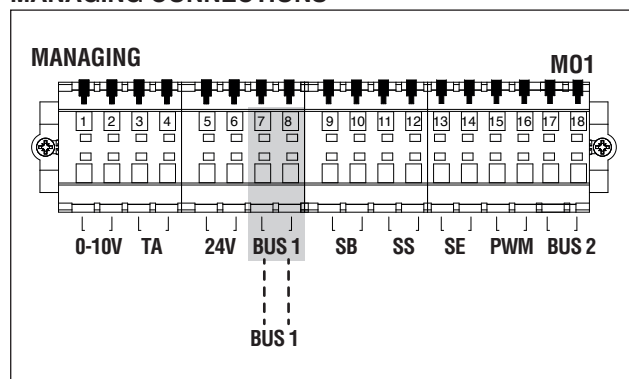

DEPENDING CONNECTIONS

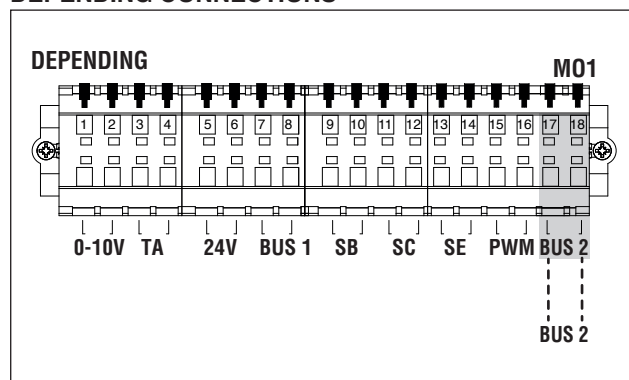

ACCESSORY CONNECTIONS FOR ADDITIONAL ZONE

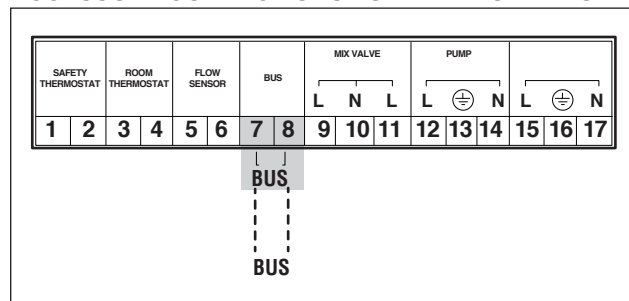


3.10 System parameters Block diagram 4



See section "Commissioning and maintenance" for a detailed description of how the parameters work

Setting switch S1=OFF

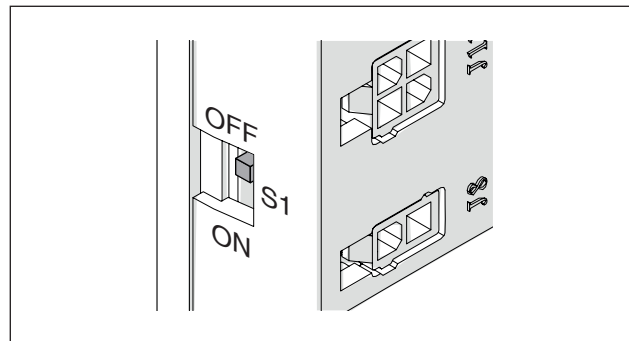

Essential parameters to be configured for the block diagram 4:

	Managing	Depending
S1	OFF	OFF
Dip-switch	1 to ON	2-10 to ON
Par.5073	Managing	Dependent
Par.4147	no. of depending modules installed	/
Par.2007	greater than/equal to 10°C	greater than/equal to 10°C
Par.9097	2	2(*)

(*) Par.9097 = 8 (Zone control with Depending module)



The 9097=8 configuration CANNOT be applied to models with a boiler circulator installed as standard.

Specific parameters to be configured for the block diagram 4:

	Managing	Depending
Par.4079	adjust according to requirements	/
Par.4080	adjust according to requirements	/
Par.4081	adjust according to requirements	/
Par.4086	adjust according to requirements	/
Par.4087	adjust according to requirements	/
Par.5169	adjust according to requirements	/
Par.5170	adjust according to requirements	/
Par.5171	adjust according to requirements	/
Par.5176	adjust according to requirements	/
Par.5177	adjust according to requirements	/

4 SYSTEM MANAGEMENT

4.1 Communication between the thermal modules

Communication between all the modules installed is a fundamental aspect in a system with multiple thermal modules.

The essential steps for configuration are:


- allow the Managing module to recognise which and how many depending modules are present in the system. Act on the dip-switch
- connect the thermal modules with a BUS cable to allow communication between the control units.

4.1.1 Setting the dip-switch


The dip-switches of all the thermal modules in the system must be set, and each must be set with an unequivocal sequence.







This way the controller of the Managing module will be able to recognise which thermal modules are present in the system.

To access the dip-switches, open the hatch using a flat-bladed screwdriver.

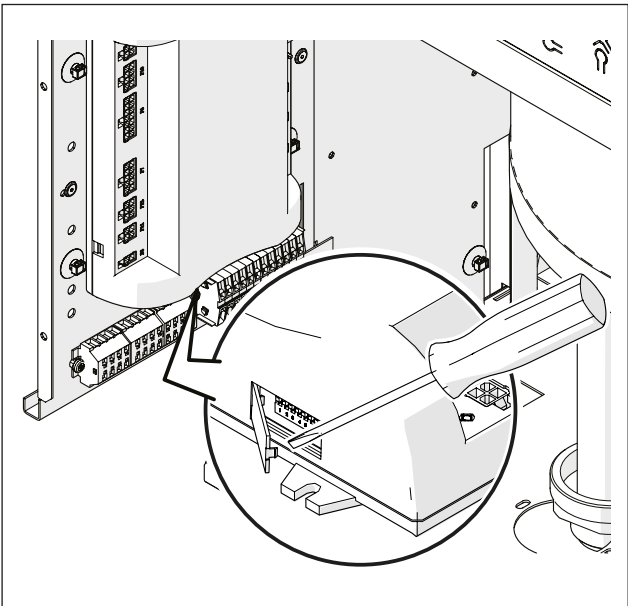

 The setting must be carried out on each thermal module. For configuration of the individual thermal module, refer to the following table.

Key	
	Dip switch ON
	Dip switch OFF
Setting the Dip-switch	Thermal Module Configuration
	Stand-alone module (all the dip-switches set to OFF, configuration not used in cascade)
	1st module (Managing)

Setting the Dip-switch	Thermal Module Configuration
	2nd module (Depending)
	3rd module (Depending)
	4th module (Depending)
↓	
	8th module (Depending)
	9th module (Depending)
	10th module (Depending)


 If two modules have the same Dip-switch setting, the Managing module will signal a communication error and the cascade will not work correctly.



 A module will not be considered if it has the setting of all the Dip-switches set to OFF.

4.2 Bus connections

Identify the terminals located below the controller. The bus connections are to be made on the low voltage terminal board (M01).

Thermal module terminal board

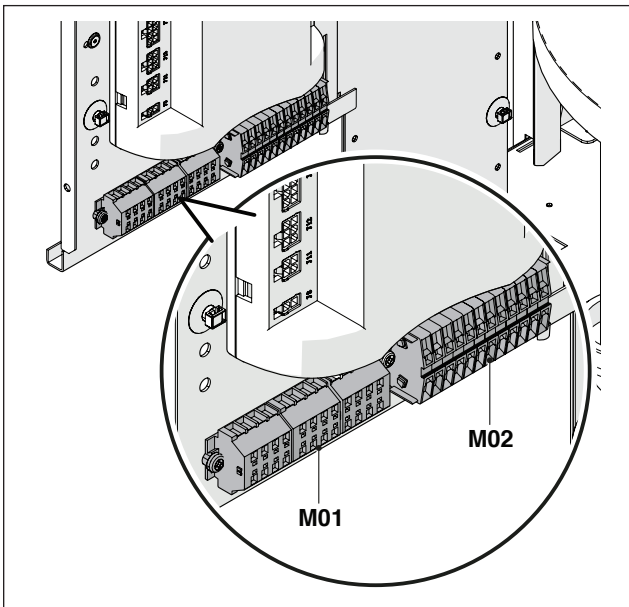

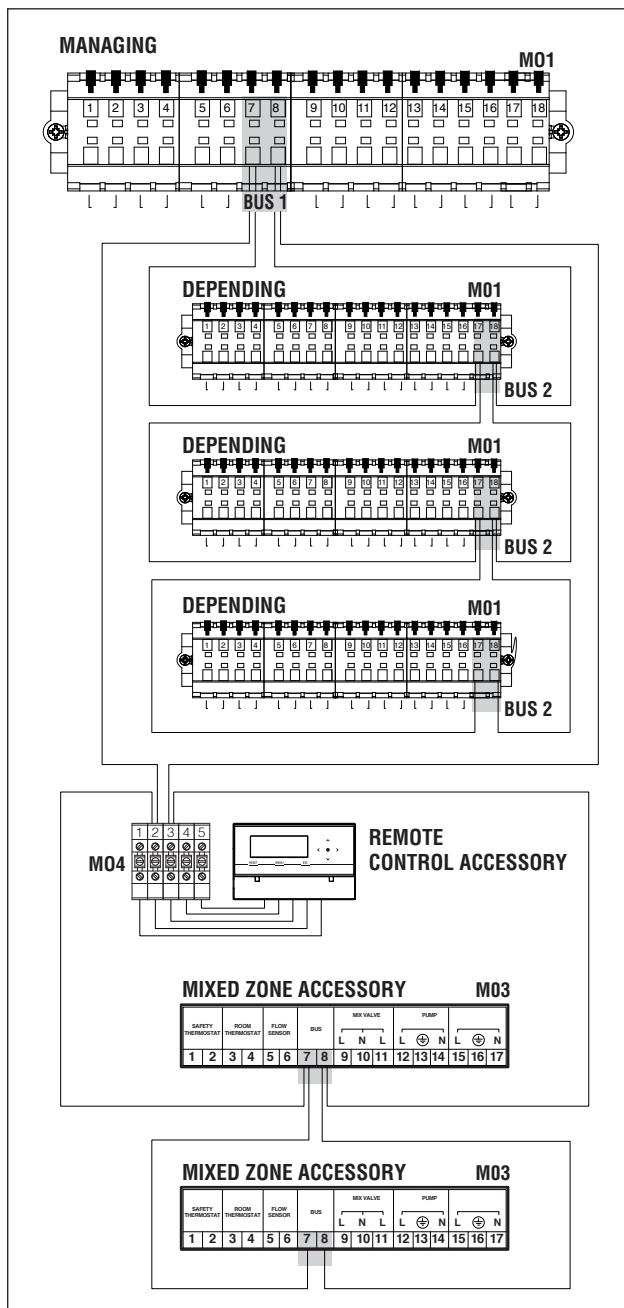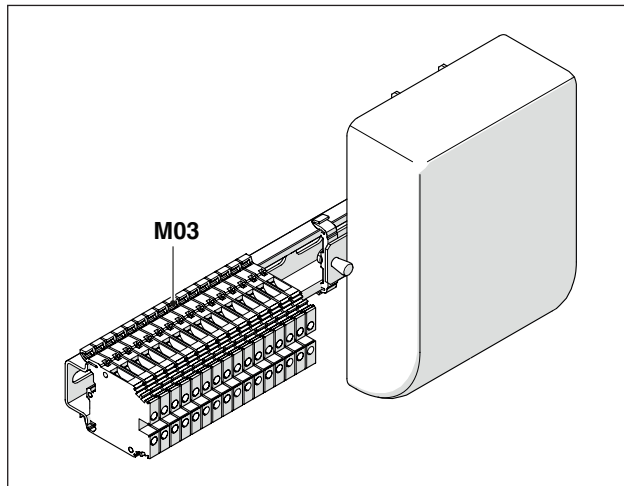

⚠ The bus connection to the Depending thermal modules must be made in parallel without the closing terminal which would cause a short circuit.

4.3 Communication with Mixed Zone Controller


The mixed zone controller connected to the system must be set with a specific number of recognition actions, so that the electronic board of the thermal module recognises which zone is making the heat request.

The number of recognition actions is set with the help of the jumpers to be applied to each pair of pins.

⚠ The setting must be carried out on each board of the additional zone accessory. To assign the required number to the additional zone, refer to the following table, applying the jumpers to the positions illustrated from 1-4.

⚠ If two zones have the same address, one of the two will not be recognised.

⚠ To configure the zones the remote control accessory is required.

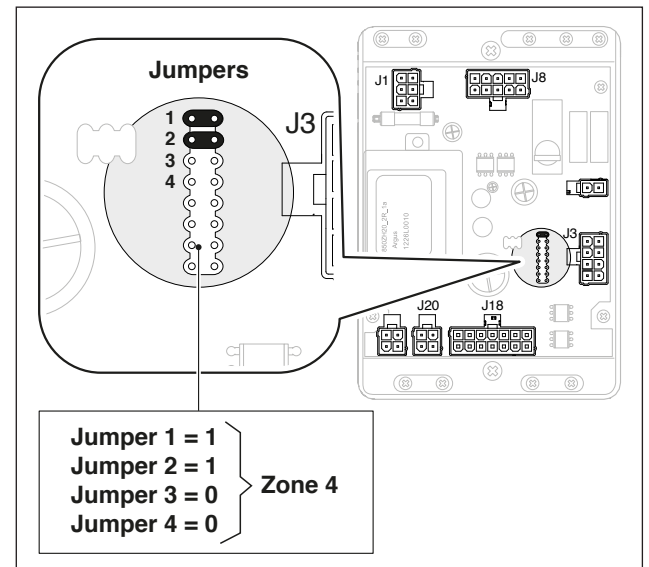


Jumpers				Zone number
1	2	3	4	
0	0	0	0	1
1	0	0	0	2
0	1	0	0	3
1	1	0	0	4
0	0	1	0	5
1	0	1	0	6
0	1	1	0	7
1	1	1	0	8
0	0	0	1	9
1	0	0	1	10
0	1	0	1	11
1	1	0	1	12
0	0	1	1	13
1	0	1	1	14
0	1	1	1	15
1	1	1	1	16

5 COMMISSIONING AND MAINTENANCE

5.1 Repositioning the front panels

Before putting the appliance into service, make sure that all the thermal modules have been reassembled with their own front panel:


- 1 Insert the panel into the seats on the points (B).
- 2 Push it forwards until contact is made and then secure using the designated screw (A).

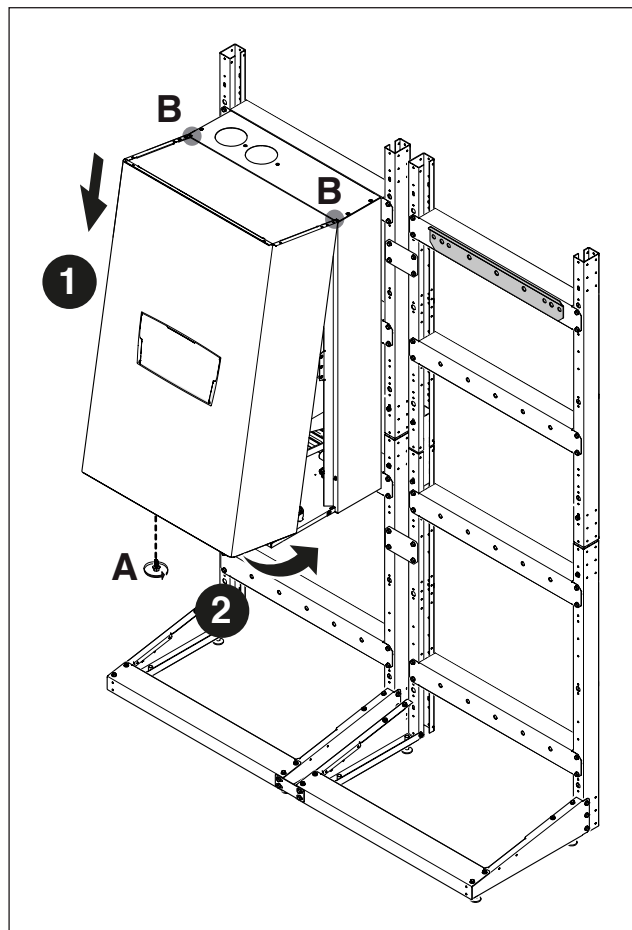


5.2 Putting the system into service

The first time the **POWER MAX** is used, the following checks and operations must be carried out:


- Check that the gas cock and heating water cock are open

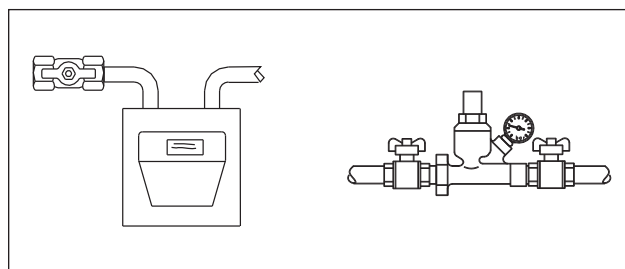

- Check that the pressure of the hydraulic circuit when cold is always greater than 1 bar and less than the maximum limit permitted for the system

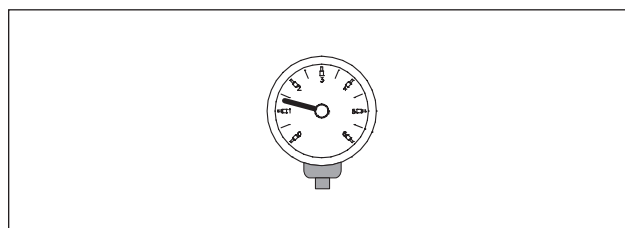

- Set the main switch of the system to ON and the main switch of all the thermal modules to (I), starting with the Managing thermal module.

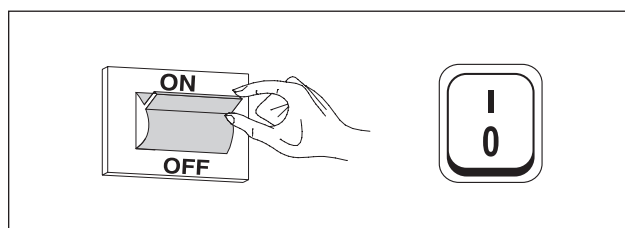


5.3 Electronic control

 For further information on the electronic control, refer to the specific section in the user manual of the individual appliance **POWER MAX**.

5.3.1 USER navigation MENU

Whilst turning on or when any key is pushed for more than 4 minutes, the display is placed on the "basic display" and it provides some general information on the thermal module.

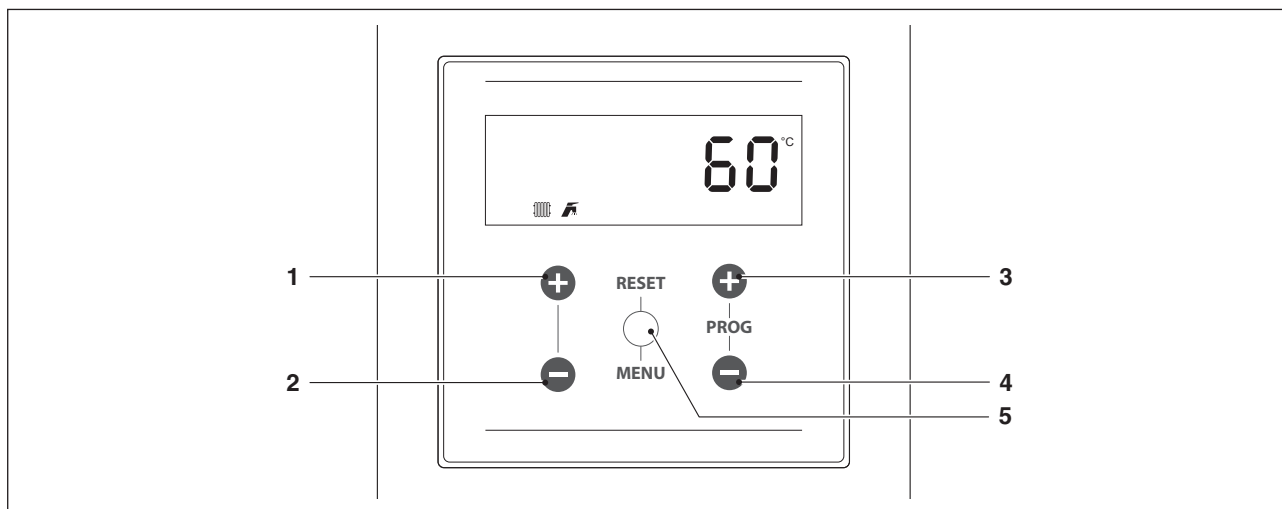


In this mode, keys have the following functions:

Nr.	Button	Function
1	"+"	Raise the heat set point (when available)
2	"-"	Decrease the heat set point (when available)
3	"PROG +"	Raise the DHW set point (when available)
4	"PROG -"	Decrease the DHW set point (when available)
5	"MENU/RESET"	Enters into "MENU" mode If pressed for more than 2 seconds, it resets a non volatile failure

MENU selection

Enters into "MENU" mode when "MENU/RESET" key is pushed. The figures of the small display indicate "0000" which is the first accessible menu.

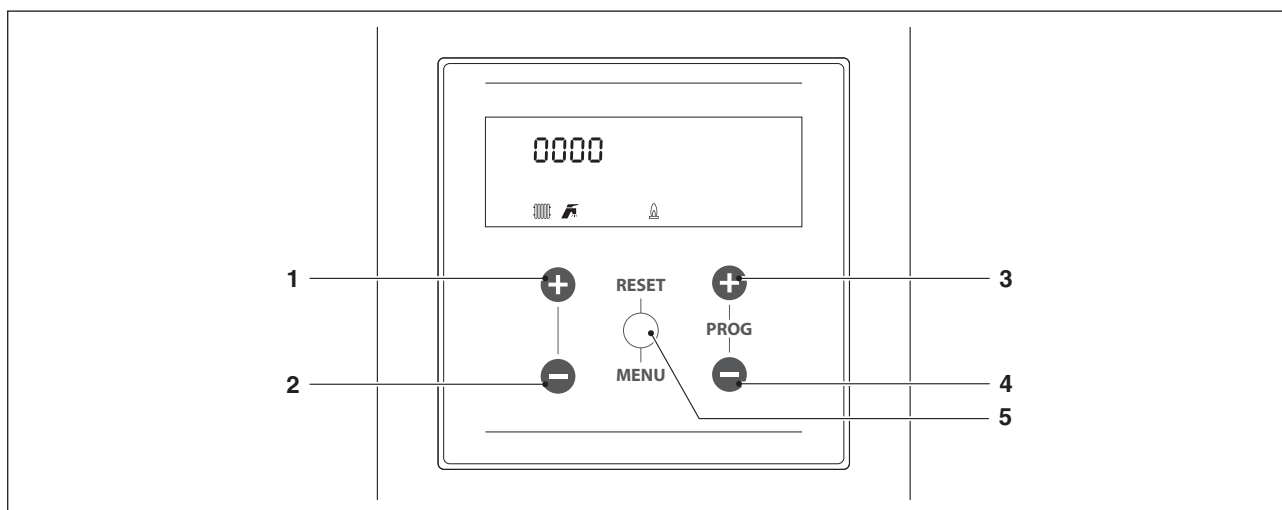

In this mode, keys have the following functions:

Nr.	Button	Function
1	"+"	Exits from the menu and cancels a parameter change
2	"-"	Exits from the menu and cancels a parameter change
3	"PROG +"	Selects the following menu or increases a certain parameter value
4	"PROG -"	Selects the previous menu or decreases a certain parameter value
5	"MENU/RESET"	Enters into the selected menu/parameter or confirms the parameter change


5.3.2 Navigation Menu INSTALLER / MANUFACTURER

It is necessary to enter the password to access the INSTALLER / MANUFACTURER parameters

- Press "MENU/RESET" and select "Code" by using the "PROG +" and "PROG -".



- Press "MENU/RESET" to confirm
- "0---" is displayed on the big numeric display and the first digit is blinking

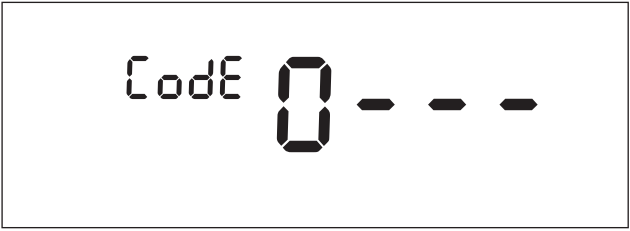


- Press "PROG +" and "PROG -" to increase or decrease the value of the first blinking digit
- When the desired value is reached on the single figure, press "MENU/RESET" to confirm the inserted value thus the second digit starts blinking
- Repeat the same procedure for all four figures and enter the password

After entering the INSTALLER or MANUFACTURER password, the related menu and parameters will be displayed.

The system provides for three types of access:

- USER: password 0000
- INSTALLER: password 0300
- MANUFACTURER

 After it is entered, the password is active during display and/or parametrisation. If the display is inactive for a few minutes, it needs to be re-entered.

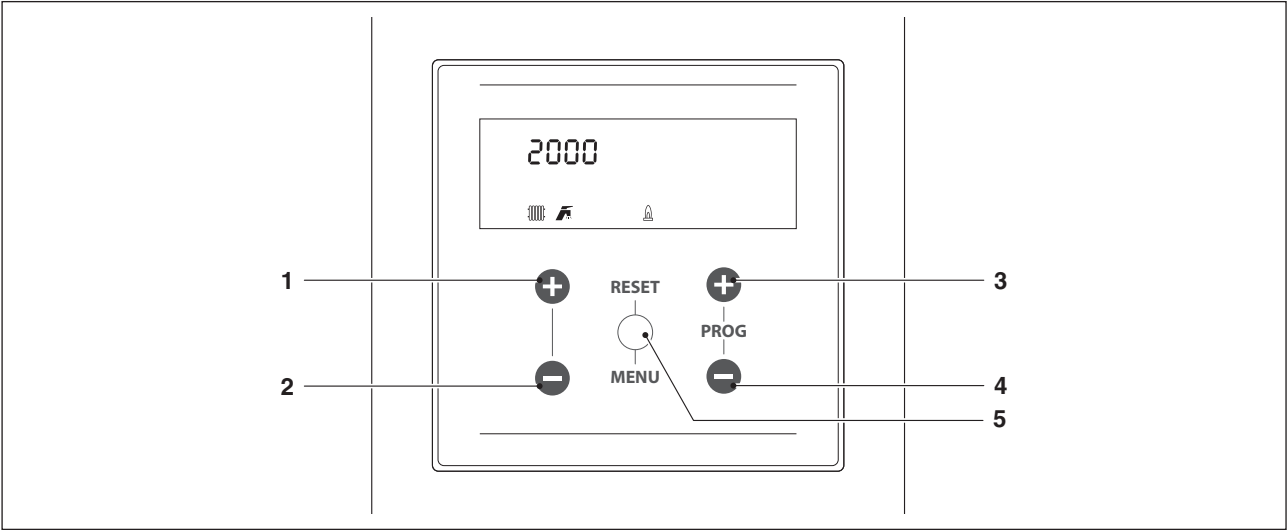

In this mode, keys have the following functions:

Nr.	Button	Function
1	"+"	Exits from the menu and cancels a parameter change
2	"-"	Exits from the menu and cancels a parameter change
3	"PROG +"	Selects the following menu or increases a certain parameter value
4	"PROG -"	Selects the previous menu or decreases a certain parameter value
5	"MENU/RESET"	Enters into the selected menu/parameter or confirms the parameter change

5.3.3 Parameters specific to cascade systems

Parameters are listed base on the reference menu.

Reference Menu

2000 Parameters Menu
4000 Cascaded module configuration menu
5000 Cascaded boiler configuration menu
9000 Appliance configuration menu

Access type

U End user
I Installer
O Manufacturer

Menu	Par. No.	Nr. displayed Display	Description	Range	Factory setting	UM	Access type	Category
4000	4072	Permit Emergency Mode	Activates the emergency mode. This mode comes on when communication between Managing and the primary circuit's probe is lost. In this event, if Par. 4072 is set to "Yes", the cascade is initiated, working to the fixed set-point determined by Par. 4074.	Yes/No	Yes		U	Cascade
4000	4074	Emergency Set-point	Set-point active in emergency mode.	20...65	70	°C	I	Cascade
4000	4075	Delay Per Start Next Mod.	Defines the stand-by time in seconds to restart the subsequent cascade module in normal start mode.	5...255	120	Sec.	I	Cascade
4000	4076	Delay Per Stop Next Mod.	Defines the stand-by time in seconds to switch off the last cascade module on in normal Off mode.	5...255	30	Sec.	I	Cascade
4000	4142	Delay Quick Start Next	Defines the stand-by time in seconds to restart the next cascade module in quick start mode.	5...255	60	Sec.	I	Cascade
4000	4143	Delay Quick Stop Next	Defines the stand-by time in seconds to switch off the last cascade module on in Quick Stop mode.	5...255	15	Sec.	I	Cascade
4000	4077	Hyst. Down Start Module	Defines by how many degrees the temperature measured by the primary circuit's probe must fall below the set-point in order for the subsequent module to be started after the time interval set by Par. 4075.	0...40	5	°C	I	Cascade
4000	4078	Hyst. Up Stop Module	Defines by how many degrees the temperature measured by the primary circuit's probe must go above the set-point in order for the subsequent module to be switched off after the time interval set by Par. 4076.	0...40	4	°C	I	Cascade
4000	4144	Hyst. Down Quick Start	Defines by how many degrees the temperature measured by the primary circuit's probe must go below the set-point in order for the subsequent module to be started after the time interval set by Par. 4142 (quick-start mode).	0...40	20	°C	I	Cascade
4000	4145	Hyst. Up Quick Stop	Defines by how many degrees the temperature measured by the primary circuit's probe must go above the set-point in order for the subsequent module to be switched off after the time interval set by Par. 4143 (quick stop mode).	0...40	6	°C	I	Cascade
4000	4146	Hyst. Up Stop All	Defines by how many degrees the temperature measured by the primary circuit's probe must go above the set-point in order for all "On" modules to be switched off at the same time.	0...40	8	°C	I	Cascade
4000	4147	Number of Units	Defines the number of modules of which the cascade consists.	1...16	8		I	Cascade

Menu	Par. No.	Nr. displayed Display	Description	Range	Factory setting	UM	Access type	Category
4000	4148	Power Mode	Defines the cascade operation mode.	0 Disabled 1 Min burners 2 Max burners	2		I	Cascade
4000	4079	Max. Setp. Offset Down	Defines the maximum decrease in the primary circuit's cascade set-point. Is based on the primary circuit's probe reading.	0...40	2	°C	I	Cascade
4000	4080	Max. Setp. Offset Up	Defines the maximum increase in the primary circuit's cascade set-point. Is based on the primary circuit's probe reading.	0...40	5	°C	I	Cascade
4000	4081	Start Mod. Delay Fact.	Defines the time in minutes from the moment the demand is triggered until the activation of the set-point increases or decreases provided for by Par. 4079 e 4080.	0...60	60	Min.	I	Cascade
4000	4082	Next Module Start Rate	It defines the minimum power for at least one of the modules in the cascade in order for the next module to be switched on (if the other conditions linked to Par. 4075 and 4077 are met).	10...100	80	%	I	Cascade
4000	4083	Next Module Stop Rate	It defines the maximum power for all the modules in the cascade in order for the last module on to be switched off (if the other conditions linked to Par. 4076 and 4078 are met).	10...100	25	%	I	Cascade
4000	4084	Module Rotation Interval	It defines the time interval (in days) after which modules are rotated.	0...30	1	Days	I	Cascade
4000	4149	First Module to Start	Establishes the number of the next module to be rotated (this value is automatically updated at each rotation).	1..16	1		I	Cascade
4000	4086	PID P	Defines the proportional term to change the setpoint of the cascade module.	0...1275	50		O	Cascade
4000	4087	PID I	Defines the integral term to change the setpoint of the cascade module.	0...1275	500		O	Cascade
4000	4150	PID Slew Rate Up	Defines the speed (in °C/100 ms) with which the set-point of individual modules is increased in the event the primary circuit's set-point is not achieved (if the value is set to zero, the change is controlled by the PI of Par. 4086 and 4087 without restrictions).	0...25.5	1		O	Cascade
4000	4151	PID Slew Rate Dn	Defines the speed (in °C/100 ms) with which the set-point of individual modules is decreased in the event the primary circuit's set-point is exceeded (if the value is set to zero, the change is controlled by the PI of Par. 4086 and 4087 without restrictions).	0...25.5	1		O	Cascade
4000	4152	Pwr-Mode2 Min Power	Defines the power value (in percentage terms) against which the average power of all on modules in cascade operation mode must be compared (Par. 4148 = 2).	0...100	20	%	I	Cascade
4000	4153	Pwr-Mode2 Hysteresis	Defines the extra power value (in percentage terms) compared to the average power of all on modules in cascade operation mode (Par. 4148 = 2).	0...100	40	%	I	Cascade

Menu	Par. No.	Nr. displayed Display	Description	Range	Factory setting	UM	Access type	Category
4000	4154	Post-Pump Period	Defines overrun time in seconds at the end of the cascade heat demand.	0...255	60	Sec.	I	Cascade
4000	4155	Frost Protection	Defines the temperature (detected by the primary sensor) below which the thermal module circulator and the system circulator (with cascade configuration) activate. If the temperature of the primary sensor falls another 5 degrees below the value set by Par. 4155, then a request to activate the cascade is generated. When the temperature of the primary sensor reaches the value defined by Par. 4155 increased by 5 degrees, then the request ceases and the cascade returns to stand-by mode.	10...30	15	°C	I	Cascade
4000	5073	Boiler Address	Defines the manner with which the thermal module is addressed.	Managing, Stand-alone, Dependent	Stand-alone		I	Cascade
5000	5169	Max. Setp. Offset Down	Defines the maximum decrease in the primary circuit's cascade set-point. Is based on the secondary circuit's probe reading.	0...40	2	°C	I	Cascade
5000	5170	Max. Setp. Offset Up	Defines the maximum increase in the primary circuit's cascade set-point. Is based on the secondary circuit's probe reading.	0...40	5	°C	I	Cascade
5000	5171	Start Mod. Delay Fact.	Defines the time in minutes from the moment the request is triggered until the activation of the set-point increases or decreases provided for by Par. 5169 e 5170.	0...60	40	Min.	I	Cascade
5000	5176	PID P	Defines the proportional term to change the set-point of the cascade module based on the secondary circuit's temperature.	0...1275	25		O	Cascade
5000	5177	PID I	Defines the integral term to change the set-point of the cascade module based on the secondary circuit's temperature.	0...1275	1000		O	Cascade
5000	5178	PID Slew Rate Up	Defines the speed (in °C/100 ms) with which the set-point of individual modules is increased in the event the secondary circuit's set-point not reached (if the value is set to zero, the change is controlled by the PI of Par. 5176 and 5177 without restrictions).	0...25.5	1		O	Cascade
5000	5179	PID Slew Rate Dn	Defines the speed (in °C/100 ms) with which the set-point of individual modules is decreased in the event the primary circuit's set-point is exceeded (if the value is set to zero, the change is controlled by the PI of Par. 5176 and 5177 without restrictions).	0...25.5	1		O	Cascade
9000	9097	Model	Allow to set the values of Par. from 2116 to 2128 through some pre-set values which define the configuration of the inlets and outlets of the module.	1...2/8...9			I	General
9000	2205	Dep. Zone Control	Enables the control of the additional heating zone managed by the thermal module. 0 = Disabled 1 = Enabled	0...1	0		U	General

5.3.4 Setting the main parameters


Some parameters are essential in order for the system to operate in cascade and setting these parameters is a determining factor for correct system operation.

5.3.5 Par.5073 – Managing, Stand-alone, Dependent mode.

Parameter 5073 defines how the thermal module is addressed and serves to ensure that the signal from the secondary sensor is recognised.


Three values can be set:

- **1** to be set on the Managing module so that secondary sensor operation is activated.
N.B.: The secondary sensor SC must be connected to the 2nd burner (1st Depending module);
- **0** to be set on the Managing module so that secondary sensor operation is deactivated;
- **2 ÷ 7** to be set on all Depending modules.



5.3.6 Par.4147 – No. thermal modules


Parameter 4147 defines the number of thermal modules in the system (it is important to set the number of connected modules for the system to work properly). This parameter must only be set on the "Managing" module.



5.3.7 Par.2007 – heating setpoint hysteresis

The parameter 2007 adjust shutdown of the individual modules when the setpoint is exceeded. With cascade operation, this value must be increased (up to a maximum of 20°C) to prevent module operation from being disabled (since the default value is 5°C) if the system decides to increase the setpoint based on the value read on the primary or secondary sensor (see explanation in paragraphs "General operation", "Operation with the primary sensor" and "Operation with the secondary sensor")

This parameter is to be modified (in the same way) on all modules of the cascade (Managing module and all the relative Depending modules).




5.3.8 Par.9097 – definition of the system with circulator / system with two-way valve

The parameter 9097 serves to quickly configure the inputs and outputs on the board of each module in order to adapt operation if a circulator is present or if a two-way valve is present.

This parameter must be configured correctly on both the Depending modules and the Managing module.

Parameter 9097 must be set to 1 (or 49 mod. **POWER MAX** 50 P DEP - 50 P) if system 1 or 2 is used (characterized by the use of the pump) on the contrary, it must be set to 2 if you are using system 3 or 4 (characterized by the use of the two-way valve).



5.3.9 General operation

With cascade operation, the regulator of the managing module establishes a setpoint to be sent to the depending modules based on the parameters 4086-4087, the difference between the setpoint value set and the value read on the primary delivery manifold (or on the basis of par 5176-5177 and the difference between the setpoint value set and the value read on the secondary delivery manifold).

On the basis of the setpoint received from the Managing module, each module modulates based on its own PID (Par 2016, Par 2017 and Par 2018) as a function of the difference between the setpoint (sent by the Managing module) and the value read by the delivery sensor on the module itself.



The PID is a Proportional-Integral-Derivative control system (abbreviated to PID) with retro-action. By reading an input value which determines the current value, it is able to react in the event of a positive or negative error (difference between the current value and the target value), tending towards 0. Reaction to the error can be regulated through the terms "proportional, integral, derivative".

5.4 Operation with the primary sensor

The system sensor present on the primary system (see block diagrams 1 and 3) allows the setpoint sent to the individual modules to be modulated on the basis of the difference between the setpoint and the value read on the delivery manifold of the primary system.

The following parameters regulate this modulation:

- 4079** defines the maximum setpoint decrease
- 4080** defines the maximum setpoint increase
- 4081** defines the time (from the start of the request) from which the setpoint modulation is started
- 4086** proportional parameter for setpoint modulation
- 4087** integrative parameter for setpoint modulation

5.5 Operation with the secondary sensor

When the secondary system is present (see block diagrams 2 and 4), the setpoint sent to the individual modules to be modulated on the basis of the difference between the setpoint and the value read on the delivery manifold of the secondary system.

In the same way that modulation is based on the system sensor, the following parameters intervene:

- 5169** defines the maximum setpoint decrease
- 5170** defines the maximum setpoint increase
- 5171** defines the time (from the start of the request) from which the setpoint modulation is started
- 5176** defines the proportional term for setpoint modulation
- 5177** defines the integrative term for setpoint modulation


5.6 Parameter 4148: operating mode of the cascade

It is possible to adopt cascade management which can be modified according to different strategies. These different strategies can be set using the parameter known as "Cascade mode" Par. 4148.

5.6.1 Par 4148 = 0

The start-up/shutdown law of each module is based on the following graph.

The shut-off values of the lines with the y axis are the sum or the difference of the values of the corresponding parameter in relation to the value of the setpoint sent by the Managing module to the modules.

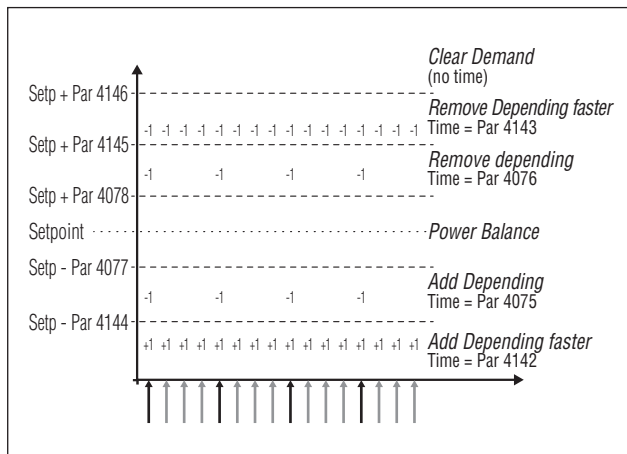

Six bands are defined on the basis of the temperature read (by the Managing module) on the delivery manifold of the primary system.

- In the central band **Power balance**, defined (by the variable parameters) around a setpoint, no start-ups or shutdowns of the Depending modules are envisaged.

The parameters which define this band are 4077 and 4078.

- In the band **Remove dependent** and **Add dependent**, the start-ups and shutdowns are carried out with "long" time intervals which can differ between start-up and shutdown.

The parameters which define this band are 4077, 4078, 4144, 4145. The time interval is defined by parameters 4075 and 4076.

- In the band **Remove dependent Faster** and **Add dependent Faster**, start-ups and shutdowns are carried out with a "short" time interval which, even in this case, can differ between start-up and shutdown. The shutdown band is between the values of parameters 4146 and 4145, while the start-up band is below the value defined by parameter 4144. The time range is defined by parameters 4142 and 4143.


- In the band **Clear demand**, all the thermal modules are immediately stopped. This band is above the value defined by parameter 4146.

5.6.2 Par 4148 = 1

In this mode the system manages the cascade so that the minimum number of modules is on.

The first difference in relation to mode 0 refers to the logic with which the modulation of Depending modules within the cascade is managed.

In fact, while each thermal module modulates with its own PID in mode 0, no more than two Depending modules modulate with the same criteria in mode 1, while the remaining modules operate at maximum power. The diagram is represented in the following figure:

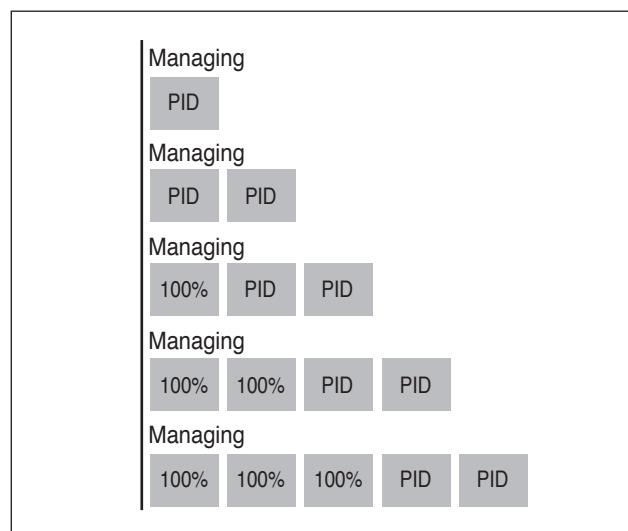

Practically speaking, if more than two thermal modules are on, only two thermal modules are controlled via PID, while the others receive a signal to move to maximum power. The second difference refers to the start-up/shutdown rules of the individual modules.

In any case, the start-up and shutdown rules are managed according to the indications shown in the previous graph. The difference is that it is also possible to have start-ups/shutdowns of the Depending modules in the "balancing" zone.

This additional start-up criteria (valid in the balancing band only) ensures that a module is started-up when any one of the two modules controlled by a PID adjustment has reached a threshold power (Par 4082) once a specific wait time defined by Par 4075 has elapsed.

Similarly (still within the balancing band), a module is shut-down if both modules controlled by a PID adjustment have reached a percentage of power which is below the minimum power threshold (Par 4083) once a specific wait time defined by Par 4075 has elapsed.

5.6.3 Par 4148 = 2

In this mode the system manages the cascade so that the maximum number of modules is on.

This mode is similar to mode 0 apart from the start-up and shutdown rules.

In this case the rules based on the information illustrated by the previous graph are still valid, with the following differences (in any case, always applicable to the "balancing" band only):

To add an additional depending module, the managing module evaluates whether the sum of the power (calculated on the basis of the fan speed) of all the active thermal modules is greater than the product between the number of the active depending modules increased by one and the minimum power value (Par 4152) increased by a hysteresis value (defined by Par 4153). $[\sum (P1, P2, \dots Pn) > (n+1) * (Par 4152) + (Par 4153)]$.

To shutdown a depending access, the managing module evaluates whether the sum of the power (calculated on the basis of the fan speed) of all the active thermal modules is less than the product between the number of the active depending modules and the minimum power value (Par 4152). $[\sum (P1, P2, \dots Pn) < (n) * (Par 4152)]$.



We must consider that the percentage of power varies from a minimum of 1% and a maximum of 100% and therefore, the parameter values 4152 and 4153 are not to be taken as the percentage of absolute power.

**Via Risorgimento, 23 A
23900 - Lecco (LC)**

www.berettaboilers.com

The manufacturer strives to continuously improve all products. Appearance, dimensions, technical specifications, standard equipment and accessories are therefore liable to modification without notice.

